

INCH-POUND

RR-C-901E

1 July 2010

SUPERSEDING

RR-C-901D

21 February 2003

## FEDERAL SPECIFICATION

### CYLINDERS, COMPRESSED GAS: SEAMLESS SHATTERPROOF, HIGH PRESSURE DOT 3AA STEEL, AND 3AL ALUMINUM

The General Services Administration has authorized the use of this federal specification by all federal agencies.

#### 1. SCOPE AND CLASSIFICATION

1.1 Scope. This specification provides the acquisition requirements for the purchase of empty compressed gas cylinders to be used for storage, transportation, and distribution of high pressure liquefied and gaseous industrial and medical compressed gases including air, argon, carbon dioxide, helium, hydrogen, nitrogen, oxygen, sulfur hexafluoride, and other gases.

1.2 Classification. The cylinders shall be of the following types, intended gas service, sizes, and valve designations (see 6.2).

- Type I - DOT 3AA steel
- II - Non-shatterable steel
- III - Aluminum

Intended gas service - See table I

Size - See tables II and III

Valve designation - See table IV

Comments, suggestions, or questions on this document should be addressed to Defense Supply Center Richmond, ATTN: DSCR-VEB, 8000 Jefferson Davis Highway, Richmond, VA 23297-5616, or e-mailed to [STDZNMGT@dla.mil](mailto:STDZNMGT@dla.mil). Since contact information can change, you may want to verify the currency of this address information using the ASSIST database at <https://assist.daps.dla.mil/>.

## RR-C-901E

1.3 International standardization agreement code numbers.

STANAG 2121 (see 6.8)

STANAG 7146 (see 6.8)

## 2. APPLICABLE DOCUMENTS

2.1 Government publications. The issues of the following documents, in effect on the date of invitation for bids or request for proposal, form a part of this specification to the extent specified herein.

## Commercial Item Descriptions

A-A-59503

- Nitrogen, Technical

A-A-59860

- Valves, Cylinder, Gas (for Compressed or Liquefied Gases)

(Activities outside the federal government may obtain copies of federal specifications, standards, and commercial item descriptions as specified in the General Information section of the Index of Federal Specifications, Standards and Commercial Item Descriptions. The index is for sale on a subscription basis from the General Services Administration, Federal Supply Service, Specification Section, East 470 L'Enfant Plaza SW, Suite 8100, Washington, DC 20407.)

(Single copies of these specifications, and other federal specifications and commercial item descriptions required by activities outside the federal government for bidding purposes are available without charge from the General Services Administration, Federal Supply Service, Specification Section, East 470 L'Enfant Plaza SW, Suite 8100, Washington, DC 20407.)

(Federal government activities may obtain copies of federal standardization documents and the Index of Federal Specifications, Standards and Commercial Item Descriptions from established distribution points in their agencies. Electronic copies may be obtained from <https://assist.daps.dla.mil/>.)

## Military Specifications

MIL-DTL-17376/1

- Caps and Flanges, Compressed-Gas Cylinder: Caps

MIL-DTL-17376/3

- Caps and Flanges Compressed-Gas Cylinder: Flanges, High Pressure

## Military Standard

MIL-STD-101

- Color Code for Pipelines and for Compressed Gas Cylinders

## RR-C-901E

(Copies of military specifications and standards required by contractors in connection with specific procurement functions are obtained from the Standardization Document Order Desk, Building 4D, 700 Robbins Avenue, Philadelphia, PA 19111-5094. Electronic copies may be obtained from <https://assist.daps.dla.mil/>.)

## Code of Federal Regulations (CFR)

|                       |   |
|-----------------------|---|
| 49 CFR 173, subpart G | - Gases; Preparation and Packaging                    |
| 49 CFR 173.34         | - Qualification, Maintenance and Use of Cylinders     |
| 49 CFR 178            | - Specifications for Packagings                       |
| 49 CFR 178, subpart C | - Specifications for Cylinders                        |
| 49 CFR 178.37         | - Specification 3AA and 3AAX Seamless Steel Cylinders |
| 49 CFR 178.46         | - Specification 3AL Seamless Aluminum Cylinders       |

(The CFR is for sale on a subscription basis from the Superintendent of Documents, P.O. Box 371954, Pittsburgh, PA 15250-7954. When indicated, reprints of certain regulations may be obtained from the federal agency responsible for issuing them. Electronic copies may be obtained from <http://www.gpoaccess.gov/cfr/>.)

## National Aeronautics and Space Administration (NASA)

|               |  |
|---------------|--|
| NASA-STD-6001 | - Flammability, Odor, Offgassing, and Compatibility Requirements and Test Procedures for Materials in Environments that Support Combustion |
|---------------|--|

(Application for copies should be addressed to NASA Technical Standards, EL01, MSFC, AL 35801 (Phone: 205-544-2448). Electronic copies may be obtained from <http://standards.nasa.gov/>.)

2.2 Other publications. The following documents form a part of this specification to the extent specified herein. Unless a specific issue is identified, the issue in effect on the date of invitation for bids or request for proposal shall apply.

## ASTM International

|           |  |
|-----------|--|
| ASTM A370 | - Standard Test Methods and Definitions for Mechanical Testing of Steel Products |
| ASTM E23  | - Standard Test Methods for Notched Bar Impact Testing of Metallic Materials     |

(Application for copies should be addressed to ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959. Electronic copies may be obtained from <http://www.astm.org/>.)

## RR-C-901E

## Compressed Gas Association (CGA)

|            |  |
|------------|--|
| CGA G-10.1 | - Commodity Specification for Nitrogen   |
| CGA S-1.1  | - Pressure Relief Device Standards Part 1 – Cylinders for Compressed Gases                     |
| CGA TB-15  | - Requirements for the Post Manufacture Tare Weight Marking of Cylinders                       |
| CGA TB-17  | - Test Methods for Evaluating Paints and Coatings on Refillable Steel Compressed Gas Cylinders |

(Application for copies should be addressed to the Compressed Gas Association, 4221 Walney Road, 5th Floor, Chantilly, VA 20151-2923. Electronic copies may be obtained from <http://www.cganet.com/>.)

## 3. REQUIREMENTS

3.1 Material, design, and construction. All cylinders shall conform to the specifications found in 49 CFR 178, subpart C. The seamless steel cylinders shall conform to Department of Transportation (DOT) specification 3AA, type 4130X steel in accordance with 49 CFR 178.37. The aluminum cylinders shall conform to DOT specification 3AL in accordance with 49 CFR 178.46. The physical characteristics, accessories and special requirements shall be as specified herein and in the acquisition document. The cylinder shall be newly fabricated within one year of the date of the contract or acquisition order.

3.2 Construction.

3.2.1 Stability. Cylinders shall be true to form and shall be stable in the upright position.

3.2.2 Fragmentation resistance (non-shatterability). The fragment resistance or non-shatterability (shatterproof) characteristics of the cylinder shall be determined by either the resultant wall stress value of the cylinder at the minimum designated test pressure or by the performance of the specified gunfire test (see 4.3.4). Cylinders manufactured to DOT specification 3AA of 4130X steel that are greater than four inches in outside diameter shall have a maximum wall stress of 70,000 psig as stated in 49 CFR 178.37. Cylinders manufactured to DOT specification 3AA of 4130X steel that are less than four inches in diameter shall have a maximum wall stress of 60,000 psig. Cylinders meeting these requirements shall be acceptable as non-shatterable cylinders and shall be steel stamped "NONSHAT". Cylinders manufactured to DOT specification 3AA of 4130X steel that are less than four inches in diameter and have a resultant wall stress value greater than 60,000 psig must pass the gunfire test to be acceptable as shatterproof cylinders. Steel cylinders manufactured of other than 4130X steel to DOT specification 3AA and all aluminum cylinders must pass the gunfire test to be acceptable as shatterproof cylinders.

3.2.3 Impact resistance. When impact resistance is specified (see 6.2), samples of each heat of steel represented in a lot of cylinders shall have a minimum lateral expansion of 0.015 inches or greater than 50 percent fibrous fracture at a temperature not higher than -58 °F (-50 °C) in accordance with ASTM E23. Sub-sized samples from a cylinder wall may be used or a sample

## RR-C-901E

from a cylinder wall of greater thickness may be used if the source, processing, and heat treatment of the steel parallels the source, processing, and heat treatment of the cylinders under consideration.

### 3.3 Cylinder processing.

3.3.1 Preconditioning and internal preservation. After hydrostatic and any other testing, the cylinder internal surface shall be cleaned and dried to be free of moisture, oil, grease, grit, machining products, loose scale, slag, or other foreign materials. Rust bloom or particulate matter (approximately 1.0 to 1.5 grams) generated subsequent to inspection as a result of handling and shipping is acceptable. Cleaning agents used shall be compatible with the cylinder materials and the intended gas service.

3.3.2 Oil and hydrocarbon residue. Residual oil and other hydrocarbons resulting from the manufacture of the cylinder shall be removed to a level not greater than 2.5 milligrams (mg) per square foot of internal surface area, but shall not exceed 20 mg per cylinder regardless of the size of the cylinder. Trailer tubes shall not contain more than 40 mg of oil or residual hydrocarbons. Verification of cleanliness shall be measured by gravimetric or infrared analysis or any equivalent chemical analysis method.

3.3.3 Moisture content. Cylinders tested hydrostatically and/or internally flushed for cleaning, or cylinders that were tested or flushed with moisture-laden air, shall be immediately dried with hot filtered air or nitrogen to insure the effluent air or gas has a dew point lower than 30 °F (-1 °C). Immediately after internal drying, the cylinder shall be closed with the designated valve or plug (see table IV).

3.3.4 Internal cylinder preparation. When specified (see 6.2) or as needed, the internal surface of steel cylinders shall be cleared of all mill scale, rust, and oxidation to the reduced metal level by use of an abrasive process such as shot or bead blasting. Aluminum cylinders shall be cleaned free of residue by vapor degreasing or equivalent process.

3.3.5 Internal cylinder preservation. When specified (see 6.2), cylinders closed with a valve shall be pressurized to approximately 5 psig with dry oil-free nitrogen, type I, grade A or B, class 1, in accordance with A-A-59503, or type I, grade L or better in accordance with CGA G-10.1. The cylinder shall then be tagged at the valve with "PRESERVED WITH NITROGEN GAS".

3.4 Tare weight. The cylinder's maximum tare weight shall be as specified in tables II or III and shall be stamped into the shoulder of the cylinder in a position other than in sequence with another DOT permanent marking (see 3.6.1). The marking shall be displayed as required by CGA TB-15. The marking shall represent the tare weight of the cylinder and valve with an accuracy of 1 percent and shall be displayed in pounds (lb.) and ounces (oz.) unless otherwise specified.

3.5 Delivery date. The cylinders shall be newly fabricated and delivered within one year from the date of manufacture.

## RR-C-901E

3.6 Cylinder identification. Unless otherwise specified herein, markings shall be in characters not less than 0.25 inch (6.350 millimeters (mm)) high. On cylinders 6 inches (152.4 mm) in outside diameter or larger, the markings shall be in characters 0.375 inch (9.525 mm) high.

3.6.1 Standard permanent markings. The standard permanent markings as required by the appropriate DOT specification shall be plainly and permanently marked by stamping into the shoulder or the neck of each cylinder.

3.6.2 Additional special permanent markings. The following permanent markings shall be stamped into the shoulder or neck of the cylinder as they are specified or as they apply to the cylinder being manufactured or its dedicated application:

3.6.2.1 Ownership markings. All cylinders being purchased by a U.S. Government agency shall be stamped with "US GOVT" to indicate government ownership. Cylinders four inches or greater in diameter shall be marked with 0.375-inch (9.525 mm) characters. Cylinders less than four inches in diameter shall be stamped with 0.25-inch (6.350 mm) characters. The symbols shall be stamped directly below or offset 90 degrees from the DOT permanent markings.

3.6.2.2 Tare weight. All cylinders being used in liquefied gas application shall have the tare weight applied to the cylinder (see 3.4).

3.6.2.3 Impact resistance. All cylinders tested and designated impact resistant shall have the designation of "-50 °C" applied to the cylinder.

3.6.2.4 Shatterproof. All cylinders meeting the shatterproof characteristics of this specification shall be stamped "NONSHAT".

3.6.3 Special markings. The following special markings shall be applied as specified in the acquisition order (see 6.2) when required:

3.6.3.1 Special cylinder applications. When specified, cylinders designated for aviators breathing oxygen (ABO), nitrogen, and compressed air used in aircraft servicing shall be stenciled with the equivalent service pressure in kilopascals.

3.6.3.2 Specific gas applications. All cylinders that have been designated for a specific gas application shall be color-coded and stenciled in accordance with MIL-STD-101.

3.6.3.3 Medical gas cylinders. All government medical cylinders, both government-owned and vender-owned, shall be color-coded and stenciled in accordance with MIL-STD-101. All materials provided in the cylinder package shall pass the applicable tests specified in NASA-STD-6001.

3.6.3.3.1 Medical services tag. A military medical services tag shall be used on filled medical cylinders when they are purchased as part of a medical gas commodity contract. The tag shall be attached to each cylinder and the markings shall include the national stock number, the name of the specified gas, cylinder size, cylinder capacity in gallons, lot number, contract number, cylinder serial number, contractor's name or registered trademark, and necessary precautionary

## RR-C-901E

markings. The statement, "CAUTION: Federal Law Prohibits Dispensing Without Prescription." shall appear on the tag, if it does not appear on the cylinder. In addition, tags for nitrous oxide cylinders shall bear the markings for total gross weight of the cylinder, tare weight, and net weight (weight of nitrous oxide liquid). These markings shall allow weights to be indicated in pounds and ounces. The tags shall be furnished with a metal eyelet and stringing wire. The wire shall be tinned, annealed, or galvanized, and be not less than 23 gauge.

Tag colors shall be as follows:

|            |   |                         |
|------------|---|-------------------------|
| Background | - | Same color as cylinders |
| Print      | - | Black                   |
| OR         |   |                         |
| Background | - | White                   |
| Print      | - | Same color as cylinders |

The bottom of the tag shall be designed with a three-part legend marked on both sides with perforated lines between the legends for easy removal as follows:

"EMPTY"  
 "IN USE"  
 "FULL"

3.6.3.3.2 Marking for medical cylinders. Medical cylinders shall be permanently marked. The markings shall be in characters not less than 0.188 inch (4.775 mm) high for cylinders less than 6 inches in outside diameter and not less than 0.375 inch (9.525 mm) high for cylinders 6 inches or more in outside diameter as follows:

- a. The capacity in gallons shall be marked on the shoulder of each cylinder. (Capacities shall be at 15 °C (59 °F) and 760 mm Hg (29.9213 in. Hg).)
- b. To the right of the manufacturer's symbol, the letters "MED" shall be added either horizontally or vertically.
- c. Name of gas abbreviated as follows:

| <u>Gas</u>    | <u>Stamped</u>   | <u>Stenciled</u>       |
|---------------|------------------|------------------------|
| Oxygen        | O <sub>2</sub>   | OXYGEN - U.S.P.        |
| Nitrous oxide | N <sub>2</sub> O | NITROUS OXIDE - U.S.P. |

3.7 Treatment and painting. The treatment and painting of cylinders shall be by any method or system that will provide a finish that meets the requirements of CGA TB-17. The cylinders shall be color coded and stenciled in accordance with MIL-STD-101 for the dedicated gas for which the cylinder is designated. When required, treatment and painting (finish) for aluminum cylinders shall be as specified in the acquisition order (see 6.2).

## RR-C-901E

3.8 Intended gas service. The intended gas service shall be selected from table I. Cylinder compatibility with the intended gas or liquid contents shall comply with the requirements of 49 CFR 173, subpart G.

3.9 Physical characteristics. The cylinder service (operating) pressure and its physical characteristics shall be selected from tables II or III. The dimensional tolerances shall be  $\pm 0.25$  inch for the diameter and  $\pm 1.00$  inch for the height.

3.10 Components. Each industrial gas cylinder with capacity of 625 cubic inches or greater and all medical cylinders with a capacity of 300 cubic inches or greater shall be fitted with a neck flange in accordance with MIL-DTL-17376/3 with a mating valve protection cap in accordance with MIL-DTL-17376/1. Fire extinguisher and industrial gas cylinders with a capacity less than 625 cubic inches, and "D" and "E" size medical cylinders (size codes BP and BQ) shall be supplied without caps and flanges.

3.10.1 Neck flange. The cylinder neck flange shall be pressed on or peened tight around the neck and onto the shoulder of the cylinder. It shall be visibly free of defects (cracks, pits, scale, etc.) or foreign materials (sand, flux, etc.). The flange threads shall be clean cut and free of any damage.

3.10.2 Valve protection cap. The cylinder neck flange shall mate with a valve protection cap of the size and thread designated in MIL-DTL-17376/1. The cap shall turn smoothly and freely on its threads to full thread engagement. The cap shall be free of any cracks or dents and shall be painted the same color and with the same quality as the shoulder of the cylinder.

3.10.3 Pressure relief device. The cylinder and valve assembly shall be furnished with a pressure relief device that is rated for the service pressure of the cylinder, and as stipulated in the designated valve specification. All pressure relief devices shall be selected and tested in accordance with CGA S-1.1 as required by 49 CFR 173.34.

3.10.4 Closure (valve or plug). The cylinder shall be furnished with a designated valve in accordance with A-A-59860 (see table IV) when specified. The valve shall meet the requirements of A-A-59860 as referenced by the part or identifying number (PIN). Unless otherwise specified (see 6.2), the inlet thread size of the valve shall be as specified in tables II or III herein. When a valve is not designated, the cylinder shall be closed with a brass plug (with hex wrenching flats) and Teflon tape to afford proper sealing and easy removal.

3.10.4.1 Medical service cylinders. All cylinders fabricated for medical services shall be supplied with a medical valve as specified. Each medical cylinder shall be equipped with a flange and a valve protection cap unless otherwise specified.

3.11 Workmanship. Cylinders, valves, plugs, flanges, and caps shall be cleaned and free from grit, fins, pits, and loose scale. Edges shall be rounded and chamfered. Cylinders shall be cleaned and free of dents, scratches, and any other surface defects detrimental to the intended use.

## RR-C-901E

## 4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or acquisition order (see 6.2), the contractor is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or acquisition order (see 6.2), the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the government. The government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure that supplies and services conform to prescribed requirements.

4.2 Quality conformance inspection.

4.2.1 Lot. A lot shall consist of not more than 200 cylinders offered for delivery at the same time.

4.2.2 Sampling.

4.2.2.1 For examination. Sampling for examination shall be in accordance with 49 CFR 178.37.

4.2.2.2 Oil content. Unless otherwise specified in the contract or acquisition order (see 6.2), the testing for hydrocarbons shall be 1 in 200 cylinders.

4.2.2.3 Impact resistance. Charpy impact samples shall be prepared from each heat of steel represented in a lot of cylinders. The sample plate shall be taken from a fabricated cylinder representative of the heat of steel and the lot of cylinders to be tested and prepared in accordance with ASTM E23. Sub-size samples are acceptable. The sample plate shall be of a length, width, and thickness to provide six Charpy impact test specimens.

4.2.3 Examination. The sample cylinders shall be examined as specified in 4.2 for the characteristics in table V.

4.3 Test methods.

4.3.1 Leakage. Cylinders with a valve threaded into the cylinder shall be charged to the indicated service pressure with oil-free air or nitrogen. The cylinder shall be immersed in water covering the valve and neck of the cylinder and observed for bubbles for two minutes. Any bubbles shall constitute failure of the test. Leakage occurring around the valve stem may be corrected and the cylinder retested.

4.3.2 Oil and hydrocarbon residue. Place a clean plug, cork, or rubber stopper in the cylinder neck, clean the area around it thoroughly with heptafluorocyclopentane (HFCPA) solvent, and wipe dry with a clean cloth. For cylinders with less than three square feet of internal surface area, remove the plug and pour in 300 milliliters (mL) of the solvent. For larger cylinders, add an additional 100 mL for each square foot of internal area over 3 square feet. Replace the plug and lay the cylinder on its side. Roll or rotate through 360 degrees on a level surface or level rolling/tumbling machine for a minimum of 10 minutes to assure all the internal surfaces have been thoroughly wetted with solvent. Remove the solvent extract into a clean beaker. Any

## RR-C-901E

undissolved liquid floating on the surface of the solvent would indicate the presence of water or glycerin. The solvent extract shall be analyzed for hydrocarbons by one of the following methods:

4.3.2.1 Evaporation method. Evaporate the extract to dryness at slightly below the boiling point and finish the drying in an oven at 221 °F (105 °C)  $\pm$  1.8 °F (1 °C) for 15 minutes. Cool, weigh, and report as milligrams of extracted oil. All traces of solvent shall be removed from the cylinder upon completion of this test. Nonconformance to the requirements paragraph 3.3.2 shall constitute failure of this test.

4.3.2.2 Infrared spectrophotometer. A sample of the solvent extract shall be analyzed against a reference standard of the base solvent with a known hydrocarbon level of 2.5 mg per 100 mL. A response in fractional range displaying a greater contamination of hydrocarbons in the solvent extract than found in the reference standard of 2.5 mg per 100 mL shall constitute failure of this test. All traces of solvent shall be removed from the cylinder upon completion of this test.

4.3.2.3 In case of dispute. In case of dispute, final determination shall be made by the evaporation method.

4.3.3 Charpy impact test. The samples selected in accordance with 4.2.2.1 shall be tested in accordance with ASTM E23. Impact energy values shall be great enough to produce cleavage of the test samples. Cleavage shall result in not less than 50 percent fibrous fracture with a transitional temperature not higher than -58 °F (-50 °C). A lateral expansion of 0.015 inch (0.381mm) measured in accordance with ASTM A370 will be an acceptable criterion instead of a 50 percent fibrous fracture evaluation. Aluminum cylinders shall be exempt from impact testing, as the ductility of aluminum metal is nearly constant above its transitional temperature, which is far below the range of practical use for alloys allowed in DOT approved permits or in proposed DOT specifications.

4.3.4 Gunfire test. If the steel utilized is other than 4130X steel manufactured to DOT specification 3AA, two cylinders shall be charged to the rated pressure  $\pm$  5 percent using a non-liquefied gas. Each cylinder shall be placed behind a suitable steel barricade. The cylinder shall be in such a position that a bullet passing through a hole in the barricade strikes the cylinder at right angles to the longitudinal centerline within 1 inch of the longitudinal centerline and near to the vertical center of the cylinder. The cylinder temperature at the time of the test shall be between 50 °F (10 °C) and 100 °F (37.8 °C). An armor-piercing projectile 0.50 caliber in size shall be fired at the cylinder. The 0.50 caliber projectile shall strike the cylinders at a velocity of 2800  $\pm$  100 feet per second. The projectile shall strike the cylinders straight on (not tumbled). A cylinder shall be considered as having failed this test if the cylinder breaks into more than two pieces, however, pieces smaller than 2 inches in diameter coming from the areas (centering on the perforation and 4 inches in diameter) on the cylinder adjacent to the point of entry and exit of the projectile will not be counted. Cylinder designs, representative samples of which have passed this test, shall be permanently marked to indicate this fact. The term "NONSHAT" shall be permanently marked on the shoulder of the cylinder.

## RR-C-901E

4.4 Inspection of preparation for delivery. An inspection shall be made to determine compliance with the requirements of section 5. A sample unit shall be one shipping container fully prepared for delivery.

4.5 Manufacturer's and inspector's reports and records. The contractor or the cylinder manufacturer shall offer and make available the manufacturer's and inspector's reports and records confirming that the fabrication of the purchased cylinders was performed by a DOT registered manufacturer and that all requirements of 49 CFR 178 and this specification have been met.

## 5. PACKAGING

5.1 Packing, packaging, and marking. Packing, packaging, and marking shall be as specified in the contract or acquisition order (see 6.2).

## 6. NOTES

INFORMATION FOR GUIDANCE ONLY. (This section contains information of a general or explanatory nature that is helpful, but is not mandatory.)

6.1 Intended use. Cylinders covered by this specification are intended for storage and transportation of high-pressure gases. Cylinders are prepared for specific gas use or are to be delivered plugged and finished in prime paint for future assigned applications.

6.2 Acquisition requirements. Acquisition documents should specify the following:

- a. Title, number, revision, and date of this specification.
- b. Type, intended gas service, size, and valve designation (see 1.2).
- c. Impact resistance, if required (see 3.2.3).
- d. Internal cylinder preparation, if required (see 3.3.4).
- e. Internal cylinder preservation, if required (see 3.3.5).
- f. Special markings, if required (see 3.6.3).
- g. Treatment and painting (finish) for aluminum cylinders, when required (see 3.7).
- h. Inlet thread size, if other than specified (see 3.10.4).
- i. Responsibility for inspection, if other than the contractor (see 4.1).
- j. Inspection facility, if other than the contractor's chosen facility (see 4.1).
- k. Oil content testing requirement (see 4.2.2.2).
- l. Packing, packaging, and marking requirements (see 5.1).


6.3 Serial numbers. Cylinder serial numbers shall be prefixed by a two- or three-letter symbol designating the procuring agency and shall have a two-letter suffix furnished by the contracting officer designating the contractor. The serial numbers shall be assigned by the contractor. These numbers may be consecutive with the contractor's regular production numbers or of a series established specifically for customer cylinders. However, all cylinders on a given contract will be numbered consecutively and controls will be exercised to preclude duplication on future deliveries to the government.

## RR-C-901E

**6.4 Nonshatterability.** Historically, government agencies have gunfire tested high-pressure cylinders to evaluate their nonshatterability and fragmentation properties. In applications where military personnel are in confined quarters, it is of prime interest to limit fragmentation and control release of the gas in a cylinder when it is pierced or burst. For ground cylinders over 4 inches in diameter, fragmentation in gunfire test should not exceed two pieces. Extensive testing has verified that cylinders over 4 inches in diameter made of 4130X steel to the limits of the DOT 3AA specification meet this requirement and have been marked "NONSHAT" by the fabricator. For cylinders in aircraft service, where the controlled release of the contained gas is more critical, tearing about the projectile apertures is limited to 3 inches from hole center. Government and industry have verified that this quality of nonshatterability is most directly related to the average wall stress in cylinder design. The DOT 3AA specification allows an average wall stress of 70,000 psig maximum. Independent investigators have arrived at wall stress limits from 50,000 to 60,000 psig as valid maximums for satisfactory nonshatterability characteristics. For procurement in accordance with this specification, cylinders under 4 inches in diameter that are fabricated in accordance with the DOT 3AA specification and have a 60,000 psig maximum wall stress will be accepted and permanently marked "NONSHAT". Cylinders under 4 inches in diameter with maximum wall stress greater than 60,000 psig will pass actual gunfire tests before being qualified as nonshatterable and permanently marked "NONSHAT".

**6.5 Recycled material.** The use of recycled material is encouraged when practical, as long as it meets the requirements of the specification (see 3.1).

**6.6 Part or identification number.** The following PIN procedure is for government purposes and does not constitute a requirement for the contractor.

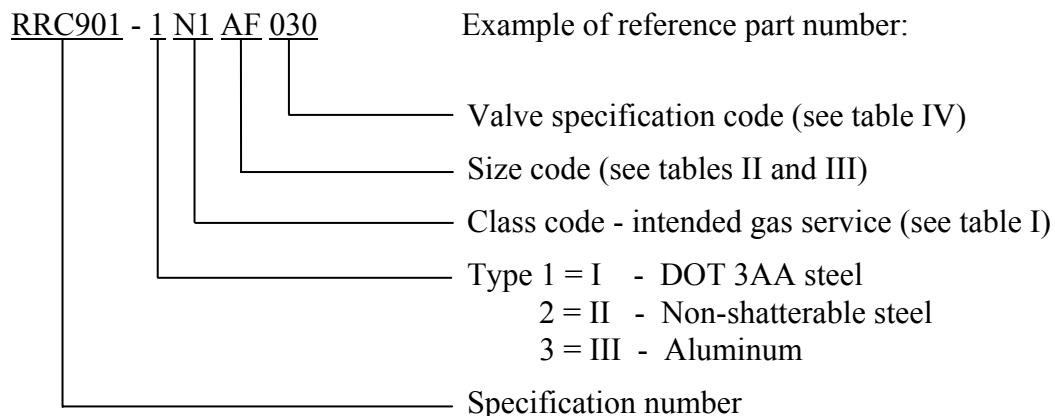

**6.7 Subject term (key word) listing.**

|           |                  |           |                    |
|-----------|------------------|-----------|--------------------|
| ABO       | carbon dioxide   | hydrogen  | nitrogen           |
| acetylene | ethane           | isobutane | nitrous oxide      |
| argon     | ethylene         | medical   | nonshatterable     |
| boron     | helium           | methane   | oxygen             |
| butane    | hexaflouroethane | neon      | sufur hexaflouride |

## RR-C-901E

6.8 International standardization agreements. Certain provisions of this specification (see 3.6.1, 3.6.2, and 3.6.3) are the subject of international standardization agreements STANAG 2121, "Cross-Servicing of Medical Gas Cylinders", and STANAG 7146, "Assignment of NATO Code Numbers to Gases Used in Aircraft Cross-Servicing". When amendment, revision, or cancellation of this specification is proposed that will modify the international agreement concerned, the preparing activity will take appropriate action through international standardization channels, including departmental standardization offices, to change the agreement or make other appropriate accommodations.

6.9 Changes from previous issue. Asterisks are not used in this revision to identify changes with respect to the previous issue due to the extensive changes.

## RR-C-901E

TABLE I. Intended gas service.

| Class code | Item name code <sup>1</sup> | Gas product                             |
|------------|-----------------------------|---|
| A1         | 49516                       | Air, breathing                          |
| B1         | 49517                       | Air, technical                          |
| C1         | 49448                       | Argon-carbon dioxide                    |
| D1         | 49449                       | Argon-carbon dioxide-oxygen             |
| E1         | 49451                       | Argon-methane                           |
| F1         | 49453                       | Argon, technical                        |
| G1         | 49452                       | Argon-oxygen                            |
| H1         | 49454                       | Boron trifluoride, technical            |
| J1         | 49458                       | Calibrating gas mixture                 |
| K1         | 49459                       | Carbon dioxide-helium-oxygen-nitrogen   |
| L1         | 49460                       | Carbon dioxide-nitrogen-oxygen          |
| M1         | 49461                       | Carbon dioxide-oxygen                   |
| N1         | 49462                       | Carbon dioxide, technical               |
| P1         | 49463                       | Carbon dioxide, USP <sup>2</sup>        |
| R1         | 49464                       | Carbon monoxide, technical              |
| S1         | 49471                       | Ethane, technical                       |
| T1         | 49473                       | Ethylene oxide-carbon dioxide           |
| U1         | 49475                       | Ethylene, technical                     |
| V1         | 49478                       | Helium-argon                            |
| W1         | 49479                       | Helium-butane                           |
| X1         | 49480                       | Helium-isobutane                        |
| Y1         | 49481                       | Helium-methane                          |
| Z1         | 49482                       | Helium-nitrogen                         |
| A2         | 49483                       | Helium-oxygen                           |
| B2         | 49484                       | Helium, technical                       |
| C2         | 49485                       | Helium, USP                             |
| D2         | 49486                       | Hexafluoroethane, technical             |
| E2         | 49487                       | Hydrogen-argon                          |
| F2         | 49488                       | Hydrogen chloride, anhydrous, technical |
| G2         | 49490                       | Hydrogen, technical                     |
| H2         | 49492                       | Methane, technical                      |
| I2         | 49477                       | Natural, dry                            |
| J2         | 49495                       | Neon, technical                         |
| K2         | 49496                       | Nitrogen-carbon dioxide                 |
| L2         | 49497                       | Nitrogen-hydrogen                       |
| M2         | 49498                       | Nitrogen, technical                     |
| N2         | 49499                       | Nitrogen, USP                           |
| O2         | 49500                       | Nitrous oxide, technical                |
| P2         | 49501                       | Nitrous oxide, USP                      |
| Q2         | 49502                       | Oxygen, aviator's breathing             |
| R2         | 49504                       | Oxygen-nitrogen                         |
| S2         | 49505                       | Oxygen, technical                       |
| T2         | 49506                       | Oxygen, USP                             |
| U2         | 49509                       | Sulfur hexafluoride, technical          |

<sup>1</sup> The item name codes are found in the Federal Item Identification Guide T162.<sup>2</sup> United States Pharmacopoeia (USP).

## RR-C-901E

TABLE II. Cylinder sizes: high pressure industrial and medical gases, steel (DOT specification 3AA).

| Size code                  | Diameter <sup>1</sup><br>(inches) | Height <sup>2</sup><br>(inches) | Maximum tare weight<br>(lbs.) | Water capacity <sup>3</sup><br>(lbs.) | Volume<br>(cubic inches) |
|----------------------------|-----------------------------------|---------------------------------|-------------------------------|---------------------------------------|--------------------------|
| 1800 psig carbon dioxide   |                                   |                                 |                               |                                       |                          |
| AA                         | 3.6                               | 14.6                            | 5.25                          | 3.9                                   | 110                      |
| AB                         | 5.5                               | 14.0                            | 10.75                         | 7.9                                   | 220                      |
| AC                         | 7.0                               | 17.75                           | 23.5                          | 17.6                                  | 490                      |
| AD                         | 7.75                              | 23.3                            | 54.0                          | 29.5                                  | 820                      |
| AE                         | 8.75                              | 45.5                            | 109.0                         | 110.2                                 | 3058                     |
| AF                         | 9.0                               | 56.0                            | 142.0                         | 110.2                                 | 3058                     |
| 2015 psig carbon dioxide   |                                   |                                 |                               |                                       |                          |
| AG                         | 8.5                               | 51.0                            | 101.0                         | 83.6                                  | 2320                     |
| AH                         | 9.0                               | 45.0                            | 104.0                         | 81.8                                  | 2270                     |
| 2300 psig carbon dioxide   |                                   |                                 |                               |                                       |                          |
| AI                         | 9.25                              | 56.0                            | 138.0                         | 110.3                                 | 3060                     |
| AJ                         | 10.625                            | 58.0                            | 190.0                         | 147.0                                 | 4080                     |
| 2015 psig medical gases    |                                   |                                 |                               |                                       |                          |
| AK                         | 3.3                               | 13.25                           | 5.25                          | 3.0                                   | 84                       |
| AL                         | 4.2                               | 16.75                           | 7.9                           | 6.3                                   | 175                      |
| AM                         | 4.2                               | 25.25                           | 11.25                         | 10.3                                  | 285                      |
| AN                         | 7.0                               | 43.0                            | 58.0                          | 47.6                                  | 1320                     |
| AO                         | 9.0                               | 51.0                            | 113.0                         | 95.1                                  | 2640                     |
| 2015 psig industrial gases |                                   |                                 |                               |                                       |                          |
| AP                         | 5.25                              | 14.0                            | 11.0                          | 7.9                                   | 220                      |
| AQ                         | 7.0                               | 18.0                            | 25.0                          | 17.6                                  | 490                      |
| AR                         | 7.0                               | 23.0                            | 31.0                          | 23.7                                  | 660                      |
| AS                         | 7.0                               | 32.0                            | 46.5                          | 47.5                                  | 1320                     |
| AT                         | 7.25                              | 46.0                            | 70.0                          | 58.7                                  | 1630                     |
| AU                         | 9.0                               | 51.0                            | 116.0                         | 95.1                                  | 2640                     |
| 2265 psig industrial gases |                                   |                                 |                               |                                       |                          |
| AV                         | 7.0                               | 43.0                            | 62                            | 47.5                                  | 1320                     |
| AW                         | 9.0                               | 51.0                            | 117                           | 95.1                                  | 2640                     |
| 2400 psig industrial gases |                                   |                                 |                               |                                       |                          |
| AX                         | 9.25                              | 55.0                            | 140.0                         | 107.4                                 | 2980                     |
| AY                         | 10.5                              | 56.0                            | 191.0                         | 133.0                                 | 3690                     |
| 3500 psig industrial gases |                                   |                                 |                               |                                       |                          |
| AZ                         | 9.25                              | 51.0                            | 188.0                         | 95.1                                  | 2640                     |
| 3600 psig industrial gases |                                   |                                 |                               |                                       |                          |
| BA                         | 9.25                              | 51.0                            | 188.0                         | 95.1                                  | 2640                     |
| 6000 psig industrial gases |                                   |                                 |                               |                                       |                          |
| BB                         | 9.25                              | 51.0                            | 267.0                         | 82.3                                  | 2285                     |

<sup>1</sup> Diameter represents the outside diameter of the cylinder body.<sup>2</sup> Height represents the measured distance from the bottom of the cylinder to the base of the valve.<sup>3</sup> The product capacity shall be determined by the cylinder application.<sup>4</sup> Unless otherwise specified, the cylinder inlet threads shall be 3/4-14 National Gas Taper (NGT).

## RR-C-901E

TABLE III. Cylinder sizes: high pressure industrial and medical gases, aluminum (DOT specification 3AL).

| Size code                | Diameter (inches) | Height (inches) | Maximum tare weight (lbs.) | Water capacity (lbs.) | Volume (cubic inches) | Cylinder inlet thread size              |
|--------------------------|-------------------|-----------------|----------------------------|-----------------------|-----------------------|---|
| 1800 psig carbon dioxide |                   |                 |                            |                       |                       |   |
| BC                       | 3.2               | 9.5             | 1.6                        | 1.8                   | 51                    | 0.750-16 UNF <sup>1</sup>               |
| BD                       | 3.2               | 11.5            | 1.8                        | 2.3                   | 63                    | 0.750-16 UNF                            |
| BE                       | 4.4               | 9.0             | 3.0                        | 3.0                   | 82                    | 0.875-14 UNF                            |
| BF                       | 4.4               | 10.4            | 3.4                        | 3.6                   | 102                   | 0.750-16 UNF                            |
| BG                       | 5.3               | 14.2            | 6.3                        | 7.4                   | 205                   | 1.125-12 UNF                            |
| BH                       | 6.9               | 16.6            | 12.9                       | 14.7                  | 408                   | 1.125-12 UNF                            |
| BI                       | 6.9               | 23.2            | 17.0                       | 22.1                  | 612                   | 1.125-12 UNF                            |
| BJ                       | 8.0               | 23.3            | 23.0                       | 29.4                  | 816                   | 1.125-12 UNF                            |
| BK                       | 8.0               | 36.0            | 34.7                       | 51.5                  | 1429                  | 1.125-12 UNF                            |
| BL                       | 8.6               | 46.3            | 48.5                       | 73.6                  | 2040                  | 1.125-12 UNF                            |
| 2015 psig medical        |                   |                 |                            |                       |                       |   |
| BM                       | 4.4               | 7.894           | 3.1                        | 2.6                   | 71                    | 0.750-16 UNF                            |
| BN "B"                   | 4.4               | 9.18            | 3.4                        | 3.1                   | 87                    | 0.750-16 UNF                            |
| BO                       | 4.4               | 10.87           | 3.8                        | 3.7                   | 103                   | 0.750-16 UNF                            |
| BP "D"                   | 4.4               | 16.5            | 5.4                        | 6.2                   | 172                   | 0.750-16 UNF                            |
| BQ "E"                   | 4.4               | 25.63           | 8.1                        | 10.2                  | 283                   | 0.750-16 UNF                            |
| 2216 psig medical        |                   |                 |                            |                       |                       |   |
| BR                       | 3.2               | 9.0             | 1.9                        | 1.6                   | 43                    | 0.750-16 UNF                            |
| BS                       | 3.2               | 11.77           | 2.3                        | 2.3                   | 62                    | 0.750-16 UNF                            |
| BT                       | 5.3               | 14.00           | 7.7                        | 7.0                   | 193                   | 0.750-16 UNF                            |
| BU                       | 5.3               | 17.06           | 8.9                        | 8.8                   | 244                   | 0.750-16 UNF                            |
| BV                       | 7.3               | 23.5            | 22.3                       | 23.4                  | 650                   | 0.750-16 UNF                            |
| BW                       | 8.0               | 36.3            | 39.7                       | 46.9                  | 1302                  | 1.125-12 UNF                            |
| BX                       | 9.8               | 51.93           | 87.4                       | 102.0                 | 2831                  | 1.125-12 UNF                            |
| 1800 psig industrial     |                   |                 |                            |                       |                       |   |
| BY                       | 8.6               | 46.1            | 49.5                       | 73.6                  | 2040                  | 3/4-14 NGT or 1.125-12 UNF as requested |
| 2015 psig industrial     |                   |                 |                            |                       |                       |   |
| BZ                       | 4.4               | 9.2             | 3.0                        | 3.1                   | 87                    | 1.125-12 UNF                            |
| CA                       | 4.4               | 10.5            | 3.5                        | 3.7                   | 103                   | 1.125-12 UNF                            |
| CB                       | 8.0               | 47.8            | 47.5                       | 65.0                  | 1800                  | 3/4-14 NGT or 1.125-12 UNF as requested |
| 2216 psig industrial     |                   |                 |                            |                       |                       |   |
| CC                       | 3.2               | 9.0             | 1.9                        | 1.5                   | 43                    | 1.125-12 UNF                            |
| CD                       | 3.2               | 11.7            | 2.3                        | 2.2                   | 62                    | 1.125-12 UNF                            |
| CE                       | 5.3               | 17.1            | 8.7                        | 8.8                   | 244                   | 1.125-12 UNF                            |
| CF                       | 5.9               | 15.6            | 15.2                       | 13.0                  | 130                   | 3/4-14 NGT or 1.125-12 UNF as requested |
| CG                       | 7.3               | 23.5            | 22.5                       | 23.4                  | 650                   | 3/4-14 NGT or 1.125-12 UNF as requested |
| CH                       | 7.3               | 32.9            | 30.0                       | 34.6                  | 960                   | 3/4-14 NGT or 1.125-12 UNF as requested |
| CI                       | 8.0               | 36.3            | 40.1                       | 47.0                  | 1302                  | 3/4-14 NGT or 1.125-12 UNF as requested |
| CJ                       | 9.8               | 51.9            | 89.6                       | 102.1                 | 2831                  | 3/4-14 NGT or 1.125-12 UNF as requested |

<sup>1</sup> Unified inch screw thread, fine-thread series.

## RR-C-901E

TABLE IV. Valve identification designation.

| Valve identification | Former detail specification number <sup>1</sup> | A-A-59860 PIN | Service pressure (psig) | Gas service   |
|----------------------|---|---------------|-------------------------|---|
| 001                  | MIL-DTL-2/1                                     | AA59860-001   | 0 - 500                 | Acetylene   |
| 002                  |   | AA59860-002   |                         |   |
| 003                  | MIL-DTL-2/2                                     | AA59860-003   | 0 - 500                 | Acetylene   |
| 004                  |   | AA59860-004   |                         |   |
| 005                  | MIL-DTL-2/3                                     | AA59860-005   | 0 - 500                 | Acetylene (10-ft <sup>3</sup> cylinders)  |
| 006                  |   | AA59860-006   |                         | Acetylene (40-ft <sup>3</sup> cylinders)  |
| 007                  | MIL-DTL-2/5                                     | AA59860-007   | 1800 - 2400             | Air for human respiration (non-medical)   |
| 008                  |   | AA59860-008   | 1800                    |   |
| 009                  |   | AA59860-009   | 2015                    |   |
| 010                  |   | AA59860-010   | 2265                    |   |
| 011                  |   | AA59860-011   | 2400                    |   |
| 012                  | MIL-DTL-2/6                                     | AA59860-012   | 1800 - 2400             | Air, industrial (oil tolerant)  |
| 013                  |   | AA59860-013   | 1800                    |   |
| 014                  |   | AA59860-014   | 2015                    |   |
| 015                  |   | AA59860-015   | 2265                    |   |
| 016                  |   | AA59860-016   | 2400                    |   |
| 017                  | MIL-DTL-2/7                                     | AA59860-017   | 0 - 500                 | Anhydrous ammonia   |
| 018                  | MIL-DTL-2/8                                     | AA59860-018   | 0 - 500                 | Anhydrous ammonia   |
| 019                  | MIL-DTL-2/9                                     | AA59860-019   | 0 - 500                 | Anhydrous ammonia   |
| 020                  | MIL-DTL-2/10                                    | AA59860-020   | 0 - 500                 | Anhydrous ammonia   |
| 021                  | MIL-DTL-2/11                                    | AA59860-021   | 1800 - 2400             | Argon, helium, nitrogen, neon, or xenon (Inert - oil free)                                |
| 022                  |   | AA59860-022   | 1800                    |   |
| 023                  |   | AA59860-023   | 2015                    |   |
| 024                  |   | AA59860-024   | 2265                    |   |
| 025                  |   | AA59860-025   | 2400                    |   |
| 026                  | MIL-DTL-2/14                                    | AA59860-026   | 240                     | Butane, propane, butane/propane mixture, MAPP gas, or propylene                           |
| 027                  |   | AA59860-027   | 260                     |   |
| 028                  |   | AA59860-028   | 240                     |   |
| 029                  |   | AA59860-029   | 260                     |   |
| 030                  | MIL-DTL-2/15                                    | AA59860-030   | 1800                    | Carbon dioxide (Industrial; non-medical)  |
| 031                  |   | AA59860-031   | 2015                    |   |
| 032                  | MIL-DTL-2/16                                    | AA59860-032   | 0 - 3000                | Carbon dioxide (medical)  |
| 033                  |   | AA59860-033   |                         |   |
| 034                  | MIL-DTL-2/17                                    | AA59860-034   | 0 - 3000                | Carbon dioxide (medical)  |
| 035                  | MIL-DTL-2/18                                    | AA59860-035   | 0 - 3000                | Carbon monoxide   |
| 036                  | MIL-DTL-2/19                                    | AA59860-036   | 1800                    | Ethylene oxide/carbon dioxide mixture (Carboxide: 10% ethylene oxide, 90% carbon dioxide) |
| 037                  |   | AA59860-037   | 2015                    |   |
| 038                  |   | AA59860-038   | 2265                    |   |
| 039                  | MIL-DTL-2/20                                    | AA59860-039   | 0 - 500                 | Chlorine  |
| 040                  | MIL-DTL-2/21                                    | AA59860-040   | 0 - 500                 | Chlorine (1-ton container)  |

## RR-C-901E

TABLE IV. Valve identification designation - Continued.

| Valve identification | Former detail specification number <sup>1</sup> | A-A-59860 PIN | Service pressure (psig) | Gas service   |
|----------------------|---|---------------|-------------------------|---|
| 041                  | MIL-DTL-2/22                                    | AA59860-041   | 225                     | R-11 trichlorofluoromethane                           |
| 042                  |   | AA59860-042   | 240                     | R-12 dichlorodifluoromethane                          |
| 043                  |   | AA59860-043   | 260                     | R-13 chlorotrifluoromethane                           |
| 044                  |   | AA59860-044   | 300                     | R-22 chlorodifluoromethane                            |
| 045                  |   | AA59860-045   | 400                     | R-23 trifluoromethane                                 |
| 046                  |   | AA59860-046   | 300                     | R-31 chlorofluoromethane                              |
| 047                  |   | AA59860-047   | 400                     | R-32 difluoromethane                                  |
| 048                  |   | AA59860-048   | 240                     | R-113 trichlorotrifluoroethane                        |
| 049                  |   | AA59860-049   | 300                     | R-114 dichlorotetrafluoroethane                       |
| 050                  |   | AA59860-050   | 400                     | R-115 chloropentafluoroethane                         |
| 051                  |   | AA59860-051   | 225                     | R-123 dichlorotrifluoroethane                         |
| 052                  |   | AA59860-052   | 240                     | R-124 chlorotetrafluoroethane                         |
| 053                  |   | AA59860-053   | 260                     | R-125 pentafluoroethane                               |
| 054                  |   | AA59860-054   | 300                     | R-134a tetrafluoroethane                              |
| 055                  |   | AA59860-055   | 400                     | R-143a trifluoroethane                                |
| 056                  |   | AA59860-056   | 300                     | R-152a difluoroethane                                 |
| 057                  |   | AA59860-057   | 400                     | R-227 Heptafluoropropane                              |
| 058                  |   | AA59860-058   | 240                     | R-290 propane   |
| 059                  |   | AA59860-059   | 300                     | R-401A (R-22/R-125/R-124)(53/13/34)                   |
| 060                  |   | AA59860-060   | 400                     | R-401B (R-22/R-152a/R-124)(61/28/11)                  |
| 061                  | MIL-DTL-2/23                                    | AA59860-061   | 0 - 500                 | R-402A (R-22/R-125/R-290)(38/60/2)                    |
| 062                  | MIL-DTL-2/24                                    | AA59860-062   | 0 - 500                 | R-402B (R-22/R-125/R-290)(60/38/2)                    |
| 063                  | MIL-DTL-2/26                                    | AA59860-063   | 1800 - 2400             | R-404A (R-125/R-143a/R-134a)(44/52/4)                 |
| 064                  |   | AA59860-064   | 1800                    | R-500 (R-12/R-152a) (73.8/26.2)                       |
| 065                  |   | AA59860-065   | 2015                    | R-501 (R-22/R-12) (75.0/25.0)                         |
| 066                  |   | AA59860-066   | 2265                    | R-502 (R-22/R-115) (48.8/51.2)                        |
| 067                  |   | AA59860-067   | 2400                    | R-503 (R-23/R-13) (40.1/59.9)                         |
| 068                  | MIL-DTL-2/27                                    | AA59860-068   | 0 - 3000                | R-504 (R-32/R-115) (48.2/51.8)                        |
| 069                  |   | AA59860-069   |                         | R-505 (R-12/R-31) (78.0/22.0)                         |
| 070                  | MIL-DTL-2/28                                    | AA59860-070   | 0 - 3000                | R-506 (R-31/R-114) (55.1/44.9)                        |
| 071                  | MIL-DTL-2/29                                    | AA59860-071   | 0 - 3000                | Ethyl chloride (R-160)                                |
| 072                  |   | AA59860-072   |                         | Ethylene oxide  |
| 073                  | MIL-DTL-2/37                                    | AA59860-073   | 0 - 3000                | Helium or nitrogen (Inert - oil tolerant)             |
| 074                  |   | AA59860-074   |                         |   |
| 075                  | MIL-DTL-2/38                                    | AA59860-075   | 0 - 3000                |   |
| 076                  | MIL-DTL-2/39                                    | AA59860-076   | 1800 - 2400             |   |
| 077                  |   | AA59860-077   | 1800                    |   |
| 078                  |   | AA59860-078   | 2015                    |   |
|                      |   |               |                         | Oxygen/helium mixture (Medical) (Helium not over 80%) |
|                      |   |               |                         | Oxygen/helium mixture (Medical) (Helium not over 80%) |
|                      |   |               |                         | Hydrogen  |
|                      |   |               |                         | Nitrous oxide (Medical)                               |
|                      |   |               |                         | Nitrous oxide (Medical)                               |
|                      |   |               |                         | Oxygen (non-medical)                                  |

## RR-C-901E

TABLE IV. Valve identification designation - Continued.

| Valve identification | Former detail specification number1 | A-A-59860 PIN | Service pressure (psig) | Gas service  |
|----------------------|-------------------------------------|---------------|-------------------------|--|
| 079                  | MIL-DTL-2/39                        | AA59860-079   | 2265                    | Oxygen (non-medical)   |
| 080                  |                                     | AA59860-080   | 2400                    |  |
| 081                  | MIL-DTL-2/41                        | AA59860-081   | 0 - 3000                | Oxygen (Medical)   |
| 082                  |                                     | AA59860-082   |                         |  |
| 083                  | MIL-DTL-2/42                        | AA59860-083   | 0 - 3000                | Oxygen (Medical)   |
| 084                  | MIL-DTL-2/43                        | AA59860-084   | 0 - 3000                | Phosgene (1-ton container)   |
| 085                  | MIL-DTL-2/44                        | AA59860-085   | 240                     | Butane, propane, butane/propane mixture, MAPP gas, or propylene  |
| 086                  |                                     | AA59860-086   | 260                     |  |
| 087                  |                                     | AA59860-087   | 240                     |  |
| 088                  |                                     | AA59860-088   | 260                     |  |
| 089                  | MIL-DTL-2/46                        | AA59860-089   | 1800 - 2400             | Sulfur hexafluoride  |
| 090                  |                                     | AA59860-090   | 1800                    |  |
| 091                  |                                     | AA59860-091   | 2015                    |  |
| 092                  |                                     | AA59860-092   | 2265                    |  |
| 093                  |                                     | AA59860-093   | 2400                    |  |
| 094                  | MIL-DTL-2/47                        | AA59860-094   | 0 - 3000                | Air for human respiration (Medical)  |
| 095                  | MIL-DTL-2/48                        | AA59860-095   | 0 - 3000                | Air for human respiration (Medical)  |
| 096                  |                                     | AA59860-096   |                         |  |
| 097                  | MIL-DTL-2/50                        | AA59860-097   | 0 - 3000                | Methyl bromide   |
| 098                  | MIL-DTL-2/51                        | AA59860-098   | 5501 - 7500             | Argon, helium, nitrogen, neon, xenon or krypton (Inert - oil tolerant)   |
| 099                  | MIL-DTL-2/52                        | AA59860-099   | 240                     | Halon<br>Halon-1202 (dibromodifluoromethane)<br>Halon-1211 (bromochlorodifluoromethane)<br>Halon-1301 (bromotrifluoromethane)<br>Halon-2402 (dibromotetrafluoroethane) |
| 100                  |                                     | AA59860-100   | 300                     |  |
| 101                  |                                     | AA59860-101   | 400                     |  |
| 102                  |                                     | AA59860-102   | 300                     |  |
| 103                  |                                     | AA59860-103   | 400                     |  |
| 104                  |                                     | AA59860-104   | 240                     |  |
| 105                  |                                     | AA59860-105   | 300                     |  |
| 106                  |                                     | AA59860-106   | 400                     |  |
| 107                  |                                     | AA59860-107   | 300                     |  |
| 108                  |                                     | AA59860-108   | 400                     |  |
| 109                  | MIL-DTL-2/53                        | AA59860-109   | 1800 - 2400             | Hexafluoroethane   |
| 110                  |                                     | AA59860-110   | 1800                    |  |
| 111                  |                                     | AA59860-111   | 2015                    |  |
| 112                  |                                     | AA59860-112   | 2265                    |  |
| 113                  | MIL-DTL-2/54                        | AA59860-113   | 0 - 500                 | Sulfur dioxide   |
| 114                  |                                     | AA59860-114   |                         |  |
| 115                  | MIL-DTL-2/55                        | AA59860-115   | 1800 - 2400             | Oxygen (non-medical)   |
| 116                  |                                     | AA59860-116   | 1800                    |  |
| 117                  |                                     | AA59860-117   | 2015                    |  |
| 118                  |                                     | AA59860-118   | 2265                    |  |
| 119                  |                                     | AA59860-119   | 2400                    |  |

## RR-C-901E

TABLE IV. Valve identification designation - Continued.

| Valve identification | Former detail specification number <sup>1</sup> | A-A-59860 PIN | Service pressure (psig) | Gas service   |
|----------------------|---|---------------|-------------------------|---|
| 120                  | MIL-DTL-2/56                                    | AA59860-120   | 3500 - 3600             | Argon, helium, neon, nitrogen, xenon, or krypton (Inert - oil tolerant) |
| 121                  |   | AA59860-121   | 4000                    |   |
| 122                  |   | AA59860-122   | 4500                    |   |
| 123                  | MIL-DTL-2/57                                    | AA59860-123   | 3500 - 3600             | Helium and nitrogen (Inert - oil tolerant)                              |
| 124                  |   | AA59860-124   | 4000                    |   |
| 125                  |   | AA59860-125   | 4500                    |   |
| 126                  | MIL-DTL-2/58                                    | AA59860-126   | 5501 - 7500             | Argon, helium, neon, nitrogen, xenon, or krypton (Inert - oil tolerant) |
| 127                  | MIL-DTL-2/59                                    | AA59860-127   | 3500 - 3600             | Air   |
| 128                  |   | AA59860-128   | 4000                    |   |
| 129                  |   | AA59860-129   | 4500                    |   |
| 130                  | MIL-DTL-2/60                                    | AA59860-130   | 0 - 3000                | Oxygen/helium mixture (Medical) (Helium over 80%)                       |
| 131                  |   | AA59860-131   |                         |   |
| 132                  | MIL-DTL-2/61                                    | AA59860-132   | 0 - 3000                | Oxygen/helium mixture (Medical) (Helium over 80%)                       |
| 133                  | MIL-DTL-2/62                                    | AA59860-133   | 0 - 3000                | Methane   |
| 134                  | MIL-DTL-2/63                                    | AA59860-134   | 0 - 3000                | Natural gas   |
| 135                  | MIL-DTL-2/64                                    | AA59860-135   | 0 - 3000                | Hydrogen chloride   |
| 136                  |   | AA59860-136   |                         |   |
| 137                  | MIL-DTL-2/65                                    | AA59860-137   | 0 - 3000                | Hydrogen sulfide  |
| 138                  |   | AA59860-138   |                         |   |
| 139                  | MIL-DTL-2/66                                    | AA59860-139   | 1800 - 2400             | Mildly oxidizing mixtures (5% to 23% Oxygen)                            |
| 140                  |   | AA59860-140   | 1800                    |   |
| 141                  |   | AA59860-141   | 2015                    |   |
| 142                  |   | AA59860-142   | 2265                    |   |
| 143                  |   | AA59860-143   | 2400                    |   |
| 144                  | MIL-DTL-2/67                                    | AA59860-144   | 0 - 500                 | Low pressure flammable  |
| 145                  |   | AA59860-145   |                         |   |
| 146                  | MIL-DTL-2/68                                    | AA59860-146   | 1800 - 2400             | Inert-oil free mixtures (With less than 5% Oxygen)                      |
| 147                  |   | AA59860-147   | 1800                    |   |
| 148                  |   | AA59860-148   | 2015                    |   |
| 149                  |   | AA59860-149   | 2265                    |   |
| 150                  |   | AA59860-150   | 2400                    |   |
| 151                  | MIL-DTL-2/69                                    | AA59860-151   | 0 - 3000                | Corrosive (acidic) mixtures   |
| 152                  | MIL-DTL-2/70                                    | AA59860-152   | 0 - 3000                | High pressure, flammable or toxic mixtures                              |
| 153                  |   | AA59860-153   |                         |   |
| 154                  | MIL-DTL-2/71                                    | AA59860-154   | 1800 - 2400             | High pressure, toxic and oxidizing mixtures                             |
| 155                  |   | AA59860-155   | 1800                    |   |
| 156                  |   | AA59860-156   | 2015                    |   |
| 157                  |   | AA59860-157   | 2265                    |   |
| 158                  |   | AA59860-158   | 2400                    |   |
| 159                  |   | AA59860-159   | 1800 - 2400             |   |
| 160                  |   | AA59860-160   | 1800                    |   |
| 161                  |   | AA59860-161   | 2015                    |   |

## RR-C-901E

TABLE IV. Valve identification designation - Continued.

| Valve identification | Former detail specification number <sup>1</sup> | A-A-59860 PIN | Service pressure (psig) | Gas service                                 |
|----------------------|---|---------------|-------------------------|---|
| 161                  | MIL-DTL-2/71                                    | AA59860-161   | 2015                    | High pressure, toxic and oxidizing mixtures |
| 162                  |   | AA59860-162   | 2265                    |   |
| 163                  |   | AA59860-163   | 2400                    |   |
| 164                  | MIL-DTL-2/72                                    | AA59860-164   | 0 - 3000                | Fluorinating compound mixtures              |
| 165                  |   | AA59860-165   |                         |   |
| 166                  |   | AA59860-166   |                         |   |
| 167                  | MIL-DTL-2/73                                    | AA59860-167   | 0 - 500                 | Corrosive (basic) mixtures                  |
| 168                  | MIL-DTL-2/74                                    | AA59860-168   | 0 - 500                 | Low pressure, toxic and oxidizing mixtures  |
| 169                  |   | AA59860-169   |                         |   |
| 170                  | MIL-DTL-2/75                                    | AA59860-170   | 3500 - 3600             | Oxygen (non-medical)                        |
| 171                  |   | AA59860-171   | 4000                    |   |
| 172                  | MIL-DTL-2/76                                    | AA59860-172   | 1800 - 2400             | Oxidizing mixtures                          |
| 173                  |   | AA59860-173   | 1800                    |   |
| 174                  |   | AA59860-174   | 2015                    |   |
| 175                  |   | AA59860-175   | 2265                    |   |
| 176                  |   | AA59860-176   | 2400                    |   |
| 177                  | MIL-DTL-2/77                                    | AA59860-177   | 225                     | Methyl chloride                             |
| 178                  |   | AA59860-178   | 240                     |   |
| 179                  |   | AA59860-179   | 300                     |   |
| 180                  |   | AA59860-180   | 225                     |   |
| 181                  |   | AA59860-181   | 240                     |   |
| 182                  |   | AA59860-182   | 300                     |   |
| 999                  | None  | Plug          | -                       | -   |

<sup>1</sup> The former detail specification number is given for cross-reference purposes only.

TABLE V. Cylinder defects.

| Defect   | Major | Minor |
|--|-------|-------|
| Dimensions not as specified                        | 101   | -     |
| Construction not as specified                      | 102   | -     |
| Cleaning not as specified                          | 103   | -     |
| Markings not as specified                          | -     | 201   |
| Delivery date not within one year of the test date | -     | 202   |
| Treatment and painting not as specified            | -     | 203   |
| Workmanship not as specified                       | -     | 204   |

## RR-C-901E

### MILITARY INTERESTS:

#### Custodians:

Army - EA

Navy - AS

Air Force - 68

DLA - GS

#### Review Activities:

Army - AI

Navy - MC, MS, OS

DLA - PS

#### Preparing Activity:

DLA - GS7

(Project 8120-2010-003)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST database at <https://assist.daps.dla.mil/>.