

NASA KSC Export Control Office (ECO) Export/SBU Determination Record

EDDR# 129171**DOCUMENT INFORMATION: (TITLE, NUMBER, REV, DATE)**

KSC-STD-E-0012F, December 14, 2012

Standard for Facility Grounding and Lightning Protection

Center Operations Directorate

SENSITIVE BUT UNCLASSIFIED (SBU)

INSTRUCTIONS: This item must be reviewed under the requirements for "Sensitive But Unclassified Information" as described in NPR 1600.1, Chapter 5.

<http://nodis-dms.gsfc.nasa.gov>

	Yes	No	SBU Reviewer's Signature	Date	Company / Org
Document contains SBU?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	C.P. Bennards	02/12/13	NASA/TA-B3B

EXPORT CONTROL (EC)

INSTRUCTIONS: Attach the document requiring an export determination. Contact the KSC ECO Help Desk (867-9209) for help in completing this form.

<http://exportcontrol.ksc.nasa.gov/>

Contractor EC Reviewer's Name and Organization	Contractor EC Reviewer's Signature	Date
NASA ECO Reviewer's Name and Organization	NASA ECO Reviewer's Signature	Date
	MELANIE CHAN (12/4/2012)	

	EXPORT DETERMINATION (Check one box only)	
EAR 99	<input checked="" type="checkbox"/>	The information contained in the document is technical in content, but is not technical data as defined by the ITAR or the EAR, and therefore is EAR 99 NLR (no export license required). [General Prohibition Six (Embargo) applies to all items subject to the EAR, i.e. items on the CCL and within EAR 99 NLR. You may not make an export or re-export contrary to the provisions of part 746 (Embargos and Other Special Controls) of the EAR and 22 CFR part 126.1 of the ITAR.]
	NLR	
EAR Controlled	<input type="checkbox"/>	This document is within the purview of the Export Administration Regulations (EAR), 15 CFR 730-774, and is export controlled. It may <u>not</u> be transferred to foreign nationals in the U.S. or abroad without specific approval of a knowledgeable NASA export control official, and/or unless an export license or license exception is obtained/available from the Bureau of Industry and Security, United States Department of Commerce. Violations of these regulations are punishable by fine, imprisonment, or both.
ITAR Controlled	<input type="checkbox"/>	This document contains information which falls under the purview of the U.S. Munitions List (USML), as defined in the International Traffic in Arms Regulations (ITAR), 22 CFR 120-130, and is export controlled. It shall not be transferred to foreign nationals, in the U.S. or abroad, without specific approval of a knowledgeable NASA export control official, and/or unless an export license or license exemption is obtained/available from the United States Department of State. Violations of these regulations are punishable by fine, imprisonment, or both.

KSC FORM 7-657V2 NS (REV. 09/11) PREVIOUS EDITIONS ARE OBSOLETE

METRIC/INCH-POUND

KSC-STD-E-0012F
JANUARY 10, 2013

Supersedes
KSC-STD-E-0012E
August 01, 2001

FACILITY GROUNDING AND LIGHTNING PROTECTION, STANDARD FOR

EAR 99 -- NO LICENSE REQUIRED

The information contained in the document is technical in content, but not technical data as defined by the International Traffic in Arms Regulations (ITAR) or the Export Administration Regulations (EAR), and therefore is EAR 99 NLR, no export license required. [General Prohibition Six (Embargo) applies to all items subject to the EAR, (i.e., items on the CCL and within EAR 99 NLR). You may not make an export or re-export contrary to the provisions of part 746 (Embargos and Other Special Controls) of the EAR and 22 CFR part 126.1 of the ITAR].

Reference EDDR 129171 -- NASA KSC Export Control Office -- 321-867-9209

JANUARY 10, 2013

CENTER OPERATIONS DIRECTORATE

National Aeronautics and
Space Administration

John F. Kennedy Space Center

KSC FORM 16-12 REV. 6/95) PREVIOUS EDITION ARE OBSOLETE
KDP-F-5407 BASIC

KSC-STD-E-0012F FINAL.DOC/



KSC-STD-E-0012F
JANUARY 10, 2013

Supersedes
KSC-STD-E-0012E
August 01, 2001

**FACILITY GROUNDING AND LIGHTNING
PROTECTION,
STANDARD FOR**

Approved by:


Nancy P. Bray, TA
Director, Center Operations

This Revision Supersedes All Previous Editions of This Document

JANUARY 10, 2013

JOHN F. KENNEDY SPACE CENTER, NASA

KSC-STD-E-0012F
January 10, 2013

RECORD OF REVISIONS		
REV LTR	DESCRIPTION	DATE
	Basic issue	September 29, 1969
A	General revision	March 1, 1974
B	General revision	October 16, 1991
C	General revision	June 8, 1994
D	General revision	June 7, 2000
E	General revision	August 1, 2001
F	General revision	January 10, 2013

KSC-STD-E-0012F
January 10, 2013

FOREWORD

KSC-STD-E-0012 establishes overall requirements and design best practices to be used at the John F. Kennedy Space Center (KSC) for the installation of facility grounding, bonding, shielding, and lightning protection systems. These requirements apply to projects in support of KSC facilities and systems for which NASA and its tenant contractors have sustaining engineering responsibility. These requirements also apply to projects at the KSC Visitor Complex.

The grounding and bonding of facility systems is covered only to the extent that those systems interact with the facility ground network. The grounding and bonding of facility systems to other interfaces (e.g. Ground Support Equipment, etc.) within the facility are not covered in this standard.

KSC-STD-E-0012F
January 10, 2013

CONTENTS

1.	SCOPE	1
1.1	Intended Use	1
1.2	General	1
1.3	Bonding and Grounding	1
1.3.1	Electrical/Electronic Equipment	1
1.3.2	Electrical Power Systems	2
1.3.3	Electromagnetic Compatibility Control Design	2
1.3.4	Protection Zones	2
1.4	Lightning Protection and Transient Voltage Surge Suppression (TVSS) Systems	2
2.	APPLICABLE DOCUMENTS	2
2.1	Government	3
2.1.1	Specifications	3
2.1.2	Standards	3
2.1.3	Drawings	4
2.1.4	Other Documents	4
2.2	Non-Governmental	4
3.	DEFINITIONS	6
3.1	Definitions	6
4.	GENERAL REQUIREMENTS	10
4.1	Requirements Applicable to All Zones	10
4.2	Request for Waivers	10
4.3	Materials and Galvanic Action	10
5.	DETAILED REQUIREMENTS	12
5.1	Bonding and Grounding Requirements	12
5.1.1	Facility Ground – Earth Electrode Requirements	12
5.1.2	Medium Voltage Power Transformers	12
5.1.3	Non-Service Separately Derived Transformers (Dry-Types)	13
5.1.4	Uninterruptible Power Supply (UPS) Units (Including rack mounted UPS units with AC output)	13
5.1.5	Medium Voltage Switching Stations	13
5.1.6	Utility to Utility Transfer Switches	14
5.1.7	Generators	14
5.1.7.1	Permanently Installed Generators	14
5.1.8	Wiring System Enclosures and Electrical Equipment Grounding	15
5.1.8.1	Electronic Equipment Enclosures	15
5.1.8.2	Instrumentation and Communication Terminal Distributors	15
5.1.9	Cable Trays	15
5.1.9.1	Cable Tray Sections	15

KSC-STD-E-0012F
January 10, 2013

5.1.9.2	Conduit and Raceway Systems	16
5.1.9.3	Mobile and Portable Equipment	16
5.1.10	Electrical Manholes/Vault	17
5.1.11	Exterior Structures	18
5.1.12	Metal pipe (General)	18
5.1.13	Ground Rods	18
5.1.14	Earth Grounding Counterpoise Design	18
5.1.15	Instrumentation and Electronic Equipment Grounding	19
5.1.16	Critical Instrumentation and Control Cable Overall Shields	21
5.1.17	Types of Bonds	21
5.1.17.1	Brazing	21
5.1.17.2	Welding	21
5.1.17.3	Clamping	21
5.1.18	Structural Joining Methods	22
5.1.18.1	Cleaning of Bonded Surfaces	22
5.1.18.2	Corrosion Inhibitor	22
5.1.18.3	Protection of Finished Bonds	22
5.1.18.4	Bonding Straps and Jumpers	22
5.1.19	Ground Connections (General)	23
5.1.20	Ground Plate and Ground Point Identification	23
5.1.21	Metallic Fences Used as Personnel Barriers	25
5.1.22	Metallic Fences for Electrical Substations	25
5.1.23	Additional Requirements for Zones 1 and 2	26
5.1.23.1	Zone 1	26
5.1.23.2	Zone 2	27
5.1.24	Resistance Values	28
5.1.24.1	Facility Ground Networks	28
5.1.24.2	Power Grounds	28
5.1.24.3	Wiring System Enclosures	28
5.1.24.4	Lightning Protection	29
5.1.24.5	Static Grounds	29
5.1.24.6	Ground Rods	29
5.1.24.7	Counterpoise	29
5.1.24.8	Bond Resistance	29
5.1.24.9	End-Device-to-Counterpoise Resistance	29
5.1.24.10	Raised Floor Resistance	29
5.2	Lightning Protection Requirements	30
5.2.1	General	30
5.2.2	Level of Protection	30
5.2.3	Materials	30
5.2.3.1	Overhead Ground Wire (OHGW)/Grid Wire Systems	31
5.2.4	Grounded Masts and OHGW System	31
5.2.4.1	Protected Area	31
5.2.4.2	Clearance between Conductive Mast and Protected Structure	31

KSC-STD-E-0012F
January 10, 2013

5.2.4.3	Clearance Between OHGW and Protected Structure.....	31
5.2.4.4	Rooftop Antenna Protection	31
5.2.4.5	Environmental Design Criteria for OHGW Installations.....	32
5.2.5	Faraday Cage Systems	32
5.2.6	Towers Located Near Structures.....	33
5.2.7	Material Corrosion-Resistance, Compatibility, and Suitability.....	33
5.2.8	Railroads	33
5.2.9	Pad-Mounted Transformers, Underground Cables, and Unit Substations/Switching Stations.....	35
5.2.9.1	Pad-Mounted Power Transformers	35
5.2.9.2	Underground Cables	36
5.2.9.3	Medium Voltage Switching Stations	36
5.2.10	Aboveground Cable Trays	36
5.2.11	Overhead Distribution Lines.....	38
5.2.12	Exposed Communications and Instrumentation Equipment.....	38
5.2.12.1	Exposed Equipment	38
5.2.12.2	Lightning Surge Protection.....	39
5.2.13	Underground Duct Banks	39
5.2.14	Guard Shacks	40
5.2.15	Guard Gates	41
5.2.16	Resistance Values	42
5.3	Transient Voltage Surge Suppression (TVSS)	42
5.3.1	General	42
5.3.2	Purpose.....	42
5.3.3	TVSS Protection Requirements for Main (Service Entrance) Panels.....	42
5.3.4	TVSS Protection Requirements for Distribution Subpanels.....	43
5.3.5	TVSS Protection Low-Voltage Signal Equipment	44
6.	QUALITY ASSURANCE PROVISIONS	46
6.1	New Installations and Modifications to Existing Installations	46
6.2	Existing Installations.....	46
6.3	Acceptance Tests	46
6.3.1	Ground Rod Resistance Tests	46
6.3.2	Continuity Tests	46
6.3.3	Visual and Mechanical Checks.....	46
6.3.4	Additional Tests	46
6.3.5	Testing Procedures.....	46
6.3.5.1	Ground-Rod-to-Earth Resistance.....	46
6.3.5.2	Counterpoise-to-Earth Resistance.....	47
6.3.6	Inspection Methods.....	47
APPENDIX A.	BONDING AND GROUNDING OBJECTIVES.....	48
APPENDIX B.	OVERHEAD GROUND WIRE CABLES	52

KSC-STD-E-0012F
January 10, 2013

FIGURES

Figure 1.	Installation of Cable Tray Grounds.....	16
Figure 2.	Grounded Raised Floor	20
Figure 3.	Ground Point Marking	24
Figure 4.	Ground Plate Marking.....	24
Figure 5.	Connection of Substation Fence and Structural Steel.....	25
Figure 6.	Substation Fence Detail	26
Figure 7.	Bonding and Grounding of Reinforced Concrete	28
Figure 8.	Rooftop Antenna Lightning Protection.....	32
Figure 9.	Lightning Protection Requirements for Railroad Tracks in Fuel Areas or Adjacent to Buildings	34
Figure 10.	Railroad Track Details for Lightning Protection	35
Figure 11.	Lightning Protection for Cross-Country Cable Trays (60-Hertz, 15-KV Rating).....	37
Figure 12.	Shield Wire and Lightning Arrester Typical Installation	39
Figure 13.	Lightning Protection for Underground Duct Banks.....	40

TABLES

Table 1.	Potential Tendency for Galvanic Corrosion	11
----------	---	----

KSC-STD-E-0012F
January 10, 2013

ABBREVIATIONS, ACRONYMS, AND SYMBOLS

ac	alternating current
ADP	automatic data processing
AFR	Air Force regulation
Al	Aluminum
ANSI	American National Standards Institute
ASCR	Aluminum Conductor Steel Reinforced
ASTM	American Society for Testing and Materials
AWG	American wire gage
BCDS	Broadband Communication Distribution System
BIL	basic impulse level
CCAFS	Cape Canaveral Air Force Station
CFR	Code of Federal Regulations
CIF	Central Instrumentation Facility
CRES	corrosion-resistant steel
dc	direct current
DOD	Department of Defense
EGC	Equipment Grounding Conductor
EIA	Electronics Industries Alliance
EMC	electromagnetic compatibility
EMI	Electromagnetic interference
EPACS	Enterprise Physical Access Control System
ESD	electrostatic discharge
ft	feet
GP	General Publication
GSE	ground support equipment
HDBK	handbook
Hz	hertz
IEC	International Electrotechnical Commission

KSC-STD-E-0012F
January 10, 2013

IEEE	Institute of Electrical and Electronic Engineers
in	inch
kA	kiloampere
kg	kilogram
KITS	KSC Integrated Transmission System
KSC	John F. Kennedy Space Center
kV	kilovolt
lb	pound
LC-39	Launch Complex 39
LCC	Launch Control Center
L-G	line and ground
LH ₂	liquid hydrogen
L-N	line and neutral
LO ₂	Liquid Oxygen
LOX	Liquid Oxygen
m	meter
MCC	motor control center
MCOV	maximum continuous operating voltage
MIL	military
min	minimum
MLP	Mobile Launcher Platform
mm	millimeter
MOV	metal oxide varistor
MSFC	Marshall Space Flight Center
NASA	National Aeronautics and Space Administration
NEC	National Electrical Code
NEMA	National Electrical Manufactureres Association
NFPA	National Fire Protection Association
N-G	neutral and ground
NSTS	National Space Transportation System
OHGW	overhead ground wire

KSC-STD-E-0012F

January 10, 2013

OIS	Operational Intercom System
OSHA	Occupational Safety and Health Administration
PAWS	Paging Area Warning System
PHSF	Payload Hazardous Servicing Facility
POL	petroleum, oil, and lubricants
PTCR	Pad Terminal Connection Room
PVC	Polyvinyl Chloride
RBS	rated breaking strength
RF	radio frequency
RFI	radio frequency interference
RMS	root mean square
RPSF	Rotation, Processing, and Surge Facility
S/S	stainless steel
Sec	second
SPD	Surge Protective Device
SPEC	specification
STD	standard
SVR	suppression voltage rating
TIA	Telecommunications Industry Association
TM	technical manual
TVSS	Transient Voltage Surge Suppression
UCPS	Unified Communication Power System
UHF	ultrahigh frequency
UL	Underwriters Laboratories Inc.
UPS	Uninterruptible Power Supply
V	volt
VAB	Vehicle Assembly Building
VDMS	Voice Distribution Management System
μs	microsecon

FACILITY GROUNDING AND LIGHTNING PROTECTION STANDARD FOR

1. SCOPE

This standard establishes design standards for grounding, bonding, shielding and lightning protection for all classes of systems and facilities at the John F. Kennedy Space Center (KSC). This standard shall be invoked by KSC projects in support of NASA programs, program constituent elements, or the KSC Institution. As a standard it is applicable to design activities in both development and sustainment project phases. It is not the intent of this document to require that all existing facilities at KSC be modified to meet the requirements contained herein. Existing facilities should be considered on an individual basis when major modifications are taking place.

1.1 Intended Use

This standard is intended for use by design organizations specifying bonding and grounding, lightning, and surge protection systems or devices for new installations; by operating organizations having maintenance responsibility for new and existing installations; and by installation contractors when required by the contract specifications.

Compliance with section 4.1, Requirements Applicable to All Zones, specifies requirements established under authority of federal law and minimally-feasible technical and safety requirements applicable to all systems and facilities, is mandatory for all KSC design activities.

Compliance with section 5, Detailed Requirements, in whole or in part, is at the discretion of the design activity manager, i.e. the cognizant Program Manager, or Project Manager, as specified in program, institutional, or project requirements documents, respectively.

Design activities may impose additional, stricter requirements above and beyond the content of this standard at the discretion of the activity manager.

1.2 General

This standard is broken into three separate areas of concern: (1) grounding and bonding, (2) lightning protection and (3) surge protection. Where appropriate, requirements for all have been combined.

1.3 Bonding and Grounding

There are different types of NASA facilities located on CCAFS and KSC that require varying degrees of bonding and grounding, depending on location and function. Section 5.1 establishes the minimum bonding and grounding practices required at these facilities. The basic bonding and grounding objectives are presented in appendix A. The following limitations are presented but not completely covered in this standard.

1.3.1 Electrical/Electronic Equipment

For individual units of electrical/electronic equipment, facility equipment or ground support equipment (GSE) bonding and grounding requirements are specified primarily to ensure proper

KSC-STD-E-0012F

January 10, 2013

interfacing between the unit and the facility within which it is installed. Additional grounding requirements applying specifically to GSE should refer to KSC-STD-E-0022.

1.3.2 Electrical Power Systems

Bonding and grounding practices for alternating current (ac) and direct current (dc) power systems are specified only to the extent that such practices may affect the safety of personnel or equipment. Bonding and grounding practices that may be required solely for the functional operation or economical consideration of power systems are not covered.

1.3.3 Electromagnetic Compatibility Control Design

Unit level equipment EMC design and requirements are specifically excluded from this standard. Such requirements must be identified and specified by system designers. This standard deals with EMC only insofar as bonding and grounding of facilities and bonding and grounding of equipment to facilities are concerned. Additional EMC requirements applying specifically to GSE should refer to KSC-STD-E-0022.

1.3.4 Protection Zones

For purposes of this standard, zones to facilitate identification and specification requirements classify areas having different bonding and grounding requirements. These zones (Zone 1, Zone 2, and Zone 3) are defined in section 3, Definitions.

1.4 Lightning Protection and Transient Voltage Surge Suppression (TVSS) Systems

The requirements outlined herein shall be observed when designing and constructing systems for lightning protection and for the application of TVSS systems for use at KSC and at CCAFS. An appraisal shall be given to each new facility to determine its intended use, criticality, personnel contained, etc., before designing a lightning protection or installing a TVSS system. Any facility that contains a launch-critical system that could be destroyed or damaged by lightning or voltage transients, if struck, shall be given maximum protection. Modifications to existing facilities shall not deteriorate the existing protection systems. Sections 5.2 and 5.3 of this standard cover the protection of KSC and CCAFS facilities from direct lightning strikes and transient voltage surge suppression of various types of facilities and systems. This standard does not treat lightning-related matters, such as design practices for equipment used at the facility for protection from indirect (induced) effects. Refer to KSC document TM-667 and KSC-STD-E-0022, for design for protection of equipment from lightning-induced effects.

2. APPLICABLE DOCUMENTS

The following documents form a part of this document to the extent specified herein. When this document is used for procurement, including solicitations, or is added to an existing contract, the specified revision levels, amendments, and approval dates of said documents shall be specified in an attachment to the Solicitation/Statement of Work/Contract. KSC organizations in performing internal operations shall use the latest available issue or revision of each document. In the event of difference between this standard and the referenced document, this standard shall govern to the extent of such difference.

KSC-STD-E-0012F
January 10, 2013

NASA facilities located on CCAFS may require adherence to additional DOD and Air Force requirements that are more stringent than this standard.

Copies of specifications, standards, drawings, and publications required by suppliers in connection with specified procurement functions should be obtained from the procuring activity or as directed by the Contracting Officer

2.1 Government

2.1.1 Specifications

John F. Kennedy Space Center (KSC), NASA

KSC-DE-512-SM	Ground Support Equipment and Ground Support Systems General Design Requirements
KSC-SPEC-Z-0005	Specification for Brazing – Steel, Copper, Aluminum, Nickel, and Magnesium alloys
KSC-E-165	Specification for Electrical Ground Support Equipment Fabrication

Occupational Safety & Health Administration (OSHA)

29 CFR 1910	Occupational Safety and Health Standards
29 CFR 1926	Safety and Health Regulations for Construction

Federal

A-A-55804	Rods, Ground (With Attachments)
-----------	---------------------------------

2.1.2 Standards

National Aeronautical Space Administration

NASA-STD-8719.12	Safety Standard for Explosives, Propellants & Pyrotechnics
NASA-STD 8739.4	Crimping, Interconnecting cables, Harnesses, and Wiring

John F. Kennedy Space Center (KSC), NASA

NASA-STD-E-0022	Bonding, Grounding, Shielding, Electromagnetic Interference, Lightning and Transient Protection, Design Requirements for Ground Systems
-----------------	---

George C. Marshall Space Flight Center (MSFC), NASA

MSFC-STD-1800	Electrostatic Discharge (ESD) Control for Propellant and Explosive Devices
---------------	--

KSC-STD-E-0012F
January 10, 2013

Department of Defense

MIL-HDBK-419A	Grounding, Bonding and Shielding for Electronic Equipments and Facilities Volumes I and II
MIL-STD-461	Requirements for the Control of Electromagnetic Interface Characteristics of Subsystems and Equipment.
MIL-E-6051	Electromagnetic Compatibility Requirements, System
MIL-STD-188-124	Grounding, Bonding, and Shielding for Common Long Haul/Tactical Communication Systems Including Ground Based Communications-Electronic Facilities and Equipment

2.1.3 Drawings

76K04892	Fastener Assembly Pipe Flange - LOX Mechanical System
76K04932	Fastener Assembly Pipe Flange LC39 B and LH ₂

2.1.4 Other Documents

John F. Kennedy Space Center (KSC), NASA

TM-667	Handbook of Design Requirements and Practices for Protection from Lightning-Induced Effects
--------	---

Department of the Air Force

TO 00-25-172	Ground Servicing of Aircraft and Static Grounding/Bonding
AFSCPCMAN 91-710	Range Safety User Requirements Manual Volume 6: Ground and Launch Personnel, Equipment, Systems, and Material Operations Safety Requirements
AFI32-1065	Grounding Systems

2.2 Non-Governmental

Industry Publications

American National Standards Institute (ANSI)

ANSI-J-STD-607-B	Joint Standard, Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications
------------------	--

KSC-STD-E-0012F
January 10, 2013

ANSI/TIA-222-G TIA Standard, Structure Standard for Antenna Supporting Structures and Antennas

ANSI/TIA/EIA-568-B.1 TIA/EIA Standard, Commercial Building Telecommunications Cabling Standard, Part 1 General Requirements

International Electrotechnical Commission

IEC 62305-(1-5) Protection against lightning Parts 1-5

Institute of Electrical and Electronic Engineers (IEEE)

IEEE C2 National Electrical Safety Code

IEEE C62.22 IEEE Guide for the Application of Metal-Oxide Surge Arresters for Alternating-Current Systems

IEEE C62.41 IEEE Recommended Practice on Surge Voltages in Low-Voltage AC Power Circuits

IEEE C62.45 IEEE Guide on Surge Testing for Equipment Connected to Low-Voltage AC Power Circuits

IEEE Std 80 IEEE Guide for Safety in AC Substation Grounding

IEEE Std 81 IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System

IEEE Std 142 Green Book Recommended Practice for Grounding of Industrial and Commercial Power Systems

IEEE Std 1100 Emerald Book Recommended Practice for Ground Electronic Equipment

IEEE Std 1410 Guide for Improving the Lightning Performance of Electric Power Overhead Distribution Lines

National Electrical Manufacturers Association (NEMA)

NEMA VE 1 Metal Cable Tray Systems

NEMA VE 2 Cable Tray Installation Guidelines

NEMA ICS 10 Parts (1&2) Industrial Control and Systems

KSC-STD-E-0012F
January 10, 2013

National Fire Protection Association (NFPA)

NFPA 70	National Electrical Code
NFPA 70E	Standard for Electrical Safety in the Workplace
NFPA 75	Standard for the Protection of Electronic Computer/Data Processing Equipment
NFPA 77	Recommended Practice on Static Electricity
NFPA 780	Standard for the Installation of Lightning Protection Systems

Underwriters Laboratories (UL) Inc.

UL 96	Lightning Protection Components
UL 96A	Installation Requirements for Lightning Protection Systems
UL 467	Ground and Bonding Equipment
UL 1449	Standard for Surge Protective Devices

(Copies of specifications, standards, drawings, and publications required by suppliers in connection with specified procurement functions should be obtained from the procuring activity or as directed by the Contracting Officer.)

3. DEFINITIONS

3.1 Definitions

For the purpose of this standard, the following definitions apply.

- a. Crowbar Device - A surge suppression device that, once turned on by a surge, will continue to conduct the ac power frequency current after the surge has passed, or until the power frequency current reaches the zero crossing of the sine wave. These devices use gas-tubes and thyristors in their design.
- b. Earth - That portion of the earth's crust sufficiently below the surface to act as an infinite sink or source for electric charge. Earth is considered the universal ground or reference zero potential level.
- c. Earth Grounding Counterpoise - Two or more electrically interconnected driven ground rods installed for the purpose of establishing low-impedance contact with earth.
- d. Facility Ground Network - The electrically conductive network, including all structures and grounding cables bonded to the earth grounding counterpoise but excluding the in-

strumentation ground network and electrical enclosures, conduit, and raceway systems. In steel frame structures, the structural members may be bonded together and connected to the earth grounding counterpoise to form the basic network. In buildings using non-conductive structural methods and materials such as masonry and in outside facility areas such as gas, propellant, or oxidizer service facilities, the facility ground network consists of conductors, sized according to criteria included in this standard, bonded to an earth grounding counterpoise, and extended to all areas containing equipment to be grounded.

- e. Equi-potential Signal Reference Plane - An equi-potential conducting plane designed to maintain a number of electrical/electronic units having a common signal reference at the same potential.
- f. Fail Short Failure Mode - A fail short failure mode takes place when the suppression elements fail as a result of a large surge current, and the surge suppressor maintains its structural integrity allowing a low impedance state to be maintained.
- g. Faraday Cage Protection - The Faraday cage protection technique encloses the area or facility to be protected in a conducting "box" comprising a grid of overhead ground wires (OHGW's), numerous grounded conducting masts surrounding the protected area and supporting the overhead grid, and a grounded counterpoise providing an underground grid similar to the overhead grid, which completes the box.
- h. Ground - If not otherwise qualified, any electrical connection to earth, either directly through a facility ground network or through some intermediary grounding system such as an instrumentation ground network.
- i. Grounding - The act of effecting optimum electrical continuity between conducting objects and earth.
- j. Instrumentation Ground Network - An electrical interconnection of low-voltage or signal-level cable shields and special electronic equipment grounding connections, utilizing techniques that minimize the possibility of EMI effects in critical systems.
- k. Equipment Ground - A connection between a unit of electrical equipment and the facility ground network.
- l. Signal Ground - A connection between a signal circuit and its zero signal reference plane.
- m. Transient Voltage Surge Suppression (TVSS) - A surge protective device intended for connection electrically on the load side of the main overcurrent protection in circuits not exceeding 600 volts RMS and for the purpose of limiting lightning and switching surge transients.
- n. Power Ground - A designed connection between a power circuit conductor and a grounding counterpoise.
- o. Lightning Ground - A connection between a lightning protection system and a facility ground network or counterpoise.

KSC-STD-E-0012F

January 10, 2013

- p. Static Ground - A functional term describing a connection between conductive objects and a facility ground network or counterpoise for the purpose of dissipating static electricity.
- q. Bonding - The act of effecting optimum electrical circuit continuity between adjoining conductive surfaces.
- r. Wiring System Enclosures - Normally, non-electrified conductive enclosures containing electrical conductors that may be in electrical contact during abnormal conditions. Examples are conduit and fittings, junction boxes, outlet boxes, cable trays, electrical and electronic equipment frames and enclosures, electrical wiring cabinets, and metallic cable sheaths.
- s. Zone 1 - Hazardous areas (areas in which gases, liquids, or dust may be present in quantities sufficient to produce flammable or explosive mixtures) where bonding and grounding of metallic conducting surfaces to prevent arcing are required. Bonding and grounding practices must be adequate to eliminate or negate the effects of the following phenomena:
 - i. Potential buildup in metal objects due to static charge accumulation
 - ii. Induced voltages from lightning and fault currents
 - iii. Arcing between metal components in fault current paths
- t. Zone 2 - Areas with a suppressed radio frequency (RF) environment that contain EMI-susceptible equipment. Zone 2 areas are areas where: (1) radio frequency interference (RFI) from sources external to the area and sources within the area are nominally suppressed or (2) EMI-susceptible equipments are not inherently efficient receivers and are nominally shielded against RF radiation. In physical terms, this classification includes interior areas containing sensitive electronic equipment, where the enclosing structure provides effective shielding from RF radiation from external sources and in which potential sources of high-level radiated interference are nominally suppressed, and enclosed metal structures and reinforced concrete buildings with all peripheral reinforcing steel bonded and grounded to provide effective shielding against external RF radiation. Examples of Zone 2 areas are:
 - i. Launch Complex 39 (LC-39)
 - ii. Pad Terminal Connection Room (PTCR)
 - iii. Mobile Launcher Platforms (MLP's)
 - iv. Launch Control Center (LCC)
 - v. Vehicle Assembly Building (VAB)
 - vi. Mobile Launcher (ML)
 - vii. Operations and Checkout (O&C) Building
 - viii. Payload Hazardous Servicing Facility (PHSF)
 - ix. Multi-Payload Processing Facility (MPPF)

- x. Rotation Processing Support Facility (RPSF)
 - u. Zone 3 - Areas not normally containing hazardous materials or EMI-susceptible equipment. This classification includes all areas not classified as Zone 1 or 2. Bonding and grounding for protection from lightning hazards and electrical power system faults are required.
- **Note**
- Zones determinations will be made by the electrical design organization after requirements consultation with the users, operator, maintenance organization, and Safety.
- v. Ordnance Facility Grounding and Bonding – Grounding and bonding of Ordnance Facilities shall follow the requirements of NASA STD 8719.12.
 - w. All Other Equipment: A functional category for this document. Miscellaneous equipment that doesn't fit the description of other explicitly described categories herein (e.g. laboratory and other test equipment, shop aids, vehicles, etc.) but may require consideration for grounding, bonding, shielding, and/or lightning protection.
 - x. Category: A broad classification of facility and system types from which the required general level of grounding, bonding, shielding, and lightning protection design rigor is inferred herein. A category is determined by the design activity manager in consultation with activity stakeholders.
 - y. Conventional Facility: a facility intended for uses typical of commercial utilization such as office buildings, warehouses, machine shops, and other uses, whose structures are characterized by well-established design precedents and loading conditions, whose primary function is nonhazardous, and which is not formally rated as Critical by the supported activity.
 - z. Facility: A functional category for this document. Land, buildings, structures, and other real property improvements including facility systems (utility systems and collateral equipment that is integral and local to the structure). Facility systems include HVAC, 60 Hz power, potable water, elevators, lighting, shop air, etc. Facility systems may support or have interfaces with GSE.
 - aa. Ground Communication System: any of a set of KSC systems which includes but is not limited to the following members – KITS (outside cable plant, inside communications wiring, transmission and media conversion equipment, dedicated ATXS/etc. networks); OIS; EPACS; BCDS; Imaging; KSC Timing; Trunked Radio System; Conventional Radio System; PAWS; and UCPS. These systems may include their own support structures; enclosures; cable raceways; cable interconnects; internal power distribution; grounding, bonding, and shielding accommodations; and surge protection. They do not include operational RF communications interfaces to flight vehicles.
 - bb. Ground Support Equipment (GSE): A functional category for this document. Non-flight equipment, systems, or devices, portable or fixed, specifically designed and developed for a direct physical or functional interface with flight hardware. GSE may be developed and/or

KSC-STD-E-0012F

January 10, 2013

operated by a specific flight program, or by the KSC Institution as a service supporting multiple flight programs.

- cc. **Nonconventional Facility:** A facility intended for uses predominately atypical to commercial utilization. Such uses may include, but are not limited to: storage or housing of flight hardware; provision of direct access to flight hardware, e.g., test stands, launch complexes, and access platforms in operational or research facilities; towers; and similar special-purpose facilities. A Nonconventional Facility may be characterized by unusual or inadequately defined conditions (launch acoustics, vibration, rocket exhaust, etc.), a lack of established design precedent, or frequent modifications to required operational configuration changes. A facility may also be treated as Nonconventional for the purposes herein based on formal assessment as Critical by the supported activity, or by identified hazards present.

4. GENERAL REQUIREMENTS

4.1 Requirements Applicable to All Zones

All facilities and structures at KSC and CCAFS shall be designed to provide adequate grounding, lightning, and transient surge protection systems as required by the applicable standards and additional requirements of this document.

All KSC facilities, systems, and all other equipment shall, at a minimum, meet the grounding, bonding, shielding, and lightning protection requirements of the following standards as applicable to elements of the design: NFPA 70, NFPA 70E, NFPA 780 and IEEE C2.

The facility or system shall comply with design requirements, and the design shall ensure compliance with operational requirements during KSC development (construction/assembly), operations, and maintenance activities.

4.2 Request for Waivers

The requirements set forth in this standard are intended to establish standard practice throughout KSC. There may be circumstances in which a deviation from the requirements listed herein are practical; such deviations may be allowed if they are approved in writing by a properly executed waiver. Requests for waivers of any requirements of this Standard must be supported by technical justification.

Direct waiver request to: Center Operations Directorate
 Mechanical/Electrical Branch, Mail-code: TA-B3
 John F. Kennedy Space Center, NASA
 Kennedy Space Center, Florida 32899

4.3 Materials and Galvanic Action

All mating surfaces that comprise a bond shall be of the same material where possible. When necessary, dissimilar metallic joints shall not form galvanic couples with a value greater than 1 as taken from table 1. Where dissimilar metals are to be used, a non-oxidizing compound shall be coated on the metals prior to connection.

KSC-STD-E-0012F
January 10, 2013

Table 1. Potential Tendency for Galvanic Corrosion

CATEGORY	METAL OR ALLOY	CATEGORY																			
		1	1	2	3	3	3	4	5	5	6	7	8	8	9	10	10	11	11	11	12
		Magnesium	Magnesium Alloy	Zinc	Clad 70 Al	Clad 7075 Al	Clad 6061 Al	Clad 2024 Al	3003 Al	6061-T6 Al	Cadmium	2024-T4 Al	Steel or Iron	Cast Iron	Chromium Iron (Active)	304 S/S (Active)	316 S/S (Active)	Lead-Tin solders	Lead	Tin	Nickel (Active)
1	Magnesium	0	0	1	2	2	3	4	4	5	6	7	7	8	9	9	10	10	10	11	12
1	Magnesium Alloy		0	1	2	2	3	4	4	5	6	7	7	8	9	9	10	10	10	11	12
2	Zinc			0	1	1	2	3	3	4	5	6	6	7	8	8	9	9	9	10	11
3	Clad 70 Al				0	0	1	2	2	3	4	5	5	6	7	7	8	8	8	9	10
3	Clad 7075 Al					0	0	1	2	2	3	4	5	5	6	7	7	8	8	9	10
3	Clad 6061 Al						0	1	2	2	3	4	5	5	6	7	7	8	8	9	10
4	Clad 2024 Al							0	1	2	3	4	5	5	6	6	7	7	7	8	9
5	3003 Al								0	0	1	2	3	3	4	5	5	6	6	6	7
5	6061-T6									0	1	2	3	3	4	5	5	6	6	6	7
6	Cadmium										0	1	2	2	3	4	4	5	5	5	6
7	2024-T4 Al											0	1	1	2	3	3	4	4	4	5
8	Steel or Iron												0	0	1	2	2	3	3	3	4
8	Cast Iron													0	1	2	2	3	3	3	4
9	Chromium Iron (Active)														0	1	1	2	2	2	3
10	304 S/S (Active)															0	0	1	1	1	2
10	316 S/S (Active)																0	1	1	1	2
11	Lead-Tin solders																	0	0	0	1
11	Lead																		0	0	1
11	Tin																			0	1
12	Nickel (Active)																				0
13	Hastalloy C (Active)																				0
14	Hastalloy A (Active)																				0
15	Brasses																				0
15	Copper																				0
15	Bronzes																				0
16	Silver Solder																				0
17	Nickel (Passive)																				0
18	304 S/S (Passive)																				0
18	316 S/S (Passive)																				0
19	Silver																				0
20	Graphite																				0
20	Platinum																				0

Note: Numbers are qualitative only; the larger the number, the greater the tendency for galvanic corrosion.

KSC-STD-E-0012F
January 10, 2013

5. DETAILED REQUIREMENTS

5.1 Bonding and Grounding Requirements

5.1.1 Facility Ground – Earth Electrode Requirements

Earth electrodes for power, communication, and lightning protection system grounding shall be accordance with NFPA 70, NFPA 780 and the following:

- a. As a minimum a counterpoise system shall encircle the perimeter of the facility. Wire used for this application shall be bare-stranded copper conductors not less than No. 2/0 AWG in size. The design should maximize burying counterpoise outside of the structure drip line, at least 24-inches from the building foundation but within 72-inches of the building foundation. Minimum burial depth recommended at 24-inches, but shall not be less than 18-inches.
- b. Ground rods shall be installed at all lightning protection down conductor connections, at ground level electrical equipment connection points, and at ground level telecommunication equipment room grounding points. In general all ground rods shall be interconnected in-line (dead-ends minimized) to the counterpoise system. Additional ground rods shall be installed as needed. The entire system shall be designed for an overall ground electrode resistance of 10 Ohms, maximum.
- c. Drawings shall show counterpoise lay-out, bonding connection provisions, ground rod locations, ground rod length, and test-well provisions.
- d. New counterpoise systems shall be bonded to existing adjacent counterpoise systems (if within vicinity), all incoming power and communication service grounds, and to other earth electrode grounds as required by NFPA 70.
- e. At a minimum, metal frame buildings shall be directly bonded to the counterpoise system at all lightning protection down conductor locations. Connection shall be made at lowest point on down conductor route (e.g., point closest to earth).
- f. No other services are to be installed in the same trench that is in use for facility counterpoise or lightning protection conductors (excluding electrical ductbanks).

5.1.2 Medium Voltage Power Transformers.

Where the voltage transformer is located within the building or facility, ac power distribution systems shall be grounded to the counterpoise at one point only. Where the voltage transformer is located external to the building or facility a counterpoise system shall encircle the perimeter of the voltage transformer equipment pad. The counterpoise shall be connected to the supplying duct bank ground, the service entrance equipment, the power ground on the secondary side of the supply transformer and, if adjacent, the facility counterpoise system. Wire used for the counterpoise shall be bare-stranded copper conductors not less than No. 2/0 AWG in size. A 6-meter (20-foot) ground rod shall be installed adjacent to the cable termination compartment (secondary side for pad-mounted transformers) and connected to the counterpoise by exothermic weld. For medium voltage transformers the following items shall be bonded together:

- a. The supplying source ground conductors including the cable shields on the medium voltage cable terminations.
- b. The transformer neutral (if not factory connected to the transformer tank).
- c. All equipment enclosure ground pads or busses.
- d. Electronic enclosure equipment if adjacent to the transformer.
- e. All surge suppressor ground connections.
- f. All metal conduit ground bushing should be equipped with lugs capable of connecting to No. 2/0 AWG copper cable.

5.1.3 Non-Service Separately Derived Transformers (Dry-Types)

Separately derived systems shall be bonded at the transformer secondary and grounded in accordance with NFPA 70.

5.1.4 Uninterruptible Power Supply (UPS) Units (Including rack mounted UPS units with AC output)

- a. Inverter input and bypass input circuits to UPS units shall be grounded in accordance with NFPA 70 requirements for equipment grounding.
- b. The inverter output of UPS units shall be grounded as a separately derived system in accordance with NFPA 70. The grounding electrode conductor shall be connected directly to the inverter neutral terminal with a system bonding jumper installed to the UPS enclosure and a supply side bonding jumper installed to the downstream distribution equipment ground bus.
- c. Battery circuits shall not be grounded.
- d. UPS cabinets, UPS inverter neutrals, and battery cabinets shall be directly connected to the facility earth ground system. The design shall provide and specify the necessary connection provisions.
- e. Transfer equipment associated with maintenance (wrap-around) bypass circuits shall include a separately switched pole for the neutral conductor.

5.1.5 Medium Voltage Switching Stations

Where the Switching Station is located within the building or facility, the facility ground shall be connected to the switchgear ground bus at each incoming cable termination compartment. For outdoor Switching Stations, a counterpoise system shall encircle the perimeter of the equipment pad. Wire used for counterpoise shall be bare-stranded copper conductors not less than No. 2/0 AWG in size. The counterpoise shall be connected to supplying duct bank grounds and, if adjacent or installed on the same project with the equipment, the facility counterpoise system. Ground rods sized and spaced to minimize resistance to ground shall be installed adjacent to incoming cable compartments and connected to the counterpoise by exothermic welding. A minimum No. 2/0 AWG bare-stranded copper cable shall connect the switchgear ground bus to these

KSC-STD-E-0012F
January 10, 2013

ground rods. Additionally, any metal enclosures shall also be directly and separately connected to the local counterpoise system. Generally, the switchgear ground bus shall be bonded together to:

- a. The supplying source ground conductors including the cable shields on the medium voltage cable terminations.
- b. Switchgear enclosure.
- c. Counterpoise of facility ground.
- d. Potential and control transformer neutrals.
- e. Adjacent electrical equipment.
- f. All surge suppressor ground connections.
- g. All metal conduits.

5.1.6 Utility to Utility Transfer Switches

Follow NEMA ICS 10 Parts (1&2). Transfer equipment shall include a separately switched pole for the neutral conductor for separately derived sources. Transfer switches shall be grounded in accordance with NFPA 70 requirements for equipment grounding.

5.1.7 Generators

5.1.7.1 Permanently Installed Generators

- a. A counterpoise system shall encircle the perimeter of the generator enclosure and other generator equipment such as fuel tanks. Wire used shall be bare-stranded copper conductors not less than No. 2/0 AWG in size. A 6-meter (20-foot) ground rod shall be installed with a ground test well adjacent to the generator output and connected to the generator counterpoise system as required to achieve a 10 Ohm maximum ground resistance. The output of generator units shall be grounded as a separately derived system in accordance with NFPA 70. The grounding electrode conductor shall be connected directly to the generator output neutral terminal with a system bonding jumper installed to the generator enclosure. Transfer equipment connecting generator sources to facility distribution equipment shall include a separately switched pole for the neutral conductor. Contact operation on neutral shall be make before break (overlapping neutral).
- b. The design shall indicate the following connections to the counterpoise system:
 - i. Generator frame.
 - ii. Generator Housing.
 - iii. Fuel Tanks.
 - iv. Generator output duct bank ground.
 - v. Any other metal bodies or auxiliary enclosures.
 - vi. Any adjacent facility counterpoise system

5.1.8 Wiring System Enclosures and Electrical Equipment Grounding

Any type of metallic electrical enclosure component that may come in contact with a conductor shall be grounded or shall be bonded to other component parts that are grounded.

5.1.8.1 Electronic Equipment Enclosures

The grounding of electronic equipment, whether single point, multipoint, or a combination, depends on the expected noise frequencies, cable lengths, and network connections involved, as discussed in appendix A, A.2.6. In accordance with NFPA 75, all exposed non-current carrying metal parts of automatic data processing/electronic computer systems shall be bonded to the equipment grounding conductor or shall be double insulated.

5.1.8.2 Instrumentation and Communication Terminal Distributors

Grounding conductors shall be No. 6 AWG copper or larger.

5.1.9 Cable Trays

Cable trays for power, control, or communications use shall be grounded, bonded and be electrically continuous systems in accordance with NFPA 70 and the following:

- a. Cable trays are permitted to be used as an equipment grounding conductor (EGC) when labeled and marked within the available cross-sectional area. If the cable tray is to be used as an EGC, bonding jumpers must be installed on both side rails at the locations illustrated in examples A through D of Figure 1, unless the splice plates meet the electrical continuity requirements of NEMA VE 1. If the connectors are UL-classified, it is not necessary to use bonding jumpers or a continuous ground.
- b. Connections shall be bi-metal type to prevent galvanic action between copper grounding conductors and the cable tray material, generally aluminum. Use non-oxidizing coating between different type metals.
- c. For all metal conduits housing conductors entering or leaving a cable tray system, grounding bushings with a grounding conductor connector shall be specified. Bond conduits using these grounding bushings to the cable tray (use bi-metal or other appropriate connectors), the equipment grounding within the conduit system, and the equipment grounding conductor within the cable tray system.
- d. Where cable trays penetrate an exterior building wall, they shall be directly connected to the facility counterpoise system at this point with a minimum No. 2/0 AWG copper cable.

5.1.9.1 Cable Tray Sections


Cable tray sections, whether in single runs or in system arrangement, shall be bonded together. Cable tray sections in tandem assembly shall be considered as having electrical continuity when these sections are bonded with appropriate high-strength bolts. A jumper, consisting of a bond strap as described in this standard, shall be installed whenever expansion joints are required. The minimum jumper size shall be equivalent to a No. 3/0 aluminum or No. 1/0 copper cable in

KSC-STD-E-0012F
January 10, 2013


cross-sectional area. Cable tray assemblies shall be connected to the facility ground network with a minimum No. 2/0 AWG copper cable. Copper grounding conductors shall not be bonded directly to aluminum cable trays. To prevent galvanic action, a UL-listed copper-to-aluminum transition lug shall be used. The connections shall be made within 0.5 meter (m) [2 feet (ft)] of each end and at intervals not exceeding 15 meters (50 feet) along the run. Where metal covers are used, they should be securely bolted in place. All cable trays shall be connected to grounding terminals at the point of entry into a structure.

5.1.9.2 Conduit and Raceway Systems


Metal conduit, fittings, junction boxes, outlet boxes, armored and metal-sheathed cable, and other raceways shall be bonded together in accordance with NFPA 70 requirements. These bonded systems shall not be considered to serve as the sole equipment grounding connector. A separate equipment grounding conductor shall be installed in each raceway for grounding connections.

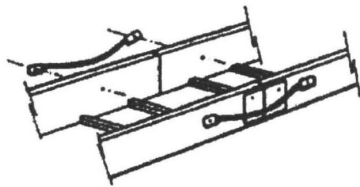


A. Expansion Splice Plates

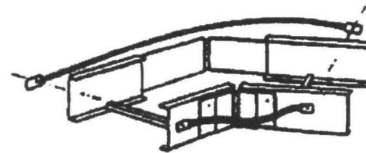

B. Horizontal Adjustable Splice Plates

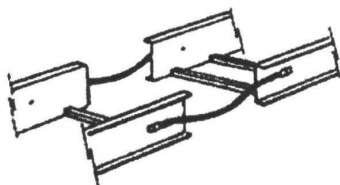

C. Discontinuous Segments

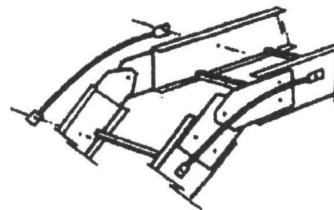

D. Cable Tray Sections
Vertical Adjustable Splice Plate

Figure 1. Installation of Cable Tray Grounds

5.1.9.3 Mobile and Portable Equipment

Portable electrical equipment shall be considered adequately grounded through the power cord ground conductor, provided a solid connection is made between the equipment case and the ground terminal of the power receptacle. All wiring enclosures and frames of electrical equipment in mobile equipment, such as elevators, cranes, trailers, crawler transporters, fuel and oxidizer handling equipment, etc., shall be grounded to the mobile equipment main metal frame in accordance with this standard. Mobile equipment shall be grounded as follows:

a. Cranes

i. Grounding

1. Feed Rail and Collector Type Electrification. – A separate grounding rail shall ground the crane to the facility ground through an equipment grounding conductor.
2. Festoon Cable or Cable Reel Type Electrification – A separate equipment grounding conductor shall ground the crane to the facility ground.
3. Crane Hooks. – Grounding of crane hooks shall be done by a mechanical attachment in lieu of welding so as to prevent degradation of the hook material.

- ii. Bonding – Bonding of crane rail sections shall be provided by the rail clips and rail connecting plates.

b. Facility Portable Generator Connections

i. Grounding

1. The Generator shall be placed adjacent nearest location of 6-meter (20-foot) ground rod test well. Connections to the ground rod location shall be made directly to:
 - a) The facility counterpoise system.
 - b) Electrical enclosures and any grounded conductor busses installed for the portable generator equipment connections to the facility.
 - c) All metal conduits enclosing generator power cables; specify grounding bushing with lug capable of connecting 2/0 copper cable.

- ii. Bonding - Main bonding jumper provisions for fault return current shall be installed at the permanently installed switching means at the facility. Portable generator connections to facility electrical systems shall be designed to include the isolation of generator and facility electrical system neutral conductors by using equipment that switches the neutral. Where such transfer equipment is employed the neutral switching shall be make before break (overlapping neutral).

5.1.10 Electrical Manholes/Vault

In all electrical power and communications cable system manholes, at a convenient point close to a perimeter wall, a 6-meter (m) (20-foot) ground rod shall be driven (before the manhole is poured) so that the top of the rod is approximately 100 millimeters (mm) [4 inches (in)] above the manhole floor.

KSC-STD-E-0012F
January 10, 2013

For precast concrete manholes, the top of the rod can be below the floor and a No. 2/0 copper conductor extended from the rod into the manhole through a watertight penetration in the wall or floor. This rod or conductor shall be utilized for grounding power and communications metallic cable sheaths and all items of hardware in the manhole. Metallic shields brought out of medium voltage cable splices shall be bonded directly to the manhole or vault ground. All metallic items of hardware in the manhole or vault shall be bonded to the manhole ground.

Where possible, exothermic welds shall be used for bonding manhole hardware to the manhole/vault ground conductor. However, where the requirement exists for disconnecting the bond or where application of heat could jeopardize existing cables, bolted or clamp connections shall be used. A conductive corrosion inhibitor shall be applied to the mating surfaces of mechanical connectors. For large vaults, ground rods shall be installed near each corner of the vault and connected with a looping counterpoise installed within the vault.

5.1.11 Exterior Structures

Exterior structures, such as towers, fences, railroad tracks, pole lines, etc., shall be grounded. Pole lines and railroad tracks should be grounded in accordance with those applicable requirements in section 5.2. Fences used as personnel barriers and around power substations shall be grounded as specified in sections 5.1.21 and 5.1.22 to provide protection from high-voltage hazards. Grounding shall be provided whether or not the exterior structure is exposed to lightning strokes.

5.1.12 Metal pipe (General)

Metal pipe shall be bonded to ground at the end terminations and at intervals of not more than 90 meters (300 feet).

5.1.13 Ground Rods

Ground rods shall be 19-millimeter (3/4-inch) diameter, 3-meter-length (10-foot length) copper-clad steel rods conforming to A-A-55804, Type II, Class B rods. The 3-meter (10-foot) lengths shall be vertically joined either by threaded brass couplings, by exothermic welding completely around both rod/coupling joints, or by threaded couplings that are welded at either rod. Ground rods shall be driven to a depth of at least 3 meters (10 feet) with the top of the ground rod at a recommended depth of 24 inches below grade but not less than 18 inches. Testing shall be in accordance with section 6.3.5.

5.1.14 Earth Grounding Counterpoise Design

An earth-grounded counterpoise shall be installed at lightning-protected facilities. The counterpoise design will vary in the number of ground rods, number of interconnections, etc., depending on the size of the facility and function of the counterpoise. The following guidelines shall be used as a minimum of each design.

- a. Except for straight-line counterpoises for duct banks, cable trays, etc., there shall be at least two copper paths between any two points in the counterpoise.

- b. Ground rods shall be installed so any point on the counterpoise is within 15 meters (50 feet) of a ground rod. Spacing between ground rods shall be as uniform as practicable throughout the counterpoise but minimum spacing between ground rods shall not be less than the sum of the ground rods length.
- c. Wire used for interconnecting ground rods shall be bare-stranded copper conductors not less than No. 2/0 AWG in size.
- d. Ground rods shall be driven not less than 610 millimeters (24 inches) from structure foundations as practical and to a recommended depth such that the tops of the rods are 600 millimeters (24 inches) below grade level but not less than 460 millimeters (18 inches). Interconnecting wires are recommended to be buried at 600 millimeter (24 inches) below grade level but shall not be buried less than 460 millimeters (18 inches). The interconnecting wire for a building counterpoise shall consist of a complete loop around the building, shall be installed in the excavation for curtain wall and column footings, shall not exceed 1800 millimeters (72 inches) from the building foundation and is recommended to be buried 600 millimeters (24 inches) below grade level but shall be not less than 460 millimeters (18 inches).
- e. Wire connections to ground rods and riser connections to counterpoise wires shall be made by exothermic welding only. The wires or the wire and rod shall be placed in parallel contact and continuously welded for a distance of at least 50 millimeters (2 inches).
- f. The design of large counterpoise systems shall consider the use of test well or test point locations that would allow for the ease of periodic testing of the network ground resistance.
- g. New counterpoise systems shall be bonded to existing adjacent counterpoise systems.

5.1.15 Instrumentation and Electronic Equipment Grounding

Specification of the detailed requirements for ground networks is dependent upon the characteristics of the systems with which the ground networks are to be used. Individual ground planes may consist of a flat conductive surface, tubular conductors, solid or stranded wire, or combinations thereof. The design of ground networks shall be in accordance with the general guidelines stated below and in appendix A, A.2.6. Three grounding schemes for use are:

- a. Structural Steel as a System Ground Point – This grounding scheme utilizes the structural steel in the structure as a low-impedance extension of the earth ground. Individual instrumentation and communication system reference planes are single-point grounded to the building steel using a minimum of No. 2/0 insulated copper ground wire. Where an electronic system consists of a number of subsystems, the ground connections from each subsystem may be connected to a common point and this point connected to the building steel using a minimum of No. 2/0 insulated copper ground wire.
- b. Separate Ground Risers – This scheme requires that each individual instrumentation/electronic equipment system reference plane be connected to the building ground system at one common point. Insulated grounding conductors, of a minimum of No. 2/0

KSC-STD-E-0012F
January 10, 2013

copper, shall be run from each equipment system to a common point where the building steel is connected to the earth ground. The maximum resistance of each insulated conductor shall not exceed 50 milliohm.

c. Use of Structural Steel for Multiple Grounds

- i. Multiple Grounds (for High Frequencies). – The multiple ground configuration is used for high frequency electronic equipment and computer ground networks. In this method, many conductive paths from the instrumentation or electronic equipment within the facility to the facility ground or earth-grounded building steel system may be established such that the systems are interconnected to each other and to building steel at multiple locations.

Raised Floors –Metallic components of raised floors can be bonded together to form an equipotential plane on which automatic data processing, computer, and other electronic equipment, susceptible to high-frequency noise, can be installed. Raised floor parts must be well bonded together and also connected to the earth electrode system. The designer may use single-point or multipoint grounding for the equipotential plane as required by the noise frequencies and the network size. Raise floor pedestals, stringers, space assembly blocks, springs, and spring isolation assemblies may be grounded via grounding system conductors to the earth electrode system. The lateral stringers (supporting braces installed between supporting pedestals) must be bolted down. Only bolted-grid (stringer) or rigid-grid systems are acceptable as equipotential planes. Members must be suitably plated (tin or zinc) so that low-resistance pressure connections can be made as shown in figure 2. See section 5.1.24.10 for test resistance values.

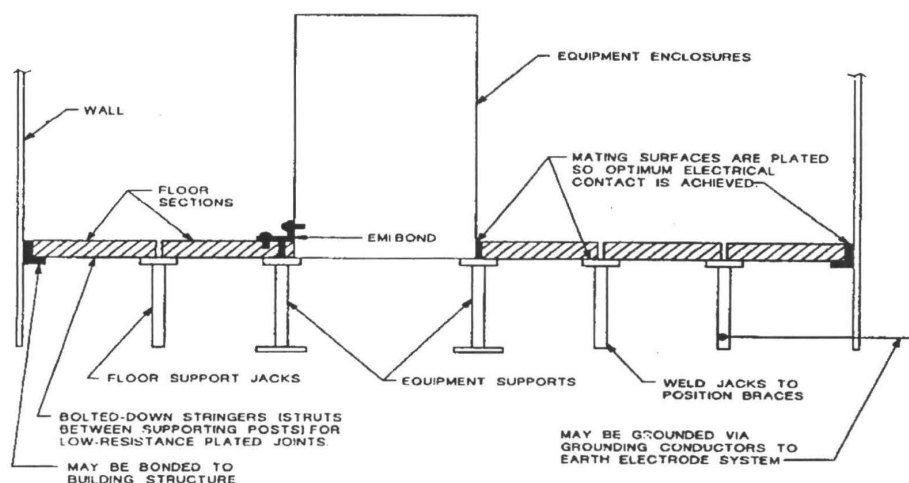


Figure 2. Grounded Raised Floor

KSC-STD-E-0012F
January 10, 2013

5.1.16 Critical Instrumentation and Control Cable Overall Shields

All critical electrical cable and wires for interior use shall have an overall shield for lightning protection, unless protection is provided by other means. The following requirements shall apply.

- a. Shield shall have a minimum optical coverage of 98 percent.
- b. Overall cable shields shall be grounded at both ends of the cable. If this is not possible due to interference from other sources, then a cable having two shields shall be specified. The outer shield shall be grounded at both ends, and the inner shield shall be grounded at the source end only and then only to a signal ground bus.
- c. Termination of overall shields shall be made along a 360-degree periphery of the connector shell.
- d. The connector shall be grounded in a 360-degree manner to the surface upon which it is mounted.
- e. Termination and grounding of overall shields at such surfaces with pigtails or single pins shall not be acceptable.
- f. Termination and grounding shields shall be installed in accordance with NASA STD 8739.4 and KSC-E-165.

5.1.17 Types of Bonds

Unless otherwise specified herein, bonding of metal surfaces shall be accomplished by (1) brazing, (2) welding, (3) clamping, or (4) structural joining methods or a combination thereof.

5.1.17.1 Brazing

Brazing solder shall conform to specifications in KSC-SPEC-Z-0005.

5.1.17.2 Welding

In accordance with the manufacturer's recommendations, welding shall be by the exothermic process in which the conductors are joined by molten superheated copper produced by reduction of copper oxide by aluminum. The welding procedure shall include the proper mold and powder charge and shall conform to the manufacturer's recommendations.

5.1.17.3 Clamping

In external locations, clamping shall be used only where a disconnect type of connection is required or as specified by this standard. The connection device may utilize either spring-loaded jaws or threaded fasteners. The device shall be so constructed that positive contact pressure is maintained at all times. This method includes the use of machine bolts with tooth-type or spring-type lock washers. A conductive corrosion inhibitor shall be applied to all mating surfaces before connection is made.

KSC-STD-E-0012F
January 10, 2013

5.1.18 Structural Joining Methods

Joints made with high-strength structural bolts and clean unpainted faying surfaces shall be considered as sufficiently bonded to meet the electrical requirements of this standard. The term "clean" as used herein shall mean that faying surfaces on new steel shall have been blasted to bare metal. Where this condition does not exist, a jumper in the form of a No. 4 AWG bare copper wire exothermally welded at each end to the surfaces involved spanning the connection, or a bond weld defined as a 6.4-millimeter (1/4-inch) or larger fillet weld with a 50-millimeter (2-inch) minimum length across the connection would meet the requirements of this standard. Wire jumpers shall be used across joints employing miscellaneous machine bolts such as those used in stairway construction.

5.1.18.1 Cleaning of Bonded Surfaces

Before joining, all surfaces that comprise a bond shall be thoroughly cleaned to remove paint, oxides, and other resistance films from the mating surfaces. Gentle and uniform pressure and an appropriate abrasive shall be used to ensure a smooth, uniform surface without point contacts. Excessive metal shall not be removed from the surface. Clad metals shall be cleaned with a fine steel wool or grit in such a manner that the cladding material is not penetrated by the cleaning process. Bare metal shall then be cleaned with a solvent-moistened cheese cloth. Grease, oil, dirt, corrosive preventatives, and other contaminants shall also be removed using this same method. This cleaned area shall be allowed to air dry before connection of the bond. The bond shall be attached within 1 hour after cleaning. The joint shall be sealed and the exposed surfaces shall be refinished within 2 hours to prevent oxidation. If additional time is required, a corrosion preventative shall be applied until the area can be refinished.

5.1.18.2 Corrosion Inhibitor

All bonds made using compression or bolted connectors shall be prepared as described in section 5.1.18.1. A conductive corrosion inhibitor shall be applied to the connector mating surfaces before the connection is made.

5.1.18.3 Protection of Finished Bonds

Finished bonds shall be protected by painting to match the original finish after the bond is made.

5.1.18.4 Bonding Straps and Jumpers

Unless otherwise specified, bonding straps and jumpers shall be copper and shall have a cross-sectional area of not less than that of No. 6 AWG copper wire. Bonding straps and jumpers for shock-mounted devices (pivot, hinged, or swivel joints) shall be made of flat-tinned copper woven wire braid or flexible stranded wire. Vibration of the strap or jumper by the shock-mounted device shall not change its electrical characteristics. Bonding jumper installation shall conform to the following:

- a. Bonds shall be accomplished by brazing or welding in outdoor locations unless a disconnect type of connection is required, in which case clamping with bolts shall be used. For each bolt, a tooth-type lock washer shall be inserted between the strap and metallic member.

- b. The straps shall be bonded directly to the basic structure rather than through any adjacent parts.
- c. When installed, the straps shall be unaffected electrically by motion or vibration.
- d. The straps shall be installed in an area that is accessible for maintenance.
- e. Single straps shall be used; two or more straps shall not be connected in series.
- f. Straps shall be installed so they will not restrict movement of structure members.
- g. Straps shall be installed so they will not weaken structure members to which they are attached.

5.1.19 Ground Connections (General)

All ground connections shall be bonded connections, made in accordance with the applicable requirements of section 5.1.17. If not otherwise specified, grounding conductors shall be solid or Class B stranded copper of a size sufficient to meet the grounding resistance requirements specified herein. Welding or brazing is the preferred method of attaching grounding conductors, and these methods shall be employed wherever possible. When welding or brazing is unsafe, bolted or clamped connections may be used. When connectors are required on ground wires or straps, the connectors shall be attached by welding, brazing, or compression methods. A conductive corrosion inhibitor shall be applied to mating surfaces before the connections are made.

5.1.20 Ground Plate and Ground Point Identification

Where required in the design, equipment grounding plates and grounding points shall be made easily identifiable. A typical ground point for horizontal or vertical use shall be identified as shown in figure 3. The dimension may be adjusted to fit available space. A typical grounding plate shall be identified as shown in figure 4. The border may be adjusted to fit the available space. An Operational Check sticker (KSC FORM 22-420) shall be affixed to the ground plate or ground point identifying the date checked for new construction. The next check due date will be established by the operations and maintenance (O&M) agency.

KSC-STD-E-0012F
January 10, 2013

Ground Point Marking

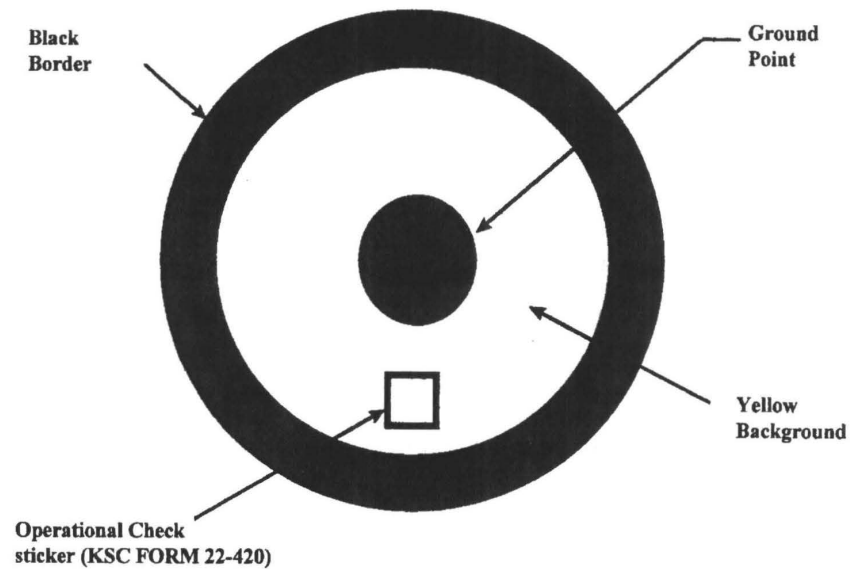


Figure 3. Ground Point Marking

Ground Plate Marking

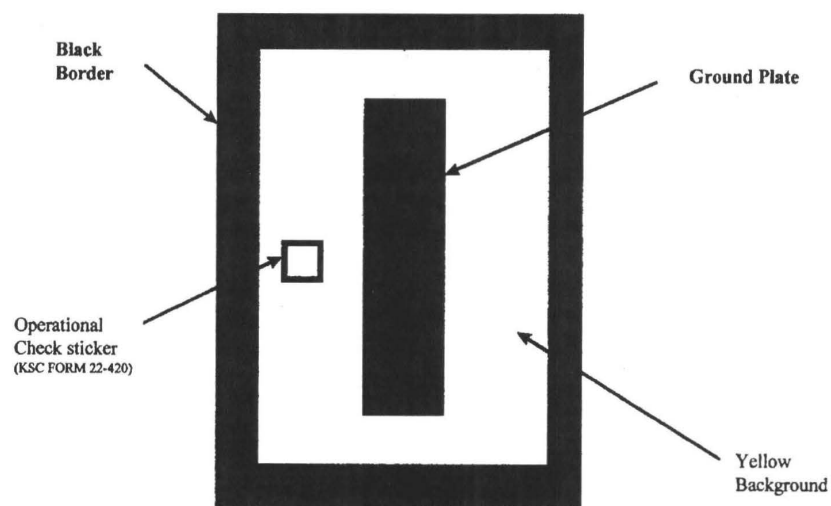


Figure 4. Ground Plate Marking

5.1.21 Metallic Fences Used as Personnel Barriers

All gates, gate posts, corner posts, and fences shall be grounded at intervals not to exceed 300 meters (1,000 feet). In addition, fences shall be grounded at a distance of 45 meters (150 feet) on either side of a point where power lines and/or communication lines cross the fence. Fences within 3 meters (10 feet) of a lightning-protected structure shall be grounded to the structure counterpoise.

5.1.22 Metallic Fences for Electrical Substations

Substation fences shall be bonded to the station counterpoise at intervals not exceeding 30 meters (100 feet). Each fence side shall have at least one bonded connection to the counterpoise regardless of length (a minimum of four bonded connections for a square or rectangular fence). Each gate post shall be bonded to the counterpoise. The top rail and posts shall be grounded with No. 2/0 AWG bare copper wire and connected to substation grounding grid. The ground grid shall be connected to the nearest metallic water main and complex grounding counterpoise, if available (see figures 5 & 6).

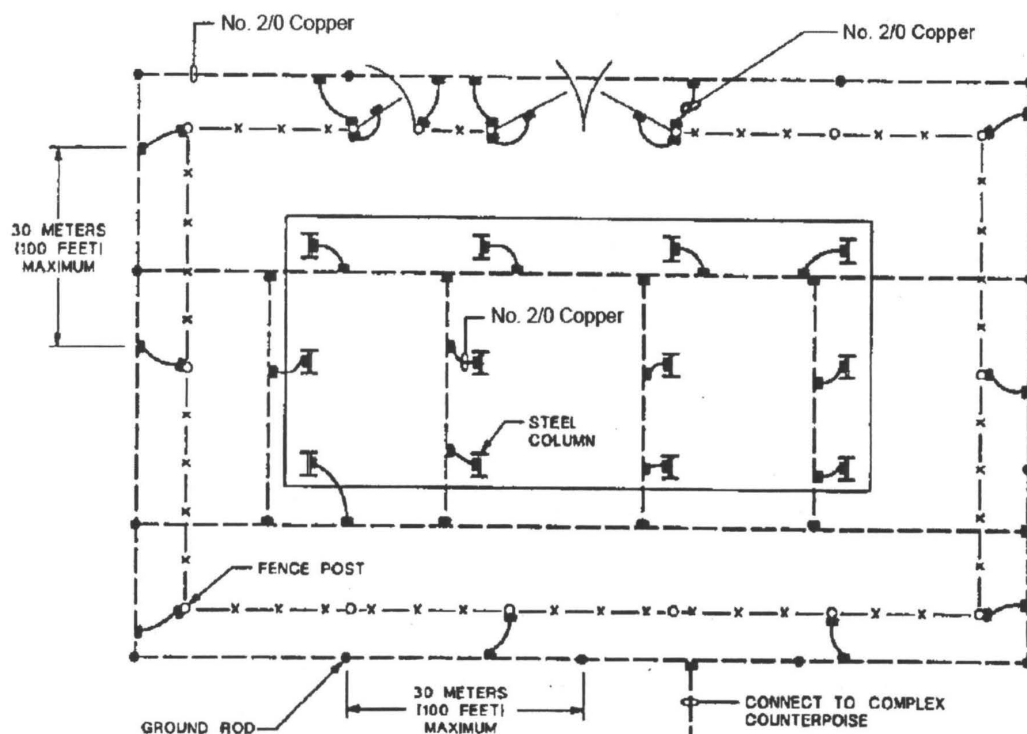


Figure 5. Connection of Substation Fence and Structural Steel

KSC-STD-E-0012F
January 10, 2013

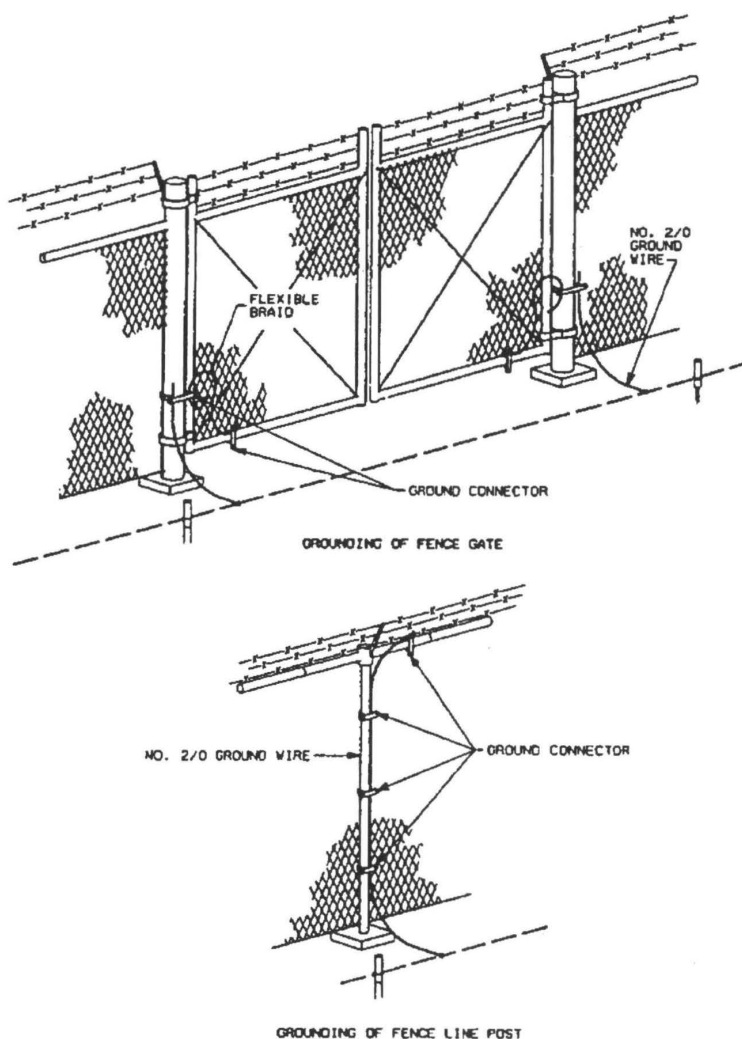


Figure 6. Substation Fence Detail

5.1.23 Additional Requirements for Zones 1 and 2

In addition to the general Zone 3 requirements specified above, areas as classified as Zones 1 and 2 (see section 3 for zones definitions) shall comply with the requirements of sections 5.1.23.1 and 5.1.23.2 as indicated. Some locations, such as certain areas of the Mobile Launcher, will have more than one zone classification. In such cases, the bonding and grounding requirements specified for all applicable zones shall apply.

5.1.23.1 Zone 1

- a. Metal Objects – All exposed metal objects exceeding 1200 millimeters (48 inches) in any dimension shall be bonded to ground. Unexposed metals (such as reinforcing steel completely encased in concrete, in objects that are completely buried, or in objects com-

pletely contained in hazard-proof locations) do not require bonding or grounding as a Zone 1 requirement. Fuel and oxidizer handling equipment shall be bonded to ground.

- b. Heating, Ventilating, and Air-Conditioning Systems – Metallic heating, ventilating, and air-conditioning ducts shall be bonded together and grounded on each end as a minimum. Jumpers shall be used across flexible connections and shall be bonded to the flanges by brazing or welding. Regular slip joints between duct sections consisting of locking devices or sheet metal screws are considered adequately bonded and require no additional bond straps.
- c. Metal Pipe (General) - Metal pipe shall be bonded to ground at the end terminations and at intervals of not more than 30 meters (100 feet). For internal locations, bonding can be by clamping methods if continuous pressure follow-up is provided with serrated or spring washers. External locations shall have brazed or welded bonds, except stainless-steel clamps can be used to bond stainless steel pipe to ground if the restrictions of dissimilar metals as presented in this standard are considered. Threaded joints that have a tapered thread are acceptable if they are drawn up tightly with a corrosion-inhibiting compound applied on both the internal and the external threads to ensure an adequate bond across the joint. Tubing sections joined with fittings that seat metal-to-metal are considered adequately bonded. Flanged joints are acceptable if the flanges are stainless steel or the flanged areas are in contact with the bolt heads and the washers are clean and bright. Bolts and nuts shall be maintained tight. Serrated or spring washers may be used with the bolts and nuts to maintain tightness. Flanged joints used in liquid hydrogen (LH₂) systems shall be bonded in accordance with 76K04932. Flanged joints used in LO₂ systems shall be bonded in accordance with 76K04892.
- d. Exotic Piping - Bimetallic and vacuum-jacketed piping shall be bonded by clamps or by previously attached grounding lugs and pigtailed of compatible materials per the provided Table 2.

5.1.23.2 Zone 2

- a. Structure Metals - In structures housing Zone 2 areas, all reinforcing steel (concrete construction) and all enclosing metal coverings (walls, roofs, floors, and interior partitions) shall be bonded together and grounded. Objects less than 600 millimeters (24 inches) in their largest dimensions are exempted.
- b. Reinforced Concrete - As illustrated in figure 7, each vertical reinforcing bar shall be brazed or welded to two adjacent transverse reinforcing bars consecutively changing bonding point on successive vertical bars, making all bars electrically continuous. A bonding jumper shall be installed from this plane to ground (as shown, building structural steel) at maximum intervals of 15 meters (50 feet). Welded wire fabric shall be brazed or welded together at the edges on 1200-millimeter (4-foot) centers and connected to reinforcing steel on 1200-millimeter (4-foot) centers.

KSC-STD-E-0012F
January 10, 2013

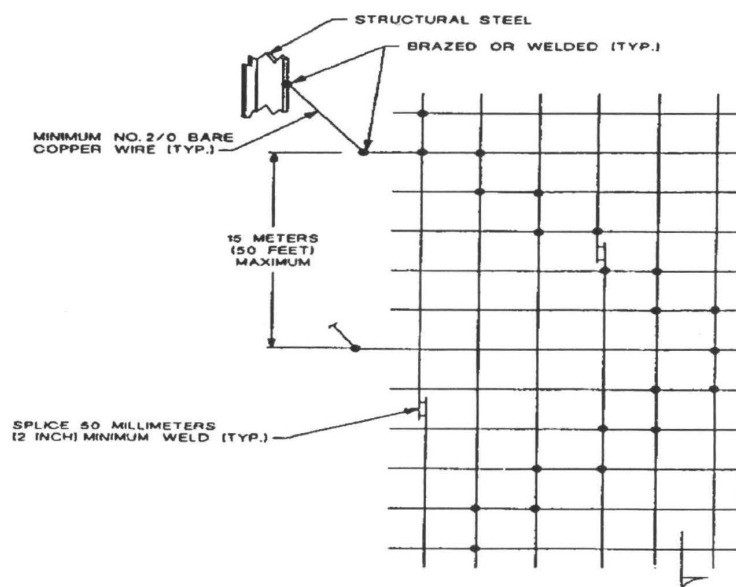


Figure 7. Bonding and Grounding of Reinforced Concrete

- c. Special Structures – Bonding and grounding required to incorporate any special shielding enclosures or other special equipment shall be performed as specified by the designers of such hardware. The methods employed in implementing these requirements shall not conflict with any provision of this standard.

5.1.24 Resistance Values

The following resistance values are the maximum desired to achieve the intended bonding and grounding objectives. The designer shall include the necessary details in the design so that these values will be met.

5.1.24.1 Facility Ground Networks

The total resistance from any point on the facility ground network to the counterpoise shall not exceed 50 milliohms.

5.1.24.2 Power Grounds

The total resistance from the neutral of the power source through the connection to the counterpoise ground shall not exceed 20 milliohms.

5.1.24.3 Wiring System Enclosures

The total resistance from each wiring system enclosure to the facility ground network shall not exceed 50 milliohms.

NOTE

Sections 5.1.24.1, 5.1.24.2, and 5.1.24.3 are established as a general guide. In situations where any of the legs of the fault circuit have resistances exceeding these limits, the fault circuit path shall be analyzed and modified if necessary to ensure instantaneous operation of the circuit protective devices in the event of a "bolted" fault between the circuit conductor and equipment frame or wiring system enclosure.

5.1.24.4 Lightning Protection

The total resistance between the ground connection of any lightning arrester or air terminal and the counterpoise shall not exceed 10 milliohms.

5.1.24.5 Static Grounds

Low resistance is not required for static grounds. Generally at KSC, resistances from 0.1 to 1 megaohm are used to provide static grounds between the grounded object and facility ground. These series resistors may be installed in wriststats and legstats (refer to A.2.3 in appendix A and see TO 00-25-172 for Shuttle Landing Facility aircraft).

5.1.24.6 Ground Rods

The resistance of individual ground rods to earth shall be measured prior to interconnection with the counterpoise. Maximum resistance values shall not exceed 25 ohms. See section 6.3.1 for testing procedures.

5.1.24.7 Counterpoise

The resistance from any point on the counterpoise to earth shall be no greater than 10 ohms. See section 6.3.5 for testing procedures.

5.1.24.8 Bond Resistance

The resistance of any bond connection shall not exceed 1.0 milliohm.

5.1.24.9 End-Device-to-Counterpoise Resistance

The resistance between the end device and the nearest grounding point on the counterpoise shall not exceed 1 ohm (such as the floor grounding receptacle and counterpoise).

5.1.24.10 Raised Floor Resistance

Raised floors used as an equipotential plane for automatic data processing, computer, and other electronic equipment shall have test resistance value of 20 milliohms or less measured from selected points on the floor grid system to the facility ground points.

KSC-STD-E-0012F
January 10, 2013

5.2 Lightning Protection Requirements

5.2.1 General

All NASA facilities and structures at KSC and CCAFS shall be designed to include adequate lightning protection. The method of bonding together lightning protection, power, control, and communication system grounds shall be evident on the design drawings. Lightning protection shall provide a zone of protection, as defined in NFPA 780, appropriate for the facility and its intended use.

A facility equipped with a lightning protection system having the proper zone or cone of protection is substantially shielded from a direct strike; however, electrical and electronic systems within or connected to the building may be damaged by lightning-induced effects if not protected by the design techniques contained in TM-667 and, where automatic data processing (ADP) systems are involved, in NFPA 75. For all buildings where explosives, solid propellants, toxic or flammable liquids and gases, or petroleum, oils, and lubricants (POL) are handled or stored, the lightning protection system shall be designed in accordance with NFPA 780 and associated appendices. Grounding systems associated with lightning protection systems shall be in accordance with the requirements of section 5.1 of this standard. Resistance values for all lightning protection system connections and components shall meet the requirements of section 5.1.24.

5.2.2 Level of Protection

The protective measures described shall be applied as follows:

- a. Unless otherwise directed by this document, NFPA 780 shall be used as the standard for protection of ordinary buildings, miscellaneous structures and special occupancies, heavy-duty stacks, and structures containing flammable liquids and gases. KSC only recognizes Franklin Rod type lightning protection systems as defined by NFPA 780 & UL 96.
- b. For maximum protection to allow certain operations in special facilities containing explosives or flammable materials, the Faraday cage protection technique may be used.

5.2.3 Materials

The minimum materials requirements to be used in lightning protection system design shall be those as specified in NFPA 780. It is preferred that all conductors, connectors, and air terminals be copper. Aluminum air terminals are allowed on aluminum buildings and sheds. Aluminum down conductors shall transition to copper, using approved connection hardware, above grade using bi-metallic connectors listed and approved for the purpose. Design shall require these connectors be near ground level at a minimum distance of 914 millimeters (36 inches) and assessable without the use of ladders or lift equipment. Areas adjacent to salt or brackish water or other installations with specific corrosion concerns shall specify copper materials unless facility construction requires the use of aluminum materials.

5.2.3.1 Overhead Ground Wire (OHGW)/Grid Wire Systems

Materials recommended for OHGW/grid wire systems are specified in section 5.2.4 and in appendix B.

5.2.4 Grounded Masts and OHGW System

5.2.4.1 Protected Area

The area protected by grounded masts supporting OHGW is specified in NFPA 780. Generally, both ends of an OHGW are grounded.

NOTE

“Shield wire” and “OHGW” are used interchangeably herein.

5.2.4.2 Clearance between Conductive Mast and Protected Structure

For structures not over 15 meters (50 feet) in height, clearance for conductive masts or wood masts with down conductor cables shall not be less than 2 meters (6 feet) from the protected structure in order to prevent side flash from the down conductor to the structure. The clearance shall be increased by 300 millimeters (1 foot) for every 3 meters (10 feet) of structure height above 15 meters (50 feet). All masts shall be grounded and connected at ground level to the grounding system of the protected structure.

5.2.4.3 Clearance Between OHGW and Protected Structure

The minimum clearance between an OHGW and the highest point on the protected structure shall be 2 meters (6 feet). The clearance shall be increased by 300 millimeters (1 foot) for each 3 meters (10 feet) of cable over 18 meters (60 feet), as measured between the midpoint on the OHGW and the down conductor ground entry point. OHGW system grounds shall be bonded with the grounding system of the protected structure.

5.2.4.4 Rooftop Antenna Protection

Rooftop antenna installations at KSC and CCAFS that require lightning protection, such as microwave dishes and helical or Yagi antennas, shall be protected from direct strikes by a bare OHGW, which is insulated from the antenna and grounded to the building structure or lightning protection conductors (see figure 8). Other antennas mounted on elevated platforms shall be protected in a similar manner. Antenna hardware shall be separately bonded to the building structure or to the lightning protection system. If antennas do not require protection from direct strikes, they shall be grounded and bonded in accordance with TIA-222-G. In addition, the metal bases of helical and yagi antennas and the supporting pedestals of microwave dishes shall be bonded to the building structure or lightning protection conductors.

All rooftop antennas, television cameras, lights, and other installations that have cabling entering the building structure shall be shielded and properly protected from lightning. The designs, installation, maintenance plan, and configuration control plan shall be reviewed by the KSC Lightning Safety Assessment Committee.

KSC-STD-E-0012F
January 10, 2013

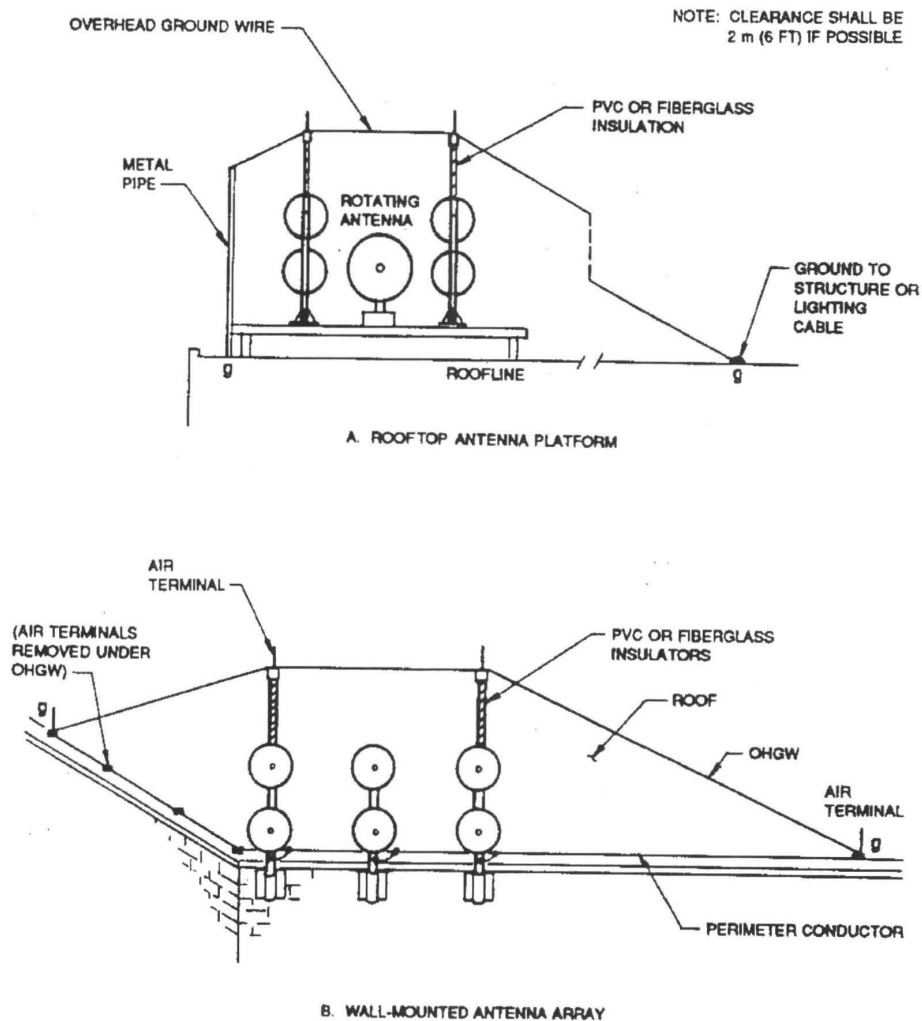


Figure 8. Rooftop Antenna Lightning Protection

5.2.4.5 Environmental Design Criteria for OHGW Installations

IEEE C2 defines the loading requirements for extreme winds on structures exceeding 18 meters (60 feet) above ground or water level, including OHGW's, towers, and poles. Criteria in IEEE C2 shall be used in the design of all affected OHGW systems, applying a 25 percent gust factor for hurricane force winds.

5.2.5 Faraday Cage Systems

The overhead grids for these systems differ from OHGW systems in that the suspended grid is an electrically continuous unit with multiple paths of conduction to ground, whereas an overhead

cable usually has but two ground connections. All grid intersections are rigidly connected to make the grid a uni-stable unit that is more resistant to wind-caused sag than single-span catenary cables. The grounded conducting masts and the air terminals are arranged, insofar as possible, to result in symmetrical current flow in the grid, down conductors, and counterpoise grid. For personnel protection, a clearance of at least 2 meters (6 feet) shall be maintained between the mast down conductors and the protected area. Since potential differences may be introduced into the cage by conductors entering from outside, measures shall be taken as necessary to ensure equal potentials at the cage entry point.

5.2.6 Towers Located Near Structures

Towers supporting antennas and other sensors are often located near structures containing equipment and systems connected to the antennas and sensors mounted on the tower. When the towers are struck by lightning, part of the current is conducted inside the structure to the equipment via the connecting cables. To prevent damage and sparking inside the structure, the tower must be well grounded by at least two 6-meter (20-foot) ground rods. All cables from the tower to the structure shall have an overall shield of at least 85 percent optical coverage or be enclosed in a covered metal cable tray. The cable shields or covered tray shall be connected, using 360-degree coverage, to an external grounded metal plate or box. For structures with grounded external metal siding, the plate or box shall be connected to the external siding of the structure with 360-degree coverage. For other structures, the interface plate or box must be well grounded by connection to the building counterpoise and to at least one 6-meter (20-foot) ground rod at the interface. Refer to MIL-STD-188-124 for further information and illustrations.

Where power cables are routed between towers and adjacent structures, suitably rated lightning arresters and/or TVSS devices shall be applied for protection.

5.2.7 Material Corrosion-Resistance, Compatibility, and Suitability

Cables and hardware selected for OHGW/grid wire systems shall be of materials that are noncorrosive for conditions at the site, galvanically compatible, and sized to carry the lightning current dictated by operational lightning protection requirements. Recommended cables are listed in appendix B.

5.2.8 Railroads

Loading and unloading operations from ungrounded tank cars are not permitted at KSC facilities. Railroad tracks in hazardous areas, fuel transfer locations, or flight hardware transfer locations, shall be grounded for lightning protection as shown in figures 9 and 10. This requirement also applies to service carts and flame-deflector tracks. Rail road tracks located within 15 meters (50 feet) of a building shall be bonded to the facility counterpoise system as shown in figure 9.

KSC-STD-E-0012F
January 10, 2013



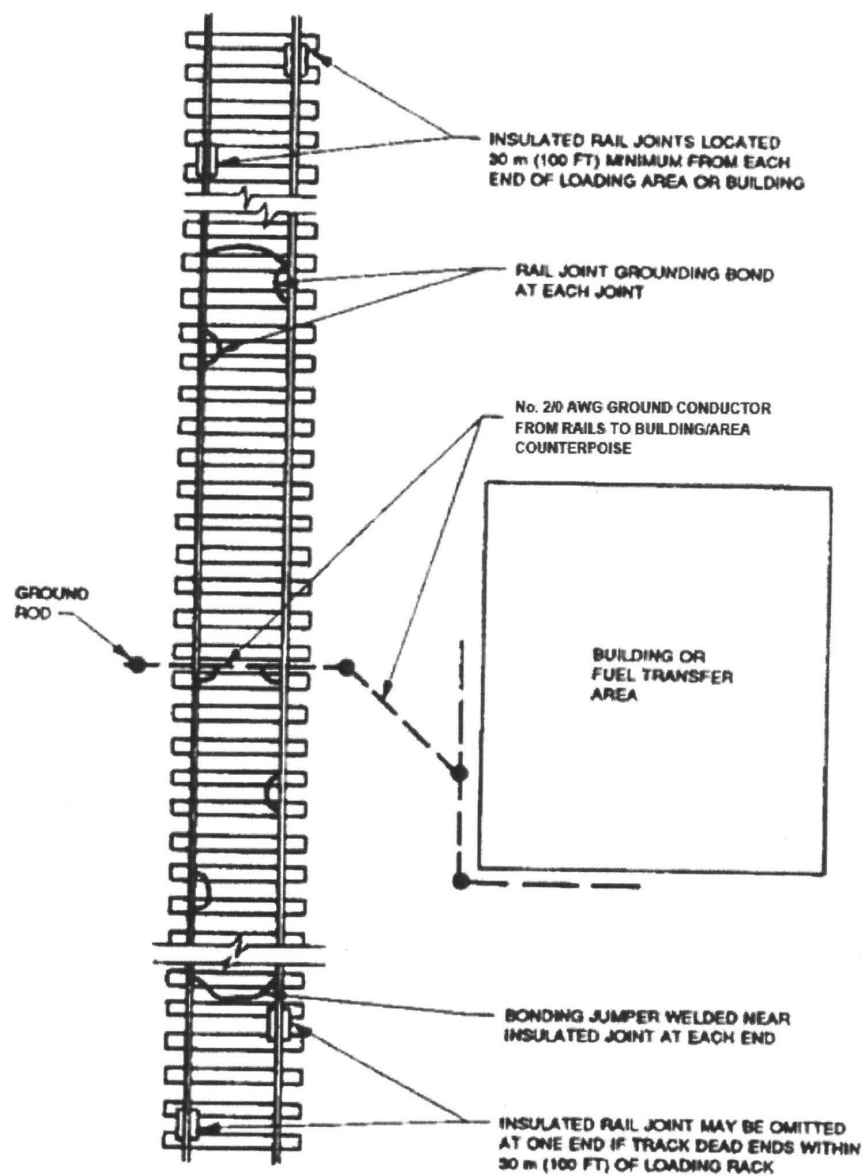


Figure 9. Lightning Protection Requirements for Railroad Tracks in Fuel Areas or Adjacent to Buildings

KSC-STD-E-0012F
January 10, 2013

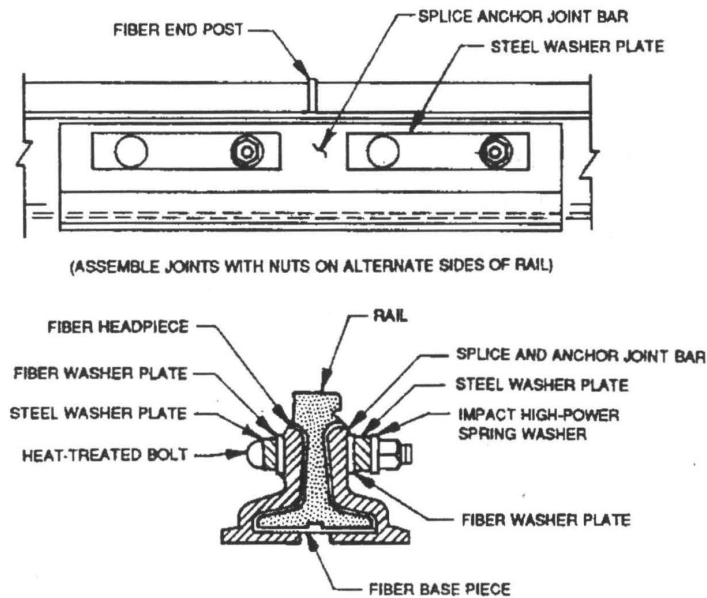

5(a) SIDE AND SECTION VIEWS OF A TYPICAL INSULATED JOINT

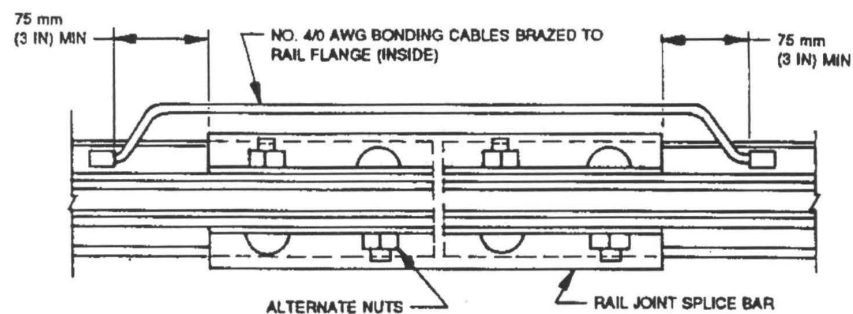

5(b) TOP VIEW OF A TYPICAL BONDED RAIL JOINT [USED WITHIN 15 m (50 FT) OF STRUCTURE]

Figure 10. Railroad Track Details for Lightning Protection

5.2.9 Pad-Mounted Transformers, Underground Cables, and Unit Substations/Switching Stations

5.2.9.1 Pad-Mounted Power Transformers

Power transformer insulation shall be protected from the voltage surge of the traveling wave coming in on the lines. This protection shall be accomplished by means of lightning arresters located as close as possible to the equipment to be protected on each primary bushing. An arres-

KSC-STD-E-0012F

January 10, 2013

ter shall be chosen whose discharge voltage is lower than the basic impulse level (BIL) rating of the transformer insulation. Metal oxide varistor (MOV) arresters shall be selected in accordance with IEEE C62.22, for the proposed operating voltages.

5.2.9.2 Underground Cables

Underground feeder cables radiating from a substation bus shall have lightning arresters installed to protect the cable. The arresters shall be connected directly to open terminals of the cable pot-head. Station class MOV arresters shall be selected in accordance with IEEE C62.22 for the proposed operating voltages. Cable splices shall be grounded in manholes and handholes.

5.2.9.3 Medium Voltage Switching Stations

Medium voltage switching substations are defined as a line-up of 5kV or 15kV class metal-clad switchgear or motor control center (MCC) installed within a facility or outdoors in a weather-proof enclosure. Switching stations shall incorporate surge protection using lightning arresters located in the incoming (and outgoing if required) cable termination compartments. An arrester shall be chosen whose discharge voltage is lower than the basic impulse level (BIL) rating of the transformer insulation. MOV arresters shall be selected in accordance with IEEE C62.22, for the proposed operating voltages. The concentric neutral shields and other supplying source ground conductors shall be directly connected the equipment ground pads, metal conduits enclosing the conductors, and all other local earth ground systems associated with the equipment.

5.2.10 Aboveground Cable Trays


All aboveground cable trays lightning protection systems shall adhere to the requirements of NFPA 780. Cable tray lightning protection systems shall be as depicted in figure 11. Specifically:

- a. An overhead ground wire (minimum 2/0 AWG bare copper wire) shall be run parallel to the cable tray supported by metallic support posts with as minimum sag as possible. The overhead ground wire shall be electrically bonded to the metallic support post at each post.
- b. The metal support posts shall be insulated from the tray support posts by air or post insulators. The metallic support posts shall be installed so they align with the cable tray support posts.
- c. Each tray support post shall have a ground rod installed next to it. The metallic support post and the cable tray bonding cable shall be electrically bonded at ground level where the grounding rod is located; the No. 2 AWG (minimum) copper conductors, running down to the ground rod, shall be insulated and protected with suitable cable guards to prevent physical damage or displacement.
- d. A counterpoise shall run parallel to the cable tray and be electrically connected to each grounding rod. The counterpoise shall extend for the length of the cable tray and shall be electrically bonded to the facility lightning protection counterpoise systems at each end.

KSC-STD-E-0012F
January 10, 2013

- e. Cable tray sections shall be electrically bonded by exothermic welded bonding wires to ensure electrical continuity. Cable tray metallic covers shall be electrically bonded to the cable tray.

The distances between metallic supporting poles and overhead ground wire shall be as per NFPA 780. In cases where the supporting poles exceed 10 meters in height the rolling sphere method shall be used and main size conductors shall be dimensioned as per NFPA 780. The height of the supporting metallic poles and overhead ground wire shall be such that the cable tray lays in its entirety underneath the area of protection.

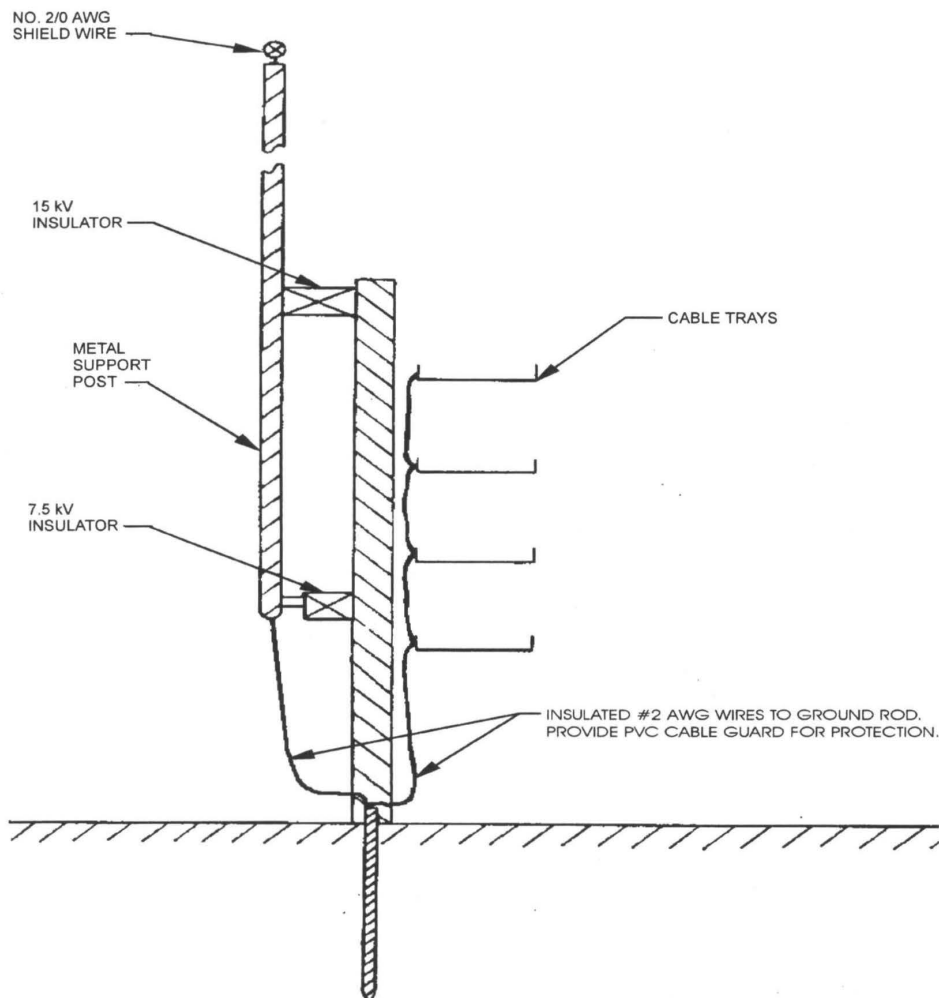

**Figure 11. Lightning Protection for Cross-Country Cable Trays
(60-Hertz, 15-KV Rating)**

KSC-STD-E-0012F

January 10, 2013

5.2.11 Overhead Distribution Lines

Overhead distribution lines (open wire or aerial cable) may consist of either high-voltage primary or low-voltage secondary circuits, or both. These circuits are normally carried on wood or concrete poles and shall be protected against direct lightning strokes with an overhead ground static wire mounted on insulators above the conductors and lightning arresters connected to protect pole-mounted equipment. The height of the static wire above the phase conductors shall be adequate to provide a zone of protection as per NFPA 780 requirements (See figure 13). The design of overhead distribution lines shall apply the methods of IEEE 1410. In addition the following requirement shall apply:

- a. The static wire shall be bonded to the underground supplying circuit concentric neutral and duct bank ground using jumpers equal in size to the static wire. The metallic conduit enclosing the underground conductors shall also be bonded to this ground.
- b. All pole line insulators and hardware shall be rated for ocean salt spray. Hardware shall be inorganic zinc coated as a minimum and insulators shall be rated 35 kV minimum. All insulators and hardware shall be designed specifically for pole-line use.
- c. Minimum neutral/static wire size shall be #1/0 AAAC; ASCR conductor is not acceptable.
- d. Ground rods shall be installed to obtain 25 Ohms resistance at each pole and shall be connected to the overhead grounded static wire. Minimum bonding wire size shall be No. 6 Copper. All metallic bodies on the pole including, primary attachment hardware, lighting, concrete pole internal ground shall be bonded to the pole ground.
- e. Pole distribution transformers shall be line to line connected only. Transformer secondary neutral shall be connected directly to both the system neutral and pole ground.
- f. Surge arresters shall be installed on all phases and spaced approximately every 400-feet or every other pole based on design arrangement. Surge arresters shall also be installed:
 - i. At all dead-end poles.
 - ii. At all poles with underground riser connections.
 - iii. At all poles with mounted equipment such as transformers.

5.2.12 Exposed Communications and Instrumentation Equipment

5.2.12.1 Exposed Equipment

Exposed communications and instrument equipment and terminal facilities shall be protected against direct lightning strokes. The methods employed may consist of overhead shield wire, grounded masts, or lightning systems placed on adjacent structures. Pole-mounted circuits shall be protected by overhead shield wires.

KSC-STD-E-0012F
January 10, 2013

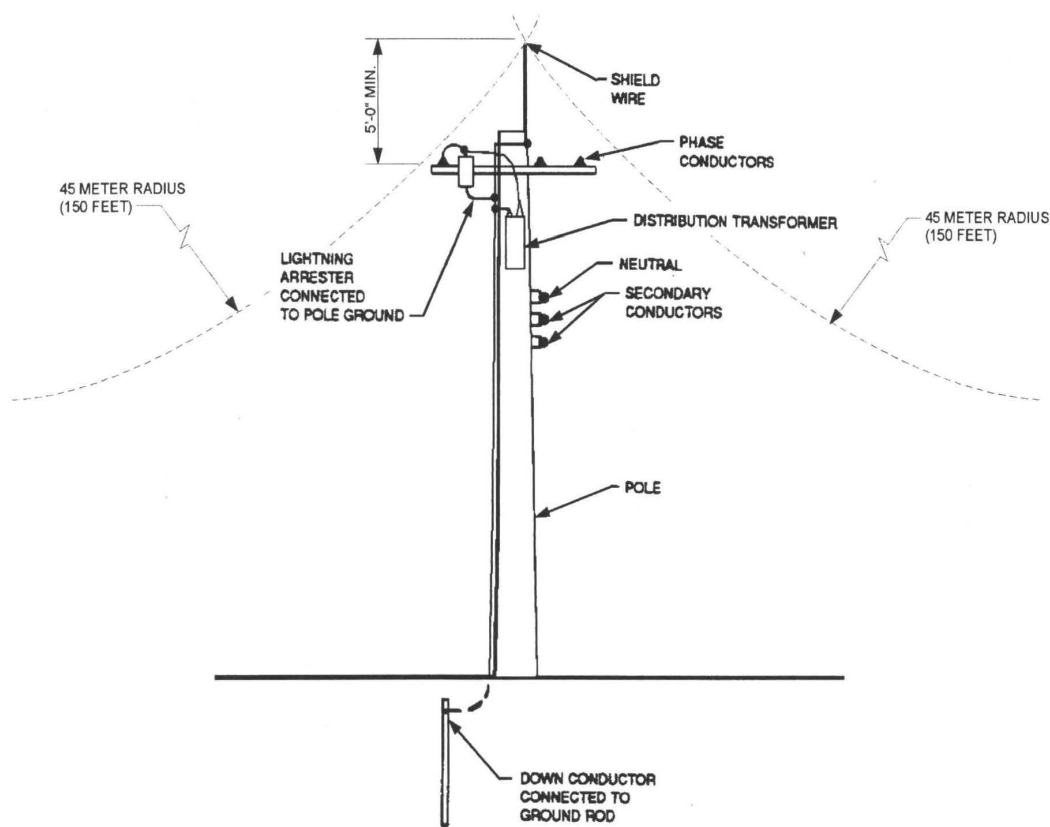


Figure 12. Shield Wire and Lightning Arrester Typical Installation

5.2.12.2 Lightning Surge Protection

Communication and instrumentation cables, equipment, facilities, and operators shall be provided with protection against induced high-voltage surges. This protection shall be afforded through the judicious use and application of lightning arresters, spark gaps, and shielding and grounding techniques. Any critical facility electronic equipment that has interconnecting cables, power, or data that extend outside the facility lightning protection system shall be protected by surge suppression devices, as discussed in section 5.3.5; where possible, fiber-optic-based cable systems, with nonconductive cable sheaths, should be considered for use.

5.2.13 Underground Duct Banks

Designs for communication, instrumentation, and power cable duct banks shall include the following features (see figure 13):

- a. A buried No. 2/0 AWG bare copper counterpoise whose spacing above the duct bank is not less than 250 millimeters (10 inches). Duct banks less than 1 meter (36 inches) wide require only one counterpoise wire. Duct banks wider than 1 meter (36 inches) require two counterpoise wires.

KSC-STD-E-0012F

January 10, 2013

- b. The subterranean configuration of the counterpoise cables to the duct bank tubes shall be maintained when the items are exposed above ground, such as at ditch crossings.
- c. The counterpoise shall be connected to ground rods driven at intervals not to exceed 30 meters (100 feet) and at manholes.
- d. New counterpoise systems shall be bonded to existing adjacent counterpoise systems.

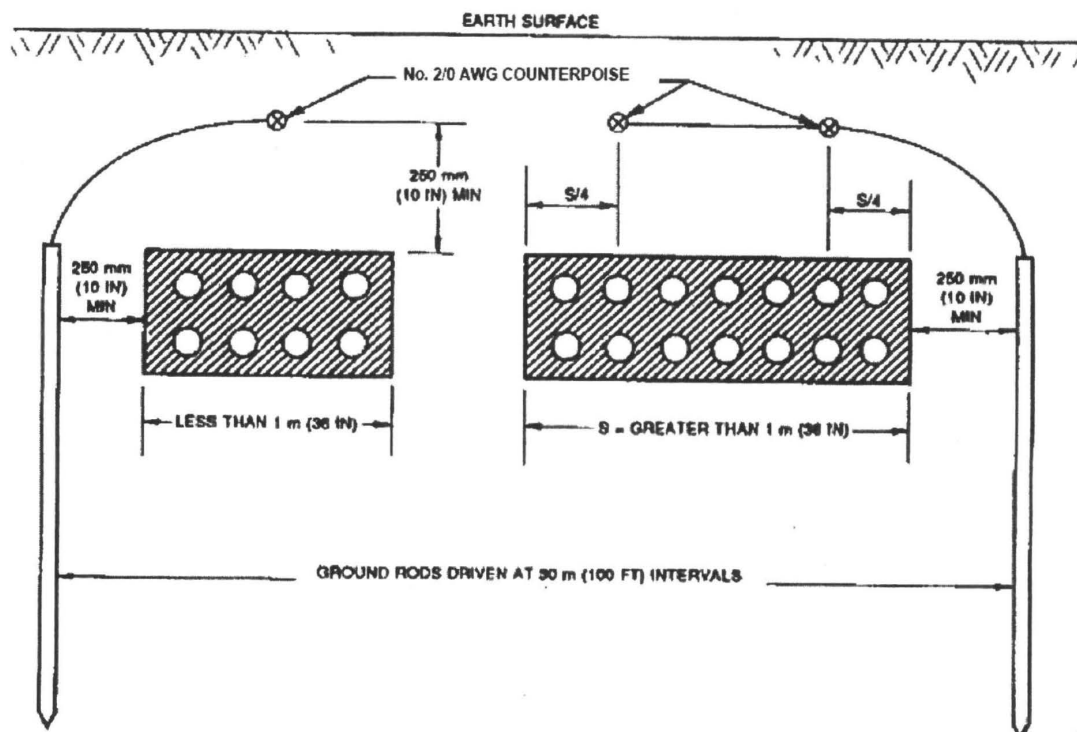


Figure 13. Lightning Protection for Underground Duct Banks

5.2.14 Guard Shacks

All guard shacks shall be provided with a lightning protection system. Since methods of construction are not uniform, lightning protection requirements for guard shacks must be tailored to each installation. Some guard shacks are all metal and can be made to qualify as Faraday cages; others are made of wood, requiring roof and ground counterpoises, down conductors, and air terminals. The following design guidelines shall be considered.

- a. Wood shacks shall utilize a roof and ground counterpoise system with down conductors and air terminals designed in accordance with NFPA 780.
- b. Communications antennas should not be located on roofs or poles without adequate consideration of lightning protection.

- c. Light poles located near guard shacks must be made part of the lightning protection system.
- d. Since guards cannot always stay inside the shacks, it is necessary to extend the guarded counterpoise to include the personnel standing areas in order to prevent high voltage from developing between their feet (step voltages).

Even with good protection, the telephone and power cables feeding a shack can violate the protective system at the entrance to the shack on the outside. Protective devices, such as metal oxide varistors and transorbs, may be required when the shielding is not adequate.

5.2.15 Guard Gates

Guard gate lightning protection systems shall be designed in accordance with NFPA 780 and ground systems in accordance with NFPA 780 and NFPA 70. The design shall specifically indicate how all lightning protection, facility grounds, system grounds, and metallic bodies are bonded together; provide additional connection points for future equipment. In addition, the following design guidelines shall be considered:

- a. Lightning mast poles and lighting poles shall be utilized as part of the lightning protection system to help divert any lightning from directly striking guard house structures.
- b. Provide a ground grid design to minimize step potentials.
- c. Provide surge suppression for all conductors entering or exiting the lightning protected area. Antennas and connecting conductors must be designed with full lightning and surge protection.
- d. Provide for the necessary accessible test points and test electrodes.
- e. Where designs are intended to provide personnel operating outside of a structure protection during lightning events, systems shall be designed for both code compliance and risk acceptability as follows:
 - i. Personnel protection shall be the design imperative for air terminal and ground grid design. The lightning protection and grounding system shall be designed to provide an acceptable human exposure risk level as deemed appropriate by NASA Institutional Safety for the assessment of human exposure risk provided by the canopy structure. The lightning risk assessment of the design shall be in accordance with IEC 63205-2, Protection against Lightning Part 2.
 - ii. In order to provide the appropriate level of risk analysis during the design phase, designs shall provide shop drawing level detail of the lightning protection and grounding system installation.

KSC-STD-E-0012F
January 10, 2013

5.2.16 Resistance Values

Resistance values for all lightning protection system connections and components shall meet the requirements of section 5.1.22.

5.3 Transient Voltage Surge Suppression (TVSS)

5.3.1 General

Designs for all buildings and structures at KSC and CCAFS shall include transient voltage surge suppression (TVSS) on all main facility service entrance equipment, AC panels or switchboards, AC subpanels and on all branch circuits supplying: telecommunication room loads, data processing room loads, critical or sensitive loads. In addition, any panel supplying exterior circuits (light poles, lift stations, etc) and any distribution panel supplied by an exterior circuit shall be equipped with surge suppression. TVSS devices, bonding and grounding shall be required on all electrical and electronic systems located outside the confines of a protected building. In general, all TVSS devices specified shall be manufactured, tested, and listed in accordance with UL 1449 and applied in accordance with IEEE C62.41 for high exposure locations. Designs shall indicate the locations of all surge suppression devices and incorporate specific provision for connection and over-current protection. Surge suppressors connected to power equipment shall be indicated on the one-line diagrams and panel schedules.

5.3.2 Purpose

This paragraph provides recommended criteria for the selection of transient voltage surge suppressors for the protection of all ac electrical circuits from the effects of lightning-induced currents, substation switching transients, and internally generated transients resulting from inductive and/or capacitive load switching. (Note that the application of TVSS protection, as described in this section, is based on the requirement that TVSS devices be applied on indicated ac supply panels in a coordinated manner starting with the main service entrance ac panel or switchboard, then to the lower voltage distribution or subpanels, and finally to specific electric or electronic equipment to be protected.)

5.3.3 TVSS Protection Requirements for Main (Service Entrance) Panels

The TVSS shall be parallel connected and designed, rated, selected, and permanently connected for main entrance panel (service entrance) protection, based on the entrance panel current and voltage ratings. The service entrance TVSS is to be tested in accordance with IEEE C62.45 and rated for application High Exposure Location, Category C3, as defined in IEEE C62.41. Suppressors specified shall be listed and labeled in accordance with UL 1449 and approved for the location in which they are to be installed. For 3-phase, 4-wire Wye configurations, suppressors, as a minimum, shall provide suppression elements between each line and neutral (L-N), each line and ground (L-G), and neutral and ground (N-G) for a minimum of seven modes of protection. For Delta-configured systems, the device must have suppression elements connected L-L and L-G, providing a total of six modes of protection. The suppressor manufacturer shall provide certified test data confirming a fail short failure mode. The suppressor should contain replaceable internal fuses that operate to isolate the TVSS protective elements under conditions of an internal short circuit. Visible indication of proper suppressor connection and operation shall be provided.

Indicators shall be provided to indicate that power has been interrupted or that protection has been reduced or lost for the specified phase/phases protected. If required for the application, the TVSS shall be selected to be furnished with dry output contacts or an audible alarm for remote monitoring of the protection status. Suppressors may be mounted internal or external to the service entrance panel being protected. The mounting position of the suppressor shall permit a straight and short lead length connection between the suppressor and the point of connection to the panel board. The interconnecting leads between the suppressor and the point of connection to the bus shall be kept as short as possible [0.5m (20 in) or less] to minimize let-thru voltage and shall be twisted to minimize lead reactances. Bends should be avoided if possible.

Suppressors shall meet or exceed the following criteria.

- a. Maximum single impulse current rating: 100,000 amperes per mode [8X20/microsecond (μ s) current waveform].
- b. Pulse life rating (IEEE C62.41, table 4, Category C3 transient): 1,000 occurrences minimum/mode, based on the highest voltage mode of the device (20kV/10kA – 8x20 μ s/1.2x50 μ s waveform).
- c. Suppressors shall be designed to withstand a maximum continuous operating voltage (MCOV) of not less than 115 percent of nominal root mean square (RMS) voltage.
- d. Suppressors shall be of solid-state componentry and operate bi-directionally. “Crowbar-type” devices are not allowed.

5.3.4 TVSS Protection Requirements for Distribution Subpanels

The TVSS device shall be parallel connected and shall be designed, rated, and permanently connected for distribution panel/subpanel protection, based on the distribution panel current and voltage ratings. The ac distribution subpanel TVSS shall be tested in accordance with IEEE C62.45 and rated for application in “Medium Exposure Level” (Category B3), as defined in IEEE C62.41. Suppressors shall be listed and labeled in accordance with UL 1449 and approved for the location in which they are to be installed. For 3-phase, 4-wire Wye configurations, suppressors as a minimum, shall provide suppression elements between each L-N, each L-G, and N-G for a minimum of seven modes of protection. For Delta configured systems, the device must have suppression elements connected L-L and L-G, providing a total of six modes of protection. Subpanel protection shall be applied on the secondary side of low-voltage transformers and subpanels serving sensitive loads. System design shall protect sensitive electronic devices against the effects of surges and transients. Effective EMI/RFI noise filtering should be provided separately at sensitive equipment locations. Suppressor manufacturer shall provide certified test data confirming a fail short failure mode. The suppressor should contain replaceable internal fuses that operate to isolate the TVSS protective elements under conditions of an internal short circuit. Visible indication of proper suppressor connection and operation shall be provided. Indicators shall be provided to indicate that power was interrupted or that protection was reduced or lost for the specified phase/phases protected. If required for the application, the TVSS device shall be furnished with dry output contacts or an audible alarm for remote monitoring of the protection status. Suppressors may be mounted internal or external to the distribution panel being pro-

KSC-STD-E-0012F
January 10, 2013

tected. The mounting position of the suppressor shall permit a straight and short lead length connection between the suppressor and the point of connection to the panel board. The interconnecting leads between the suppressor and the point of connection to the bus shall be kept as short as possible [0.5m (20 in) or less] to minimize let-thru voltage and shall be twisted to minimize lead reactances. Bends should be avoided if possible.

Suppressors shall meet or exceed the following criteria.

- a. Maximum single impulse current rating: 50,000 amperes per mode (8X20 μ s current waveform).
- b. Pulse life rating (IEEE C62.41, table 4, Category B3 transient): 1,000 occurrences minimum per mode, based on the highest voltage mode of the device (6kV/3kA – 8x10 μ s/1.2x50 μ s waveform).
- c. Suppression voltage ratings (SVR): The maximum UL 1449 SVR for the device should not exceed the ratings listed in table 3.

Suppressors shall be designed to withstand an MCOV of not less than 115 percent of nominal RMS voltage. Suppressors shall be of solid state componentry and operate bi-directionally. “Crow-type” devices are not allowed.

5.3.5 TVSS Protection Low-Voltage Signal Equipment

This paragraph provides recommended criteria for the selection of TVSS for the protection of electronic equipment low-voltage signal conductors. System design shall protect sensitive electronic devices against the effects of surges, transients, and electrical line noise. Note that the intent of the section is to only make general recommendations with respect to TVSS selection for sensitive equipment applications. The protection system designer shall set more specific criteria based on knowledge of the specific requirements of the equipment to be protected. General protection requirements for all systems such as telecommunication systems, temperature control panels, security systems, TV antenna distribution systems, fire alarm systems, sound distribution systems, paging systems, intrusion detection and alarm systems, energy management systems, scoreboards, control systems, surveillance TV systems, and all other systems that communicate by wire are covered by this paragraph.

The system parameters of the electronic system requiring protection shall be reviewed by the surge suppression system designer for the proper selection of TVSS components. The system parameters to be considered in the design shall include but are not be limited to:

- a. Conductor size.
- b. Maximum conductor length.
- c. Signal speed of transmission and signal type.
- d. Peak-to-peak voltages with relation to ground.
- e. Shielding requirements, if any, of the cable at both ends of the equipment.

- f. Expected EMI/RFI exposure of sensitive electronic equipment. External filtering components should be considered for use at the equipment location where required to minimize noise from known external sources. Filters should also be considered for application at the source of the noise or RF interference.
- g. Maximum operating voltage and maximum operating current.

Electronic system equipment low-voltage signal conductors are exempt from required protection provided all of the following conditions are met:

- a. The electronic equipment within a single facility has the same ground potential as all other electronic equipment within that facility. This is accomplished by dealing with the equipment as groups or clusters not exceeding a radius of approximately 9 meters (30 feet).
- b. Signal conductors extending 7.5 meters (25 feet) beyond the cluster within the facility shall be enclosed within ferrous metal conduit.
- c. No wiring within the raceways containing signal conductors shall extend beyond the confines of the building. Any critical facility electronic equipment that has interconnecting cables, power, or data that extend outside the facility lightning protection system shall be protected by surge suppression devices selected for the signal voltage levels and cable types involved.
- d. No ac power conductors shall be installed in common conduits or raceways containing low-voltage signal conductors.

The performance of TVSS devices for the low-voltage signal conductors shall meet or exceed the following criteria.

- a. Suppressors shall have a response time of less than 5 nanoseconds.
- b. Suppressors selected for equipment protection shall be of a multistage design utilizing solid-state componentry and shall operate bi-directionally.
- c. The suppressor manufacturer shall provide certified test data confirming a fail short failure mode.
- d. The suppressor shall be housed in an enclosure that is compatible with the system being protected.
- e. Where required, low-voltage signal conductors with maximum operating voltages between 6 and 48 volts should be protected with TVSS devices that clamp at a voltage no greater than 150 percent of the maximum operating voltage. For signal conductors operating at a maximum voltage above 48 volts, the TVSS should provide protection to limit the voltage to a maximum of 135 percent of the maximum operating voltage. Signal conductors with maximum operating voltages of 5 volts or less should provide voltage clamping at a maximum of 8 volts.

KSC-STD-E-0012F
January 10, 2013

6. QUALITY ASSURANCE PROVISIONS

6.1 New Installations and Modifications to Existing Installations

Designers preparing designs for new installations or modifications to existing installations shall ensure that grounding, bonding, lightning protection, and transient voltage surge suppression systems conform to all applicable requirements of this standard.

6.2 Existing Installations

Responsible operating and maintenance organizations are required to implement adequate testing and inspection programs to ensure the facilities and equipment under their responsibility conform to the applicable requirements of this standard.

6.3 Acceptance Tests

The following test shall be performed by the contractor for all new installations and modifications to existing installations. The Government reserves the right to witness the test performed by the contractor and to perform these test and any additional tests deemed appropriate.

6.3.1 Ground Rod Resistance Tests

All newly installed ground rods shall be individually tested prior to interconnection with other ground rods, and the rod-to-earth resistance for each rod shall be recorded.

6.3.2 Continuity Tests

Continuity tests shall be performed on all power receptacles to ensure the ground terminals are properly grounded to the facility ground network.

6.3.3 Visual and Mechanical Checks

The contractor shall inspect all connections, conductors, arresters, and air terminals for looseness or damage. Damaged items shall be replaced by the contractor.

6.3.4 Additional Tests

The design agency shall specify any additional tests that may be required to verify conformance with the design. The resistance values given in section 5.1.22 shall be used as a guide in determining additional tests that may be required as well as the usage and general configuration of the facility.

6.3.5 Testing Procedures

6.3.5.1 Ground-Rod-to-Earth Resistance

The resistance between a ground rod and earth shall be determined by the fall-of-potential test method as described in IEEE Std 81.

KSC-STD-E-0012F
January 10, 2013

6.3.5.2 Counterpoise-to-Earth Resistance

The resistance between a counterpoise and earth shall be determined by the fall-to-potential method as described in IEEE Std 81.

6.3.6 Inspection Methods

Verification of bond and ground connection acceptability shall include the following:

- a. Inspection of connections and conductors for looseness or damage
- b. Replace, repair, or tighten conductors or connections that are mechanically damaged, or loose
- c. Inspect air terminals and lightning arresters for visible defects
- d. Inspect, repair, or replace equipment surge protection devices found to be defective.

NOTICE. The Government drawings, specifications, and/or data are prepared for the official use by, or on behalf of, the United States Government. The Government neither warrants these Government drawings, specifications, or other data, nor assumes any responsibility or obligation, for their use for purposes other than the Government project for which they were prepared and/or provided by the Government, or any activity directly related thereto. The fact that the Government may have formulated, furnished, or in any way supplied the said drawings, specifications, or other data is not to be regarded, by implication or otherwise, as licensing in any manner the holder or any other person or corporation nor conveying the right or permission to manufacture, use, or sell any patented invention that may relate thereto.

Custodian:

NASA – John F. Kennedy Space Center
Kennedy Space Center, Florida 32899

Preparing Activity:

John F. Kennedy Space Center
Center Operations Directorate
Construction of Facilities Mechanical/Electrical
Project Branch

KSC-STD-E-0012F
January 10, 2013

APPENDIX A. BONDING AND GROUNDING OBJECTIVES

A.1 Applicability

Bonding and grounding of conductive materials may be required for any of the following reasons:

- a. To provide a low-impedance path to earth for electrical currents resulting from lightning discharges or electrical power system faults in order to minimize abnormal voltage rises that might injure personnel or damage equipment.
- b. To provide a discharge path between metal objects and earth to prevent the buildup of static electricity.
- c. To eliminate electrically nonlinear junctions between conducting surfaces in order to prevent RF noise generation by nonlinear mixing and harmonic generation when the junctions are subjected to RF illumination.
- d. To incorporate structural metals into an electrically continuous mass that will afford electromagnetic shielding.
- e. To provide a conductive equi-potential surface to serve as a zero signal reference plane for electrical/electronic systems or subsystems.

A.2 Design Considerations

Various factors to be considered in designing bonding and grounding schemes are presented in the following subsections.

A.2.1 Lightning Protection

For effective protection of structures and personnel and equipment housed therein from harmful effects from lightning, any part of a structure or air terminal arrays sheltering a structure that may sustain lightning strikes should be electrically connected to earth through a low-impedance path. On nonmetallic structures, air terminals are provided to intercept any lightning strokes to the structure and these air terminals must be solidly connected to an earth grounding counterpoise through down conductors in order to dissipate lightning discharge currents. Massive metal structures capable of sustaining direct lightning strokes without damage generally are not provided with additional lightning protection, and the structure itself serves as the path to the earth grounding counterpoise for lightning discharge currents. Since such currents can reach several hundred thousand amperes, the electrical impedance of the structure must be extremely low to prevent dangerous differences in electrical potential from developing between different paths of the structure. A low-impedance path through the structure is attained by bonding all structural members together and bonding the structure to an earth grounding counterpoise. This practice also serves to minimize potential rises in any part of the structure due to electrostatic or magnetic induction effects from discharge currents in the structure. A decision of whether a structure is exposed to lightning and thereby requires bonding and grounding for that reason must be made by consideration of the requirements and provisions section 5.1 of this standard.

A.2.2 Power System Fault Protection

Electrical systems design practices and requirements set forth in this standard dictate that the neutral conductor of all ac power distribution systems be grounded at some point. Therefore, contact between a phase conductor and any conductive object or person will raise the potential of that object or person to phase voltage with respect to any grounded structure. The resulting hazard can be minimized by bonding all wiring system enclosures to ground to provide a fault current return path of sufficiently low impedance that potential rise in the contacted structure is limited, and extremely rapid operation of the circuit protective device is obtained. In order to avoid the flow of currents in a facility ground network that can produce EMI problems, arcing hazards, or differences in potential between metal objects, the power system within a facility or building should be grounded at one point only.

A.2.3 Static Grounding

The generation, accumulation, and effects of static electricity are rather complex processes, and ANSI/NFPA 77 should be consulted for a detailed treatment of the subject. The process, insofar as this standard is concerned, consists of electric charge displacement between ungrounded metal objects and their environment (including earth) so that a difference of electrical potential is developed due to the accumulation of electric charge on the ungrounded objects. This buildup in potential difference produces the possibility of arcing, which may constitute a safety hazard if the charged objects are located in an environment containing highly flammable or explosive materials. It must be assumed that some of many processes that produce electric charge displacement are present in practically all areas. Therefore, bonding and grounding practices for minimizing static electricity shall be followed in all areas of KSC where highly flammable or explosive materials may be located. The dimensional limitations specified elsewhere in this standard are based on the relationships between minimum ignition energies of hydrocarbon gaseous mixtures and ungrounded structure sizes given in ANSI/NFPA 77 and are considered adequate to minimize hazards from static arcing.

A.2.4 Nonlinear Junction RFI

Uncoated junctions between metal surfaces rapidly develop oxide films over the mating surfaces, particularly in exterior locations. Such junctions have the characteristics of electrical diodes; that is, the conductivity across the junction is nonlinear and is partially unidirectional. This condition can, under certain conditions, produce radiated RFI in either or both of the following ways:

- a. When illuminated by two or more RF fields, the junction acts as a diode mixer, heterodyning the induced currents across the junction to produce beat (sum and difference) frequency currents. These currents produce electromagnetic fields that are radiated along with the reradiated incident fields.
- b. The nonlinear nature of the junction distorts any currents through it, producing harmonic currents with resultant radiated fields at harmonic frequencies.

Spurious RF fields generated in this manner would have very low field strength but could theoretically constitute a source of RFI to sensitive electronic equipment, such as receiving antennas, in the immediate vicinity of the source junctions. In a case where the field strength of a desired

KSC-STD-E-0012F

January 10, 2013

signal to a receiving antenna is small compared to other ambient RF fields, spurious fields generated by nonlinear junctions located within the receiving pattern of the antenna could theoretically be of sufficient strength to interfere with the desired signal. The possibility of such interference could be eliminated by providing low-impedance bonds across all metallic junctions within the field patterns of receiving antennas. These bonds provide a linear shunt around the nonlinear junctions and suppress the noise-generating mechanisms but, in order to be effective, must be installed at intervals not exceeding 150 millimeters (6 inches). In order for significant noise generation by nonlinear junctions to occur, the dimensions of the metal objects comprising the junctions must be an appreciable fraction (one-tenth or greater) of the wavelength of the frequency of the RF fields incident on the junctions. Also, the re-radiation efficiency of these junctions decreases with increasing frequency and is negligible above the middle ultrahigh frequency (UHF) range. This phenomenon has not been found to be a problem at KSC and, due to the high cost of guarding against it, is not considered in the requirements of this standard.

A.2.5 Structural Shielding

Enclosed metal and reinforced concrete structures will provide effective electromagnetic shielding between interior and exterior if all peripheral metal is bonded together and grounded. This practice should be followed in all structures that may contain equipment susceptible to EMI. Isolation of interior areas from the external electromagnetic environment may significantly reduce the EMI suppression measures required for the systems and equipment therein. Particular attention should be given to this consideration when establishing bonding and grounding requirements for new facilities, since bonding and grounding of peripheral metals may not be required for any other reason.

A.2.6 Instrumentation and Electronic Equipment Grounding

The physical configuration of special grounding systems for sensitive electrical/electronic systems and equipment depends on the physical and electrical characteristics of the system or equipment to be grounded. The overall design objectives of all such grounding systems are common. The objectives are:

- a. To provide a ground connection to earth in a manner that will not introduce EMI into the system or equipment
- b. To provide an equi-potential signal reference plane for the system or equipment

The design criteria given below should be followed in order to accomplish these design objectives:

- a. At low frequencies up to 300 kilohertz, there should be no conductive loops anywhere within the grounding network. Such loops will result in induced circulating currents from inductive coupling with ambient magnetic fields and consequent noise voltages.
- b. The impedance of the ground network at the highest signal frequency in the using system should be extremely small. Even though the signal circuits in the system may be single-point grounded to the ground plane, there will usually be signal currents flowing in the ground plane due to capacitive coupling between signal circuits and ground plane.

KSC-STD-E-0012F
January 10, 2013

Any voltage drop in the ground plane will appear as a noise signal in the system. This effect will be minimized by minimizing the impedance of the grounding network.

- c. Single-point grounding minimizes low-frequency noise currents up to approximately 300 kilohertz. At higher frequencies, a multipoint ground system is preferred. An equipotential plane should be established where the equipment is located. For safety, the plane must be grounded to earth through a conductor, grounded structural steel, or copper down conductors. All digital circuits are considered high-frequency signal circuits. The final selection of grounding techniques must be made by the designer familiar with the equipment in the facility or network of facilities.

KSC-STD-E-0012F
January 10, 2013

APPENDIX B. OVERHEAD GROUND WIRE CABLES

B.1 CABLES

Two types of stranded-steel cables are recommended for overhead ground wires: aluminum-clad steel (alumoweld or equivalent) and type 316 corrosion-resistant steel (CRES). The CRES cable is recommended only where a corrosive atmosphere could not be tolerated by aluminum or where an extra-high-strength cable is required.

Three sizes of each type of cable are listed in table B1; these are the minimum, average, and maximum size cables recommended for OHGW systems. The size of the cable shall be determined by the length of the span, the strength required to tension it to the desired sag and to provide the maximum windload, the interconnections made in the OHGW system, the size and number of down conductors, and the current-carrying requirements of the system. Initial cable tension shall not exceed recommendations based on the cable rated breaking strength (ultimate tensile strength), manufacturer's specified outside air temperature, and the length of the ruling space. Typically, this would be 22.8 percent of the rated breaking strength (RBS) at -1 degree Celsius (30 degrees Fahrenheit) for 10 mm (3/8 inch), 7 No. 8 AWG aluminum-clad steel cable with a 150-meter (500-foot) ruling span, and 25 percent of the RBS for a type 316 CRES cable of the same size, outside air temperature, and ruling span.

B.2 Hardware

Connectors, clamps, and air terminal point bases shall be galvanically compatible with the connected cable. Bimetal connectors or fused bimetal shim stock shall be used for interconnection of copper- and aluminum-clad cables.

B.3 Guy Wires

Guy wires shall be constructed of aluminum-clad, or galvanized, stranded steel cables. However, long-term tests in salt fog atmospheres conducted by the American Society for Testing and Materials (ASTM) prove that aluminum-clad cable will outlast galvanized cable by a factor of 3 to 1. Strain insulators shall be installed in guy wires when not used as down conductors; such insulators shall have a minimum rating of 1.8 kV [2 meters (78 inches) long] and shall be located so the center of the insulator is approximately 2 meters (6 feet) from the pole.

KSC-STD-E-0012F

Table B1. Cable Strand and Wire Data

Wire Type	Size Diameter		Stranding mm (in)	Cross-Sectional Area		Type/ Grade	Ultimate Breaking Strength		Weight			
	mm	in		mm ²	circular mil		Kilo- newton (kN)	Pound (lb)	kilo- gram (kg)/ m	m/kg	lb/ft	ft/lb
CRES	6.35	0.25	3 x 3.05 (0.12)	21.88	43,200	316	33.36	7,500	0.176	5.69	0.118	8.475
	9.614	0.3785	7 x 3.05 (0.12)	51.08	100,800	316	72.06	16,200	0.42	2.381	0.282	3.546
	12.7	0.5	7 x 4.24 (0.167)	98.92	195,223	315	134.33	30,200	0.797	1.255	0.535	1.869
Aluminum Clad Steel	7.938	0.3125	3 No. 7 AWG	31.65	62,467		38.35	8,621	0.21	4.755	0.1412	7.082
	9.614	0.3785	7 No. 8 AWG	58.57	115,586		70.86	15,930	0.39	2.565	0.2618	3.82
	12.7	0.5	19 No. 10 AWG	99.97	197,289		120.94	27,190	0.668	1.496	0.4487	2.229