

Langley Research Center

LPR 1710.11

Effective Date: October 3, 2004

Expiration Date: October 21, 2008

FIRE PROTECTION PROGRAM

National Aeronautics and Space Administration

October 3, 2004

LPR 1710.11

RESPONSIBLE OFFICE: SAFETY AND MISSION ASSURANCE OFFICE**PREFACE****P.1 PURPOSE**

This Langley Procedural Requirements (LPR) sets forth procedural requirements for the Langley Research Center (LaRC) Fire Protection Program. It defines the requirements of the Center's Fire Protection Program. This program includes the elements of management; administration; documentation; training; system facility design and construction; fire protection engineering; fire prevention; annunciation; confinement; suppression; fire department; inspection, testing, and maintenance; and quality assurance. This LPR also provides guidance for government personnel in performing their responsibilities for this program.

P.2 APPLICABILITY

This directive is applicable to all employees at LaRC.

P.3 AUTHORITY

- a. NPD 8700.1, "NASA Policy for Safety and Mission Success"
- b. NPD 8710.2, "Safety and Health Program Policy"

P.4 REFERENCES

- a. NPR 8715.3, " NASA Safety Manual"
- b. STD 8719.11, "NASA Safety Standard for Fire Protection"
- c. NPR 8820.2, "Facility Project Implementation Handbook."
- d. 29 CFR Part 1910 Subpart L, Fire Protection
- e. STD 8719.7, "Facility System Safety Manual"
- f. NFPA 101, "Life Safety Code"
- g. NFPA 70, "National Electrical Code"
- h. NFPA 1, "Fire Prevention Code"
- i. ASME A17.1, "Safety Code for Elevators"

October 3, 2004

LPR 1710.11

P.5 CANCELLATION

N/A

original signed on file

Roy D. Bridges, Jr.
Director

DISTRIBUTION:

SDL 040, SDL 043, SDL 4 1 0, SDL 41 1, and SDL 412
429/SMAO (150 copies)

TABLE OF CONTENTS

Chapter	Page
1. INTRODUCTION	1-1
1.1 FORWARD.....	1-1
1.2 GLOSSARY OF TERMS.....	1-2
2. PROGRAM MANAGEMENT.....	2-1
2.1 FIRE PROTECTION STATEMENT	2-1
2.2 FIRE PROTECTION ISSUES MANAGEMENT	2-4
2.3 FIRE PROTECTION DEVIATION AND WAVIERS	2-7
2.4 FIRE PROTECTION RULES.....	2-8
3. ADMINISTRATIVE ASPECTS/FEATURES	3-1
3.1 FIRE PROTECTION PROGRAM ANNUAL REPORT	3-1
3.2 HALON EXTINGUISHING AGENT	3-1
3.3 FIRE PROTECTION ENGINEERING SURVEY DEFICIENCY DATABASE.....	3-3
3.4 FIRE PROTECTION ENGINEERING SURVEY DEFICIENCY RANKING SYSTEM.....	3-4
3.5 FUNDING PRIORITIZATION OF FIRE PROTECTION ISSUES.....	3-7
3.6 PROCUREMENT RELATED FIRE PROTECTION ISSUES	3-10
3.7 AUTHORITY HAVING JURISDICTION	3-11
3.8 FIRE INVESTIGATION AND REPORTING.....	3-13
4. DESIGN CRITERIA.....	4-1
4.1 FIRE PROTECTION DESIGN CRITERIA	4-1
4.2 PROPERTY LOSS DESIGN CRITERIA.....	4-2
4.3 FACILITY MODIFICATIONS AFFECTING FIRE PROTECTION AND/OR LIFE SAFETY ASPECTS.....	4-4
4.4 FIRE PROTECTION DESIGN/DOCUMENT REVIEW PROCESS	4-6
5. FIRE PROTECTION EQUIPMENT AND SYSTEMS (OPERATIONS AND RELIABILITY)	5-1
5.1 FIRE PROTECTION SYSTEM IMPAIRMENTS	5-1
5.2 UTILITY IMPAIRMENTS AFFECTING FIRE PROTECTION SYSTEMS....	5-3
5.3 FIRE PROTECTION SYSTEM WINTERIZATION.....	5-4
5.4 NONEMERGENCY USE OF FIRE HYDRANTS	5-6
5.5 INSPECTION, TESTING, AND MAINTENANCE DOCUMENTATION REVIEW AND ANALYSIS.....	5-6
5.6 INSPECTION, TESTING, AND, MAINTENANCE MATRIX	5-8
6. LIFE SAFETY.....	6-1
6.1 MEANS OF EGRESS.....	6-1
6.2 FACILITY EVACUATION PLANS.....	6-2
6.3 FACILITY EMERGENCY LIGHTS	6-5
6.4 OCCUPANCY PERMIT APPROVAL	6-5

TABLE OF CONTENTS (Cont.)

Chapter	Page
7. FIRE PROTECTION.....	7-1
7.1 SMOKING REGULATIONS	7-1
7.2 FIRE LANES	7-1
7.3 HOT WORK/OPEN FLAME AND WELDING PERMIT SYSTEM	7-3
7.4 FACILITY FIRE WATCH REQUIREMENTS	7-6
7.5 HEAT-PRODUCING APPLIANCES.....	7-8
7.6 FIRE PROTECTION DURING CONSTRUCTION	7-11
7.7 STANDARD FIRE SYMBOLS FOR LARC	7-12
7.8 CONTROL OF COMBUSTIBLES	7-16
7.9 HOUSEKEEPING PRACTICES TO MINIMIZE FIRE LOSS	7-18
7.10 FIRE NOTIFICATION/FACILITY EVACUATION	7-21
7.11 EMPLOYEE FIRE PROTECTION TRAINING.....	7-24
7.12 FIRE PROTECTION IN FACILITY OPERATING PROCEDURES.....	7-24
8. FIRE HAZARD PROTECTION.....	8-1
8.1 ELECTRICAL INSTALLATION IN HAZARDOUS LOCATIONS	8-1
8.2 FLAMMABLE AND COMBUSTIBLE LIQUIDS	8-2
8.3 SAFE STORAGE AND USE OF FLAMMABLE GASES	8-4
8.4 FIRE PROTECTION FOR PORTABLE STRUCTURES	8-6
8.5 FIRE PROTECTION FOR STORAGE FACILITIES AND AREAS	8-10
8.6 FIRE PROTECTION FOR COMBUSTIBLE SOLIDS, METALS, AND DUSTS.....	8-12
8.7 FIRE PROTECTION FOR CLEAN ROOMS.....	8-14
8.8 FIRE PROTECTION FOR AIRCRAFT HANGERS.....	8-14
8.9 FIRE PROTECTION FOR FLIGHT SIMULATORS.....	8-16
8.10 FIRE PROTECTION FOR COMPUTER FACILITIES	8-18
8.11 FIRE PROTECTION FOR ANECHOIC CHAMBERS.....	8-19
8.12 FIRE PROTECTION FOR TEMPORARY ENCLOSURES AND MEMBRANE STRUCTURES	8-23
8.13 FIRE PROTECTION FOR VITAL RECORDS STORAGE.....	8-25
8.14 FIRE PROTECTION FOR OVENS, FURNACES, AND ENVIRONMENTAL CHAMBERS.....	8-26
8.15 FIRE PROTECTION FOR HEPA FILTER SYSTEMS.....	8-28
8.16 FIRE PROTECTION FOR HAZARDOUS MATERIALS STORAGE	8-29
8.17 FIRE PROTECTION FOR LABORATORY FACILITIES.....	8-30
8.18 FIRE PROTECTION FOR VACANT FACILITIES	8-32
9. ASSESSMENT AND ANALYSIS	9-1
9.1 FIRE PROTECTION ENGINEERING SURVEY PROGRAM.....	9-1
9.2 FIRE HAZARD ANALYSIS PROGRAM.....	9-2
9.3 FIRE PROTECTION PROGRAM REVIEW/SELF-ASSESSMENT	9-5

October 3, 2004

LPR 1710.11

TABLE OF CONTENTS (Cont.)

Chapter	Page
10. FIRE DEPARTMENT OPERATIONS AND EMERGENCY RESPONSE	10-1
10.1 FIRE DEPARTMENT EMERGENCY EQUIPMENT	10-1
10.2 FIRE DEPARTMENT PERSONAL PROTECTIVE EQUIPMENT.....	10-2
10.3 FIRE FIGHTING FORCES	10-3
10.4 FIRE SUPPRESSION	10-4
10.5 FIRE DEPARTMENT TRAINING	10-6
10.6 FIRE DEPARTMENT MUTUAL AID AGREEMENTS	10-8
10.7 FIRE DEPARTMENT FACILITY INSPECTIONS	10-8
10.8 EMERGENCY MEDICAL SERVICES	10-9
10.9 FIRE DEPARTMENT PREPLANS	10-9
10.10 FIRE DEPARTMENT HAZARDOUS MATERIAL RESPONSE PROGRAM.....	10-11
10.11 FIRE DEPARTMENT SALVAGE PLANS	10-11

APPENDICES

Appendix	Page
A. FORMAT FOR ANNUAL SUMMARY OF FIRE AND OTHER PROPERTY DAMAGE EXPERIENCE REPORT	A-1
B. FPE SURVEY DEFICIENCY DATABASE PRINTOUT	B-1
C. FIRE PROTECTION IMPAIRMENT	C-1

October 3, 2004

LPR 1710.11

LIST OF FIGURES**Page**

FIGURE 2.1, FUNCTIONAL/ORGANIZATIONAL STRUCTURE OF THE FIRE PROTECTION PROGRAM	2-2
FIGURE 3.1, FIRE PROTECTION RATING SCHEDULE	3-6
FIGURE 3.2, FIRE PROTECTION FUNDING PRIORITIZATION SCORING MATRIX	3-10
FIGURE 6.1, SAMPLE FACILITY EVACUATION PLAN	6-4
FIGURE 7.1, APPROVED FIRE LANE TURN AROUNDS	7-3
FIGURE 7.2, OUTSIDE FIRE PROTECTION EQUIPMENT SIGNAGE	7-15

LIST OF TABLES

	Page
TABLE 5.1, INSPECTING, TESTING, AND MAINTAINING: FIRE DOORS AND DAMPERS.....	5-9
TABLE 5.2, INSPECTING, TESTING, AND MAINTAINING: VALVES AND FIRE DEPARTMENT CONNECTIONS	5-10
TABLE 5.3, INSPECTING, TESTING, AND MAINTAINING: DELUGE/WATER SPRAY FIXED SYSTEMS.....	5-11
TABLE 5.4, INSPECTING, TESTING, AND MAINTAINING: CARBON DIOXIDE SUPPRESSION SYSTEMS.....	5-12
TABLE 5.5, INSPECTING, TESTING, AND MAINTAINING: PORTABLE FIRE EXTINGUISHERS	5-12
TABLE 5.6, INSPECTING, TESTING, AND MAINTAINING: FIRE PUMPS.....	5-13
TABLE 5.7, INSPECTING, TESTING, AND MAINTAINING: PRIVATE FIRE SERVICE MAINS	5-13
TABLE 5.8, INSPECTING, TESTING, AND MAINTAINING: STANDPIPE AND HOSE SYSTEMS	5-14
TABLE 5.9, INSPECTING, TESTING, AND MAINTAINING: FACILITY EMERGENCY LIGHTS	5-14
TABLE 5.10, INSPECTING, TESTING, AND MAINTAINING: WATER STORAGE TANKS	5-15
TABLE 5.11, INSPECTING, TESTING, AND MAINTAINING: FIRE ALARM AND DETECTION SYSTEMS.....	5-16
TABLE 7.1, DEGREES OF HAZARDS.....	7-14
TABLE 8.1, SPRINKLERS FOR ANECHOIC CHAMBERS	8-21

CHAPTER 1**1. INTRODUCTION****1.1 FORWARD**

Langley Research Center (LaRC) management is committed to strive for excellence in the conduct of operations to ensure a fire-safe work environment. Work is performed at LaRC only when the risk of fire is as low as is reasonably achievable (ALARA) and when the people are provided with a fire-safe workplace. Facilities shall be designed and operated in a manner to minimize the adverse impacts of fire and its related perils to workers, the public, and the environment. Fire protection support activities are conducted in compliance with fire safety laws, National Aeronautics and Space Administration (NASA) directives, and regulations and general industry practices, and in a manner appropriate for the associated hazards.

The establishment of a comprehensive LaRC fire protection program has as its goal to ensure that an adequate level of fire protection and life safety is maintained for personnel and property. This LPR was developed in order to achieve this goal and maintain a viable and effective fire safety program. Authority for the development and implementation of the LaRC Fire Protection Program is rooted in two NASA-wide policies:

- NPD 8700.1A, "NASA Policy for Safety and Mission Success"
- NPD 8710.2C, "Safety and Health Program Policy"

Guidance for the development of this LPR was provided by:

- NPR 8715.3, "NASA Safety Manual"
- STD 8719.11, "NASA Safety Standard for Fire Protection"
- NPR 8820.2C, "Facility Project Implementation Handbook."

NPR 8715.3 requires each NASA organizations to comply with the most current requirements of the following documents:

- Any applicable Federal Documents
- ICC International Codes (Building, Mechanical, Fire, Plumbing)
- 29 CFR Part 1910 Subpart L, Fire Protection
- Any applicable NASA Documents
- NASA Safety Standard for Fire Protection – STD 8719.11
- Facility System Safety Manual – STD 8719.7
- Any applicable NFPA Codes and Standards and their Appendices
- NFPA 101, Life Safety Code
- NFPA 70, National Electrical Code
- NFPA 1, Fire Prevention Code

October 3, 2004

LPR 1710.11

- ASME A17.1, Safety Code for Elevators

STD 8719.11 expands on the policy and guidelines for fire protection listed in NPR 8715.3. STD 8719.11 is a compilation of pertinent requirements from OSHA, NFPA, as well as unique NASA requirements. Compliance with this standard is mandatory for all NASA Field Installations. This Standard establishes fire protection requirements for NASA facilities in addition to those provided in NPR 8820.2C. NPR 8820.2C adds the following documents to the list of those stated previously that must be adhered to:

- Code of Federal Regulations (CFR)
- Factory Mutual (FM) Data Sheets and Approval Guides

LaRC management is responsible for correcting work conditions and employee actions that may contribute to the occurrence of fire. It also is responsible for informing employees, contractors, and relevant authorities of known potential fire hazards encountered in the workplace; for training individuals and making equipment and appropriate job procedures available so that each assignment can be completed in a fire-safe manner; and for ensuring that contractors apply fire protection requirements fully complying with LaRC directives.

1.2 GLOSSARY OF TERMS

Aging: Large-scale deterioration over time, caused by service and the environment.

Approved: Acceptable to the Authority Having Jurisdiction (AHJ).

Approved Materials: Materials approved by Factory Mutual (FM) or listed with Underwriters Laboratories (UL).

Assembly Point: An area identified by the facility owner and/or facility safety head with concurrence from the LaRC Fire Chief for facility personnel to safely gather following an evacuation.

Authority Having Jurisdiction (AHJ): The individual responsible for approving equipment, an installation, or a procedure.

Building: Any structure, enclosure, facility, or ramp used or intended for supporting or sheltering any use or occupancy. The term "building" shall be construed as if followed by the words "or portions thereof."

Certificate of Beneficial Occupancy: A document signed by the Safety and Facility Assurance Branch (SFAB) Head attesting that an area or facility substantially complies with all fire protection and Life Safety Code requirements, but is not in literal compliance with all fire safety requirements.

Certificate of Final Occupancy: A document signed by the SFAB Head attesting that an area or facility fully complies with applicable Occupational, Safety and Health Administration (OSHA), National Fire Protection Association (NFPA), NASA, and LaRC safety requirements on the date of the issuance of the certificate.

Clean Room: A room in which the concentration of airborne particles is controlled to specific limits.

October 3, 2004

LPR 1710.11

Clean Zone: A defined space in which the concentration of airborne particles is controlled to specific limits.

Computer Area: An area of a facility where the computer room is located including support rooms served by the same special air conditioning/air handling equipment as the computer room.

Computer Room: A room within the computer area that contains the electronic computer/data processing equipment.

Construction Projects: New facilities, facility additions, and facility alterations.

Deviation: A variance that authorizes departure from a particular safety requirement where the intent of the requirement is being met through alternate means which provide an equal or greater level of safety.

Exit: That portion of a means of egress that is separated from all other spaces of the facility or structure by construction or equipment as required by referenced documents to provide a protected way of travel to the exit discharge.

Exit Access: That portion of a means of egress that leads to an exit.

Exit Discharge: That portion of a means of egress between the termination of an exit and the public way.

Facility Fire Watch: The monitoring of facility operations during fire protection system impairments and the monitoring of other compensatory measures.

Facility Owner and/or Facility Safety Head: The individual having either the responsibility for all facility related items or processes with the facility or the responsibility for the personnel working in the facility. The responsible manager is the facility owner in instances where the requirement or responsibility pertains to the actual facility or processes in the facility, such as when a light bulb needs to be replaced. The supervisor directly responsible for the employees performing operations or working in the facility is the responsible manager in instances where the requirement or responsibility pertains to the employees performing operations (e.g., when a requirement states that the responsible manager ensures that personnel conduct tasks in a specified manner). In many situations, the responsible manager is both the facility owner and the supervisor of personnel in the facility.

Fire Area: An area bounded by construction with a minimum fire resistance rating of 2 hours, unless otherwise approved by the AHJ, with openings protected by appropriately fire rated doors, dampers, or penetration seals. The boundaries of exterior fire areas (yard areas) are determined by the AHJ.

Fire Hazard Analysis: A comprehensive assessment of the risks from fire within individual fire areas in a facility.

Fire Loss: The dollar cost of restoring damaged property to its prefire condition. In determining loss, the estimated damage to the facility and its contents includes replacement cost less salvage value. Losses will exclude costs of restoring (1) property that is scheduled for demolition, (2) property that is decommissioned and not carried on the books as value, and (3) property that has no loss potential. Personnel performing

October 3, 2004

LPR 1710.11

the loss estimate should include the cost of decontamination and cleanup, the loss of production or program continuity, the indirect costs of fire extinguishment (such as damaged fire department equipment), and consequent effects on related areas in all property loss amounts.

Fire Protection: A broad term that encompasses all aspects of fire safety, including facility construction and fixed facility fire protection features, fire suppression and detection systems, fire water systems, emergency process safety controls, emergency fire fighting operations (fire department), Fire Protection Engineer (FPE), and fire prevention. Fire protection is concerned with preventing or minimizing the direct and indirect consequences of fire on people, property, and programs. By extension, fire protection also includes aspects of the following perils as they relate to fire protection: explosion, natural phenomenon, and smoke and water damage from fire.

Fire Protection Engineering Survey: The process of reviewing, inspecting, testing, conducting surveillance, appraising and surveying to determine and document the compliance of facilities and operations with applicable directives, codes, and standards.

Fire Protection Program: A program that establishes the requirements, responsibilities, and organizational interfaces for implementing policy in the areas of fire protection, fire prevention, and life safety.

Fire Protection Review: A review of construction plans prior to contemplated construction for adequacy of fire risk appraisal and protection and for compliance with NASA fire protection criteria.

Fire Protection System: Any system designed and installed to detect, control, or extinguish a fire; to limit fire damage; to alert occupants and/or the fire department that a fire has occurred; or to otherwise enhance life safety.

Fire Protection System Impairment: A shutdown of a fire protection system or portion thereof.

Fire Watch (for hot work activities): The individual(s) who monitor the area around hot work activities for any fires or hot spots caused by sparks or slag. The personnel assigned to this task have received hands-on fire extinguisher training, and the hands-on training is renewed biannually. The personnel performing this task typically are drawn from the organization performing the hot work or possibly the LaRC Fire Department in special hazard situations and with the approval of the LaRC Fire Chief.

Graded Approach: By graded approach, LaRC intends that the depth of detail required and the magnitude of resources expended for a particular action are commensurate with the action's relative importance to safety, environmental compliance, safeguards and security, programmatic importance, and/or other facility specific requirements.

Improved Risk: Generally, an improved risk property is one that would qualify for complete insurance coverage by the Factory Mutual System, the Industrial Risk Insurers, and other industrial insurance companies that limit their insurance underwriting to the best protected class of industrial risk. This term also implies that qualified fire protection engineering judgment has been used to obtain the highest economically justifiable level of industrial loss prevention. The most evident characteristic of an improved risk property is the existence of reliable, automatic fire extinguishing systems

October 3, 2004

LPR 1710.11

throughout all facilities of combustible construction or content where the facility is vital to operational continuity or may experience a large property loss from fire in the absence of an automatic extinguishing system.

Maximum Credible Fire Loss: The property damage that would be expected from a fire, assuming that (1) all installed fire protection systems function as designed; and (2) the effect of emergency response is omitted except for post fire actions such as salvage work, shutting down water systems, and restoring operations.

Maximum Possible Fire Loss: The value of property, excluding land, within a fire area, unless a fire hazards analysis demonstrates a lesser (or greater) loss potential. This assumes the failure of both automatic fire suppression systems and manual fire fighting efforts.

Means of Egress: A continuous and unobstructed way of exit travel from any point in a facility or structure to a public way, consisting of three separate and distinct parts: the exit access, the exit, and the exit discharge.

Products of Combustion: Heat, smoke, sparks, and firebrands generated by burning.

Public Way: Any street, alley, or other similar parcel of land essentially open to the outside air that is dedicated or otherwise permanently appropriated to the general employee for Center use. The public way has clear width and height of not less than 10 feet.

Pyrophoric Material: A material that ignites spontaneously when exposed to air.

Redundant Fire Protection: Fire protection measures implemented to mitigate the effects of fires or related perils in the event of a partial or total failure of the primary fire protection measures (e.g., two independent fire suppression systems to protect a high risk facility).

Safety Class Equipment: A system or component that by not performing as intended could lead to loss of life, severe injury, or major property damage.

Safety Related Area: A system, equipment, or facility that, by not performing as intended, causes a hazardous condition that may lead to loss of life, severe injury, or major property damage.

Shop Welding Area: A permanently identified and fixed location in which hot work operations take place to support specific projects or facility operations.

Structure: That which is built or constructed. The term "structure" shall be construed as if followed by the words "or portion thereof."

Temporary: Not to exceed a period of 45 days.

Transient Fire Load: A fire load that is not permanently installed or stored in a designated storage area. This includes items such as combustible shipping containers, packing, stored paper, etc. This does not include hand carrier items directly under an individual's control such as toolboxes, work documents personal protective equipment, and instrumentation devices.

October 3, 2004

LPR 1710.11

Variance: Documented and approved permission to perform some act different than established requirements.

Waiver: A variance that authorizes departure from a specific safety requirement where an increased level of risk has been accepted.

Wear: Local deterioration that is expected based on previous experience.

Work Order: A written request for maintenance work submitted on a work order form.

CHAPTER 2**2. PROGRAM MANAGEMENT****2.1 FIRE PROTECTION STATEMENT****2.1.1 PURPOSE**

This LPR outlines the procedural requirements necessary for the LaRC fire protection program to meet the NASA fire protection criteria and NASA-mandated fire protection codes and standards.

2.1.2 SCOPE

This directive shall apply to the implementation of the fire protection program in all organizations at LaRC and to all contractors.

2.1.3 REQUIREMENTS

The LaRC fire protection program shall include the following elements: management; administration; documentation; training; system and facility design and construction; fire protection engineering (FPE); fire prevention; annunciation; confinement; suppression; fire department organization; inspection, testing, and maintenance; and quality assurance. The functional/organizational structure of the LaRC Fire Protection Program is shown in Figure 2.1.

The fire protection program shall provide and maintain a level of fire protection at LaRC which shall meet and/or exceed the objectives and criteria stated in NASA STD 8719.11, "NASA Safety Standard for Fire Protection". The objectives and the approach of the program shall entail the following:

1. Complete facility survey/risk analysis to identify fire protection and life safety deficiencies within the LaRC facilities. This shall be accomplished by the performance of comprehensive FPE surveys on a periodic basis and more detailed fire hazard analyses (FHA's) of facilities and hazards as warranted.
2. Reporting and tracking of fire protection deficiencies. This shall be accomplished by the fire protection organization maintaining a database of all FPE deficiencies, recommended corrections, and status of corrections.
3. Appropriate review and correction of fire safety violations. This shall be accomplished by a formal fire protection design review process to facilitate fire protection and life safety deficiency resolution in the earliest design phases. This process shall aid in preventing vital programs or projects from suffering unacceptable delays as a result of fire or its perils.
4. Submittal of Construction of Facilities (CoF) projects to correct fire protection deficiencies. This shall be addressed by periodic submission of deficiencies to LaRC management in an effort to have funding allocated for correction of the fire protection problem areas identified at LaRC.

October 3, 2004

LPR 1710.11

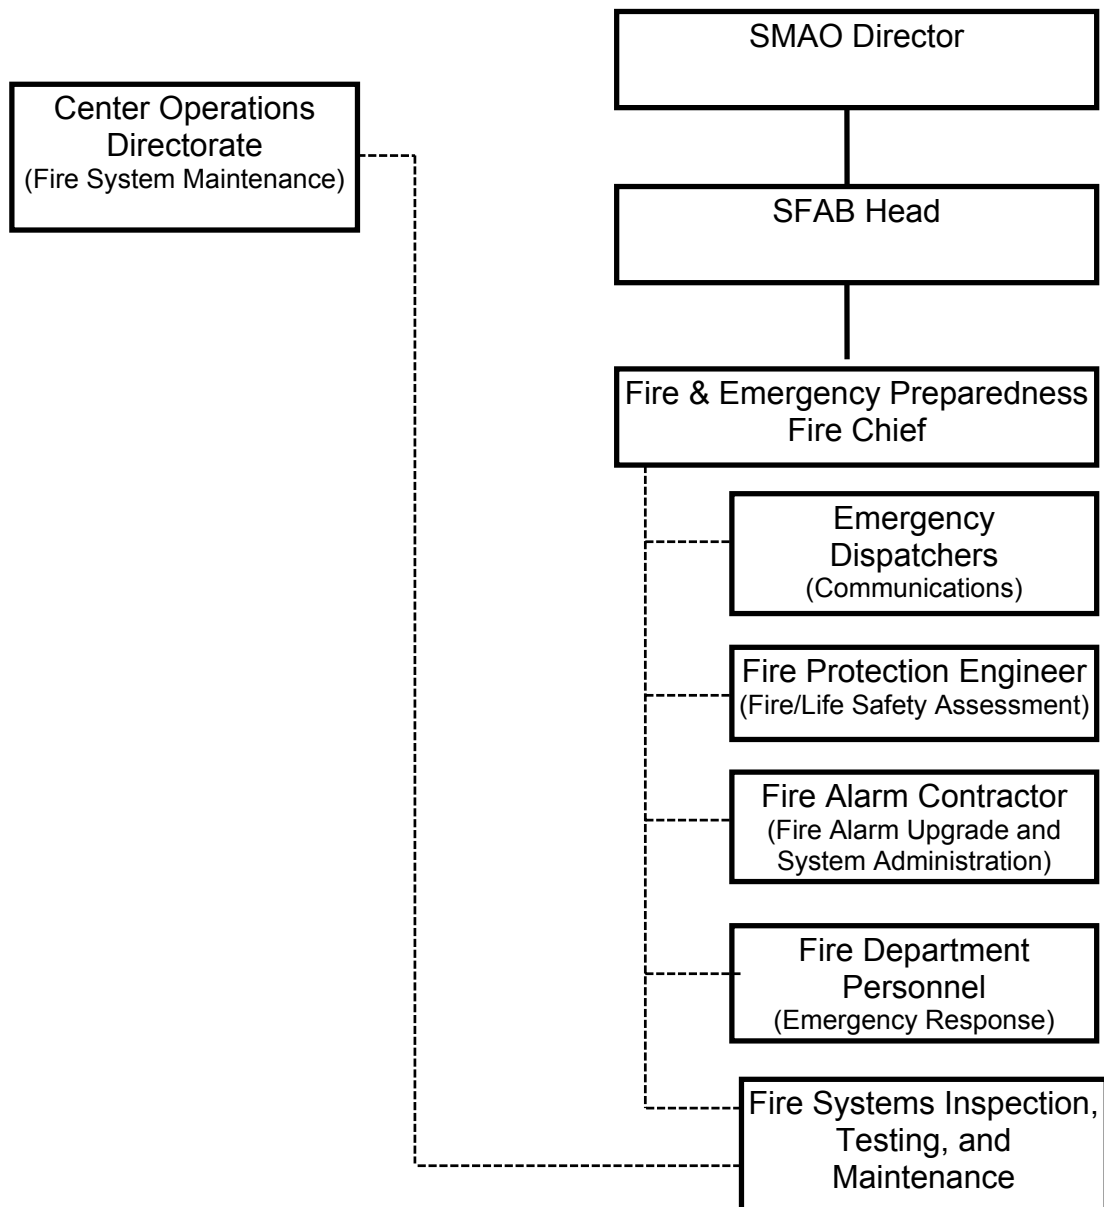


Figure 2.1, Functional/Organizational Structure of the Fire Protection Program.

October 3, 2004

LPR 1710.11

5. Control of flammable materials and hazardous operations to ensure that fire does not cause an on-site or off-site release of hazardous material that may threaten public health and safety or the environment. This shall be addressed through the design review process, the FPE survey program, and an aggressive fire prevention and housekeeping program.
6. Review of maintenance programs for fire protection equipment and systems. This shall be accomplished through an aggressive and documented inspection, testing, and maintenance program of fire protection systems and equipment, as well as a documented impairment system to follow fire protection system outages and to ensure complete and on-line operations.
7. Facility fire inspection and fire safety training. Inspections shall be accomplished through an aggressive inspection program with responsibility lying in the structure of LaRC Fire Department operations. Fire protection training shall be accomplished through a variety of employee training opportunities, as well as an aggressive fire prevention program for the control of housekeeping, combustible loading, hot work operations, hazardous materials, and ignition sources such as smoking and portable heating devices.
8. Proper functioning of the field installation fire department and/or coordination with the responsible local fire department. Fire department emergency response shall be coordinated through an agreement between the City of Hampton, Virginia; Langley Air Force Base; and LaRC. The objectives are to provide fully staffed, trained and equipped fire response forces for fire suppression, aircraft emergencies, emergency medical services, prefire planning, inspection services, and specialized fire safety training.
9. Investigation and reporting of fires. This shall be accomplished through LaRC Fire Department operations and the LaRC Fire Chief.
10. Development of emergency action plans and a field installation fire protection program plan and policy statement.
11. Designation of an authority having jurisdiction (AHJ). The responsibility of the AHJ is identified in Section 3.7
12. Compliance with local, state, and federal law and national codes and criteria for fire protection, as well as ensuring implementation of operational fire protection devices. This shall be addressed through the design review process, FPE survey program, more detailed Fire Hazard Analyses as warranted, and direct fire protection technical support to projects and operations.
13. Assistance in ensuring the adequacy of design from a code compliance, contractual, and cost benefit standpoint for major construction projects. This shall be accomplished through an established fire protection design review process and a design-based Fire Hazard Analysis, as warranted.
14. Review of facility design drawings for inclusion of adequate fire protection features and systems and for compliance with applicable codes and criteria. This shall be accomplished by establishing requirements that provide an acceptable degree of life safety to facility personnel; by providing a reliable

October 3, 2004

LPR 1710.11

water supply and water supply system (source, storage facilities, pumps, valves, and hydrants) of sufficient capacity for the maximum credible fire; by developing and maintaining Fire Hazard Analyses for new facilities; and by providing automatic suppression and detection systems in all areas subject to serious property damage and/or program interruption.

15. Review of all contractual documents for fire protection specifications. This shall be accomplished through an aggressive and documented fire protection design review process and the requirement to have contractual documents reviewed and approved by the Safety and Mission Assurance Office (SMAO).

2.1.4 RESPONSIBILITIES

The LaRC Fire Chief shall have the overall management responsibility for the fire protection program and shall:

1. Plan, direct, and execute a comprehensive fire protection program for LaRC, in accordance with the criteria established in STD 8719.11.
2. Formulate, implement, maintain, and assess the fire protection program.
3. Provide and maintain the necessary staffing and resources for the program.

The LaRC Fire Chief shall be responsible for the day-to-day operation of the fire protection program and shall:

1. Plan, organize, direct and control the fire protection program.
2. Provide and maintain a strong, competent fire protection staff.
3. Periodically assess the fire protection program.

Center Operations Directorate must coordinate with the LaRC Fire Chief for design review and resolution of problems related to fire protection.

All Associate Directors, Organizational Unit Managers, and workers shall be directly responsible for the fire safety of all personnel and property within their respective areas of operation.

2.2 FIRE PROTECTION ISSUES MANAGEMENT

2.2.1 PURPOSE

This section establishes the process and requirements for tracking corrective actions relative to fire protection findings resulting from audits and surveys. This shall include appraisals, inspections, surveys, assessments, and evaluations.

2.2.2 SCOPE

This section shall apply to all fire protection findings resulting from audits and surveys at LaRC.

October 3, 2004

LPR 1710.11

2.2.3 REQUIREMENTS

2.2.3.1 Internal Surveys Conducted Under the Direction of the LaRC Fire Chief

The LaRC Fire Chief shall ensure that the required fire protection engineering (FPE) surveys are performed according to Section 9.1:

- Forward copies of the surveys to the responsible Facility Coordinator and/or Facility Safety Head for resolution of deficiencies.
- Discuss with the Facility Coordinator and/or Facility Safety Head, potential corrective actions for identified deficiencies. Additionally, ensure that interim compensatory measures are in place as warranted.

The LaRC Fire Chief shall categorize, consolidate, and track deficiencies according to established protocol and enter the following information into a deficiency tracking system:

1. Violation number.
2. Facility number.
3. Year.
4. Type of violation (life safety, fire system deficiency, other specified code deficiency, NASA fire protection criteria noncompliance, housekeeping deficiency, or noncompliance with a good fire protection practice).
5. Fire protection ranking of violation.
6. Violation description.
7. Recommendation(s)/interim compensatory measures if warranted.

The responsible Facility Coordinator and/or Facility Safety Head shall notify the LaRC Fire Chief when the corrective actions are complete.

The LaRC Fire Chief or an appointed representative shall review and validate the corrective action to ensure that it was satisfactorily completed. The LaRC Fire Chief then shall close the deficiency in the database, as well as notifying the responsible Facility Coordinator and/or Facility Safety Head that the deficiency has been closed.

The LaRC Fire Chief shall maintain documentation relative to all corrected fire protection related findings.

2.2.3.2 Internal Inspections Conducted by the LaRC Fire Department using the Audit Tracking System (ATS)

LaRC Fire Department management shall:

1. Record deficiencies on ATS stipulated under Section 10.7.
2. Contact the Facility Coordinator and/or Facility Safety Head to advise that a fire inspection will be performed.
3. Provide the LaRC Fire Chief with a copy of the inspection report using ATS.

October 3, 2004

LPR 1710.11

LaRC Fire Chief shall:

1. Forward the inspection report (ATS) to the SFAB Head for review.
2. Issue requirements for compensatory measures that may be necessary until deficiency resolution (e.g., facility evacuation, fire watch).
3. Validate deficiency correction and close out the deficiency in ATS when notification is received from the Facility Coordinator and/or Facility Safety Head.

SFAB Head shall review ATS inspection report and forwards the report to the respective Facility Coordinator and/or Facility Safety Head.

Facility Coordinator and/or Facility Safety Head shall:

1. Through the ATS system will notify the LaRC Fire Chief when deficiencies are corrected.
2. Ensure that all interim compensatory measures are being performed.

2.2.3.3 External Audits Conducted by Non-LaRC Organizations

The LaRC Fire Chief shall serve as the primary point of contact for external fire protection related audits and shall:

1. Aid in coordination of the audits and question resolution.
2. Assist with resolution of deficiencies but is not responsible for corrective actions unless such actions specifically involve a function under his/her control. This responsibility shall lie with the Facility Coordinator and/or Facility Safety Head.
3. Enter the deficiencies into the fire protection database for tracking purposes.
4. Validate closure of deficiencies when notified by the Facility Coordinator and/or Facility Safety Head.

The Facility Coordinator and/or Facility Safety Head for the area shall achieve resolution of all identified deficiencies and shall:

1. Coordinate corrective actions relative to fire protection findings with the LaRC Fire Chief.
2. Seek funding to resolve deficiencies, as warranted.
3. Notify the LaRC Fire Chief when the corrective action is complete.

2.2.4 RESPONSIBILITIES

LaRC Fire Chief shall:

1. Report fire protection deficiencies observed during audits and validates implementation of corrective actions as delineated in this protocol.
2. Ensure that FPE surveys are performed for major facilities and that the deficiencies are tracked to resolution.

Facility Coordinator and/or Facility Safety Head shall:

1. Perform tasks as delineated in this section.

October 3, 2004

LPR 1710.11

2. Aid with deficiency resolution and performance of any other tasks assigned within this section.

LaRC Fire Department shall report fire protection deficiencies observed during facility inspections.

2.3 FIRE PROTECTION DEVIATION AND WAIVERS

2.3.1 PURPOSE

This section identifies the methodology necessary to request a deviation or waiver from a mandated NASA fire protection policy, code, or standard.

2.3.2 SCOPE

This section shall apply to all organizations at LaRC which operate facilities or equipment that may warrant deviations or waivers.

2.3.3 REQUIREMENTS

If compliance with a specified code, standard, or mandated policy cannot be achieved, a deviation or waiver containing the following information must be provided to the LaRC Fire Chief. The deviation or waiver must contain at a minimum:

1. The specification of the standard from which the deviation or waiver is being requested.
2. A detailed explanation of why compliance cannot be achieved.
3. A description of what measures will be implemented and maintained to provide protection equivalent to the requirement.

An analysis of the benefit gained or negative impact avoided by receiving the deviation or waiver versus the worst probable incident that may occur under the deviation or waiver. This shall require the development of a fire hazard analysis in accordance with Section 9.2 to provide technical justification for support of the deviation or waiver.

For temporary deviations or waivers, a statement of when compliance will be achieved and what actions have been and/or will be taken to achieve compliance must be provided to the LaRC Fire Chief. Additionally, interim compensatory measures must be identified to ensure that the highest levels of fire safety are maintained. Temporary deviations or waivers shall be valid for a period of up to 45 days and are permitted to be renewed up to three times.

Requests for deviations / waivers of NASA-specific criteria, codes, standards, and other relevant fire, life safety, and facility requirements shall be made in writing directly to the NASA Fire Chief who serves as the Authority Having Jurisdiction (AHJ) at LaRC. All requests shall contain the following information:

1. Name of person making request for deviation / waiver
2. Company, organization, work group

October 3, 2004

LPR 1710.11

3. Address, mail stop, telephone number, email address
4. Facility and room number (or area) where deviation / waiver is sought
5. Subject
6. Origination Date
7. Specific code, standard, or requirement from which deviation or waiver is being requested
8. Reasons why compliance cannot be achieved
9. Justification for approval of request and continued operation
10. Analysis of the benefit gained and negative impact upon operation
11. Systems, area, and personnel affected
12. Existing conditions or compensatory measure to be implemented and maintained to provide commensurate protection
13. If temporary deviation or waiver is requested, when will full compliance be achieved

Attachments such as drawings, sketches, fire hazard analysis to support requested deviation / waiver

2.3.4 RESPONSIBILITIES

All LaRC organizations requesting a deviation or waiver from a mandated fire protection code, standard, and/or policy must submit the request to the LaRC Fire Chief with the information outlined in Section 2.3.3.

The LaRC Fire Chief shall review and approve or reject the submittal from the LaRC Facility Coordinator and/or Facility Safety Head. The LaRC Fire Chief shall annually prepare a list of deviations or waivers that have been approved and are active at LaRC.

2.4 FIRE PROTECTION RULES

2.4.1 PURPOSE

This section outlines the process for issuance of formal fire protection rules by the LaRC Fire Chief pertaining to specific codes, standards, and amendments. Such fire protection rules are promulgated to administer and implement the fire protection program and to provide clarification of language found within applicable regulating documents.

2.4.2 SCOPE

This section shall apply to formal fire protection rules made by the LaRC Fire Chief for applicable fire protection codes, standards, and amendments implemented at the LaRC.

October 3, 2004

LPR 1710.11

2.4.3 REQUIREMENTS

2.4.3.1 General

Formal fire protection rules shall provide formal explanations and guidance pertaining to the meaning or intent of any specific provision or provisions of any regulatory document affecting the LaRC fire protection program.

All requests for formal rulings on the intent of NASA-specific criteria, codes, standards, and other relevant fire, life safety, and facility requirements shall be made in writing directly to the NASA Fire Chief who serves as the Authority Having Jurisdiction (AHJ) at LaRC. All requests shall contain the following information:

1. Name of person making request for a formal ruling
2. Company, organization, work group
3. Address, mail stop, telephone number, email address
4. Origination date
5. Cite applicable edition of NASA-specific criteria, code, standard, or requirement
6. Cite specific paragraph or section number where clarification, interpretation, or ruling is being requested
7. Does this matter involve an existing condition or design considerations of proposed project
8. State your business interest in the matter and identify all other parties involved
9. Concerning formal ruling, clearly state question in such a manner that it can be answered with either YES or NO

2.4.3.2 Limitations

A statement, written or oral, that is not processed in accordance with this section shall not be considered the official position of the LaRC Fire Chief or any of the fire protection designees and shall not be considered to be, nor relied upon as, a formal rule.

2.4.3.3 Nature of Formal Fire Protection Rules

A request for formal fire protection rules shall be clearly worded so as to solicit a Yes or No answer from the LaRC Fire Chief.

2.4.3.4 Editions to be Ruled

Formal fire protection rules shall be rendered on the text of the requested edition of the applicable document. The formal rule shall also apply to the current edition of the document, if the text is identical, unless deemed inappropriate by the LaRC Fire Chief.

2.4.3.5 Reasons for Not Processing

A request for a formal rule shall not be processed if it involves any of the following:

1. A determination of compliance of a design, installation, or product or equivalency of protection.

October 3, 2004

LPR 1710.11

2. A review of plans or specifications, or if it requires judgment or knowledge that can only be acquired as a result of on-site inspection.
3. Text that clearly and decisively provides the requested information.
4. Subjects that were not previously considered by the LaRC Fire Chief or that are not addressed in the document.

2.4.3.6 Method for Requesting Formal Fire Protection Rules

A request for a formal rule shall be directed to the LaRC Fire Chief.

The request shall include a statement which details specific references to a single problem and identifies the portion (e.g., article, section, paragraph) of the document and edition of the document on which a formal rule is requested.

Such a request shall be in writing and shall indicate the business interest of the requester.

A request involving an actual field installation shall state this, and all parties involved shall be named and notified.

2.4.3.7 Processing

Determination of Qualification

The LaRC Fire Chief, after consultation with the appropriate staff, shall determine if the request for a formal rule shall not be processed.

Editing of the Rule Request

A request for a formal rule may be rephrased. The rephrased version and any pertinent background information shall be sent to the requester and all parties named in the request for a formal rule. A deadline for receipt of agreement shall be established.

Approval of Formal Fire Protection Rules

If accepted for consideration, each request shall then be submitted to the LaRC Fire Chief and appropriate staff having expertise in the document or portion covering the subject under consideration. The LaRC Fire Chief will have the Head of SFAB and/or the Executive Safety Board subcommittee that oversees that particular area for which the ruling pertains, to provide comment.

Issuance of Formal Fire Protection Rules

If the required agreement is secured, the requester, the staff, and all named parties shall be notified by the LaRC Fire Chief. The interpretation shall be issued and become effective 20 days after notification unless a complaint is filed with the LaRC Fire Chief within that 20-day period.

Publication

Formal fire protection rules pertaining to text of the current edition of a document shall be published by SFAB. Formal fire protection rules pertaining to text of an outdated document shall not be published by SFAB but shall be sent to the requester and all parties named in the request.

October 3, 2004

LPR 1710.11

Applicability

Any formal rule issued shall apply to the edition of the document for which the rule is made and to any other edition of the document where the text is identical to the text of the edition on which the formal rule was rendered unless deemed inappropriate by the LaRC Fire Chief.

2.4.4 RESPONSIBILITIES

All LaRC organizations requesting a formal rule of a mandated fire protection code, standard, and/or policy shall submit the request to the LaRC Fire Chief with the information outlined in Section 2.4.3.

The LaRC Fire Chief shall review and approve or reject all requests for formal rulings brought before him.

October 3, 2004

LPR 1710.11

CHAPTER 3**3. ADMINISTRATIVE ASPECTS/FEATURES****3.1 FIRE PROTECTION PROGRAM REPORT****3.1.1 PURPOSE**

This section identifies the requirements for preparing a report of fire and other property damage experience and specifies the report format.

3.1.2 SCOPE

This section shall apply to all fire protection related activities at LaRC.

3.1.3 REQUIREMENTS

A report shall be prepared every two years which summarizes the previous two year's experiences and activities at LaRC relative to the control of NASA property damage and loss from fire and other accident causes.

The report shall be prepared in accordance with the format contained in Appendix A.

The report shall be submitted to the SMAO.

3.1.4 RESPONSIBILITIES

LaRC Fire Chief shall prepare the report and submit the report to the SFAB Head.

Fire Protection Engineer shall assist the LaRC Fire Chief, as necessary, by providing information pertaining to the fire protection program.

Center Operations Directorate shall assist the LaRC Fire Chief, as necessary, by providing needed information pertaining to fire protection related maintenance activities.

SFAB Industrial Safety Personnel shall provide the LaRC Fire Chief with information relative to monetary value of losses resulting from fire incidents.

3.2 HALON EXTINGUISHING AGENT**3.2.1 PURPOSE**

This section provides the criteria for reducing and eliminating chlorofluorocarbon (CFC)-based Halon fire extinguishing agents at LaRC.

3.2.2 SCOPE

This section shall apply to all Halon extinguishing agents at LaRC.

October 3, 2004

LPR 1710.11

3.2.3 REQUIREMENTS

3.2.3.1 General

No new Halon fire suppression agent shall be proposed to mitigate fire and life safety hazards:

1. Alternative protection in the form of automatic sprinkler suppression, water-mist, alternative gaseous agent, carbon dioxide, and preaction type suppression systems coupled with fire detectors shall be considered.
2. Automatic sprinklers shall be the preferred alternative, although facility specific design considerations may warrant the use of other protection.

Halon extinguishing agents that have been budgeted but for which no outside contract exists for procurement shall be canceled.

Where an outside contract exists but procurement may be under way or on an as-needed basis, the contract should be modified to require alternative protection as described in 3.1.1.

Situations beyond NASA control shall require that some or all of the existing Halon systems in inventory be deactivated and portable extinguishers removed.

3.2.3.2 Portable Fire Extinguishers

Halon portable fire extinguishers must not be purchased.

Existing Halon fire extinguishers shall be inspected and maintained pending the next hydrostatic testing interval.

Extinguishers requiring hydrostatic testing shall be removed from service and replaced with alternative portable extinguishers.

Halon agent (1211 or 1301) contained within extinguishers removed from service shall be retained as a reserve in an approved manner to be available for replenishment of Halon systems described in Section 3.2.3.3.

3.2.3.3 Specialty Halon Extinguishing Systems (Aircraft)

Existing Halon systems shall be inspected and maintained.

Existing Halon systems shall be prioritized in order of importance to safety so that if one discharges and no more Halon is available to replenish it, the capability exists to deactivate other system(s) that are of lesser priority.

A contingency plan shall be developed for interim compensatory measures to be implemented if a Halon system is rendered inoperative and cannot be restored.

Planning for projects to replace Halon systems with an alternative means of protection shall be expedited.

3.2.4 RESPONSIBILITIES

SFAB Head shall ensure CFC-based Halon fire extinguishing agents are eliminated or replaced in a timely manner.

October 3, 2004

LPR 1710.11

Facility Coordinator and/or Facility Safety Head shall:

1. Assist the LaRC Fire Chief in determining the need for CFC-based Halon fire extinguishing agents within the facilities of equipment.
2. Ensure elimination or replacement of CFC-based Halon fire extinguishing agents as directed by the LaRC Fire Chief.

Fire Extinguisher maintenance personnel shall inspect and maintains Halon portable fire extinguishers as directed in this section.

LaRC Fire Chief shall:

1. Assess the need for CFC-based Halon fire extinguishing agents at LaRC.
2. Establish the priority for the elimination and/or replacement of CFC-based Halon fire extinguishing agents at LaRC.

3.3 FIRE PROTECTION ENGINEERING SURVEY DEFICIENCY DATABASE

3.3.1 PURPOSE

This section establishes the process and requirements for the tracking of corrective actions relative to fire protection deficiencies resulting from fire protection engineering surveys.

3.3.2 SCOPE

This section applies to all fire protection findings resulting from fire protection engineering surveys at LaRC.

3.3.3 REQUIREMENTS

Surveys shall be conducted by a Fire Protection Engineer. The fire protection engineer shall forward copies of the survey report to the LaRC Fire Chief.

The LaRC Fire Chief shall ensure that survey deficiencies and related information are entered on the existing database named *Fire Protection Survey Tracking System*. Information to be entered shall include FPR Number (see Section 3.4), Violation Number, Facility Number, Year, Violation Description, Type of Violation, Recommendation, Status of Violation and Date, and Status of Description:

Type of violation shall be coded as follows:

1. SCD Specified Code Deficiency
2. LSCD Life Safety Code Deficiency
3. FSD Fire System Deficiency
4. ANC Administrative Noncompliance
5. HSK Housekeeping
6. NASAFP STD 8719.11 Noncompliance
7. GFP Good Fire Protection Practice

October 3, 2004

LPR 1710.11

An example of the printout from the FPE Survey Deficiency Database is in Appendix B. The Facility Coordinator/Facility Safety Head shall notify the LaRC Fire Chief when the corrective action is completed.

The LaRC Fire Chief or designee shall validate the closure of fire protection related findings.

The LaRC Fire Chief shall ensure that the appropriate information is entered on the tracking system to close the finding.

The LaRC Fire Chief or designee shall maintain all documentation relative to corrected fire protection related findings.

3.3.4 RESPONSIBILITIES

LaRC Fire Chief shall complete the duties outlined in this section.

Facility Coordinator/Facility Safety Head shall:

1. Coordinate fire protection related corrective actions resulting from FPE surveys.
2. Ensure that interim compensatory measures and/or corrective actions are implemented and completed by the indicated completion date.
3. Notify the LaRC Fire Chief when corrective actions resulting from surveys are completed.

3.4 FIRE PROTECTION ENGINEERING SURVEY DEFICIENCY RANKING SYSTEM

3.4.1 PURPOSE

This section establishes a system for assessing the relative risk associated with each fire protection engineering (FPE) survey deficiency and for determining the priority of abatement activities. In addition, it establishes the requirements for interim compensatory measures based on the deficiency ranking.

3.4.2 SCOPE

This process shall apply to all deficiencies noted during fire protection engineering surveys and to the interim compensatory measures used as alternative protection to meet the intent of code requirements when final resolution of a deficiency is significantly delayed because of funding, scheduling, or other considerations.

3.4.3 REQUIREMENTS

3.4.3.1 Deficiency Ranking System

The FPE survey shall be the basis for assigning the fire protection rating for each deficiency by determining the severity of the injury or damage that could result from the hazard and the probability that an injury or damage could occur.

October 3, 2004

LPR 1710.11

Note: Considerable fire protection engineering judgment is necessary to appropriately assess the severity and probability of a specific fire event as well as the impact of related perils.

The classification of the severity of a hazard shall be based on the severity of the injury or damage that could result from the hazard. This classification shall constitute the first step in determining the risk associated with the hazard.

The most serious type of injury or damage that is reasonably predictable as a result of the type of accident of fire shall be used in determining the fire protection rating.

The probability is directly related to the likelihood that a hazard will result in an injury or property damage based on an assessment of applicable safety factors.

The assessor shall identify and evaluate as many relevant factors that may influence the likelihood that an injury or property damage will occur as possible and shall assign them a weight in accordance with the relative contribution of each.

The following safety factors shall be considered when evaluating hazards:

1. Number of personnel or type of facility potentially exposed, both concurrently and sequentially.
2. Frequency and duration of hazard exposure, including the full range of possible frequency/duration, from one-time, short exposures to once-per-week exposures to continuous daily exposure.
3. Personnel/property proximity to the hazard (e.g., from a location at the fringe of the danger zone up to the point of danger).
4. Working conditions that may increase the likelihood of an accident and the existence of appropriate and effective protective equipment.

The assessor shall also consider mitigating factors to the hazardous condition, such as the existence of specific instructions, effective training programs, warning signs and labels, and specific procedures which would provide some protection.

The assessor shall also consider contributing factors specific to the hazardous condition—such as inappropriate or inadequate instructions, inadequate or no training, and widespread hazardous conditions or faulty equipment—with little or no attempt to control them.

The Fire Protection Rating (FPR) assigned to each hazard is an expression of risk which combines its severity and probability. Using the matrix shown in Figure 3.1, the FPR shall be expressed as a single code and shall relate directly to a risk category that can be used as a tool to determine priorities among hazard abatement activities.

October 3, 2004

LPR 1710.11

FPR	Major Category Rating Criteria	Subcategory Descriptive Criteria
	Priority Category	Fire Protection
V	Nonserious Technical Deficiency	Minor code noncompliance or deviation from a best management practice or recommended guide Permanent deviation or wavier may be on file or need to be sought for these deficiencies
IV	Code Noncompliance (Less Serious)	Technical deficiency, but much less serious in nature than FPR II or III High-dollar value loss or loss of life not likely to occur Fire potential and probability low
III	Code Noncompliance (Moderate)	Deficiency not as serious in nature as FPR II, but warrants some level of priority correction Fire potential moderate
II	Code Noncompliance (Serious)	Major deficiency, major code violations but not imminent in nature Serious life safety deficiencies Major fire protection system problems Lack of required suppression Large loss property damage potential high
I	Imminent	Death or serious injury to personnel very likely to occur Large loss property damage very likely Unacceptable fire loss potential Fire potential high Fire probability high

Figure 3.1, Fire Protection Rating Schedule.

October 3, 2004

LPR 1710.11

3.4.3.2 Interim Compensatory Measures

Interim compensatory measures shall be used to abate a hazard when the FPR is determined to be unacceptable if left unattended.

Interim compensatory measures (e.g., fire watches, fire patrols, enhanced hazard control procedures, temporary fire protection features) shall be specified under the following conditions:

1. A fire protection system is impaired, either planned or unplanned.
2. A temporary fire protection and life safety deviation or waiver from NASA directives or other mandatory codes and standards has been requested or granted.
3. Final resolution of a fire protection/life safety deficiency is significantly delayed because of funding, scheduling, or other considerations.
4. The measures specified are based on sound FPE judgment and recommended fire protection practices resulting from fire risk and loss potential assessment of the particular situation. Factors to be considered when assessing the fire risk and loss potential include the process/system involved, the location of the hazard, the impact on the program continuity, and similar items.

3.4.4 RESPONSIBILITIES

LaRC Fire Chief shall:

1. Rank each FPE survey deficiency to determine the overall risk rating.
2. Specify interim compensatory measures to be implemented as a result of a requested or granted fire protection deviation/waiver, or when justified by the hazard.

SFAB Head shall specify interim compensatory measures in the absence of the LaRC Fire Chief.

3.5 FUNDING PRIORITIZATION OF FIRE PROTECTION ISSUES

3.5.1 PURPOSE

The purpose of this section is to provide a credible, standardized, and auditable process to ensure that funding is secured for fire protection deficiencies and projects of high programmatic importance.

3.5.2 SCOPE

This section shall apply to all organizations requesting funding for fire protection modifications, upgrades, and construction related projects.

October 3, 2004

LPR 1710.11

3.5.3 REQUIREMENTS

3.5.3.1 General

A ranking system shall be in place so that deficiencies and projects can be evaluated based on the relative risk associated with each item.

The intent shall be to prioritize projects as well as findings resulting from internal and external surveys, appraisals, and audits. This prioritization scheme shall not be intended to include maintenance-type items.

A list of all open fire protection items (such as unfunded projects and findings from internal and external surveys, appraisals, and audits) shall be maintained and updated annually.

3.5.3.2 Capital Equipment

Capital equipment shall include any item of personal property with a unit cost of \$5,000 or more and a minimum useful life of 2 years or more.

3.5.3.3 Project Type and Funding Allocation

Major Construction of Facilities (CoF)

CoF projects shall be those construction projects that are submitted for funding as discrete projects valued at \$1.5 million or greater.

Minor Construction of Facilities (CoF)

Minor construction projects shall be those construction projects or compilations of projects that are submitted for funding as a package and that shall be specifically reviewed and approved by Congress as a package.

Minor construction projects are minor new construction projects of a general nature, the total estimated cost of which may not exceed \$1.5 million for any single project.

Minor Revitalization Construction of Facilities (CoF)

Revitalization projects shall be those construction projects that are submitted for funding separately as rehabilitation, modification, or major repairs to existing facilities valued at less than \$1.5 million and that are specifically reviewed and approved by Congress as a package.

Research Operations Support

Research operations support projects shall be minor construction projects of a maintenance, operations, and safety related nature, the total estimated cost of which may not exceed \$200,000.

Research operations support funding shall be allocated at the Center level.

October 3, 2004

LPR 1710.11

3.5.3.4 Prioritization

General

The prioritization criteria shall consist of two elements of risk: consequence and probability.

The prioritization process shall be universal, encompassing the major category of health and safety and the subcategory of fire protection.

Three other categories shall be considered: (1) environment/waste management, (2) safeguards and security, and (3) programmatic.

Approach

The rating criteria within the major category and subcategory shall be aligned along a scoring scale so that they represent the same severity or priority.

Each funding request shall be prioritized based on the potential risk to assist management in the budgeting process and to ensure that the higher risk items receive funding priority.

Prioritization Levels

Prioritization levels shall be used to identify the importance of each item. The prioritization level shall be established utilizing the Fire Protection Funding Prioritization Scoring Matrix shown in Figure 3.2.

Fire protection funding requests with a score of 50 or greater shall be Priority I and shall warrant immediate compensatory action and/or correction. Priority I issues shall be conveyed to LaRC and NASA Management upon discovery for immediate action.

Fire protection funding requests with a score of 20 to 49 shall be Priority II and must be corrected in a timely manner.

Fire protection funding requests with a score of 19 or less shall be Priority III. These items present little threat to personnel safety or the environment but, if corrected, would improve the effective implementation of the fire protection program.

Consideration must be given to correction of these issues because correction may prove to be cost-effective or of little impact to operations.

3.5.4 RESPONSIBILITIES

Originating Organization (with Outstanding Fire Protection Issues) shall submit copies of their proposed remediation plans and funding sources for outstanding fire protection issues to the SFAB Head for review.

SFAB Head shall forward all fire protection funding requests to the LaRC Fire Chief.

LaRC Fire Chief shall review all fire protection funding requests and establish the priority for each request and maintain the log and status of all fire protection funding requests.

October 3, 2004

LPR 1710.11

Score	Major Category Rating Criteria	Subcategory Descriptive Criteria
	Priority Category	Fire Protection
10	Nonserious Technical Deficiency	Minor code noncompliance or deviation from a best management practice or recommended guide Permanent deviation/waiver may be on file or need to be sought for these deficiencies
20	Code Noncompliance (Less Serious)	Technical deficiency, but much less serious in nature than 40 or 30 High-dollar value loss or loss of life not likely to occur Fire potential and probability low
30	Code Noncompliance (Moderate)	Deficiency not as serious in nature as 40, but warrants some level of priority correction Fire potential moderate Fire probability low
40	Code Noncompliance (Serious)	Major deficiency, major code violations but not imminent in nature Serious life safety deficiencies Major fire protection system problems Lack of required suppression Large loss property damage potential
50	Imminent	Death or serious injury to personnel very likely to occur Large loss property damage very likely to occur Unacceptable fire loss potential Fire potential high Fire probability high

Figure 3.2, Fire Protection Funding Prioritization Scoring Matrix.

3.6 PROCUREMENT RELATED FIRE PROTECTION ISSUES

3.6.1 PURPOSE

This section establishes requirements and provides guidance for fire protection review of purchase requisitions for capital and Center equipment or materials which present fire protection issues or concerns.

3.6.2 SCOPE

These criteria shall apply to all organizations preparing purchase requisitions for capital equipment and Center equipment costing \$5,000 or more, except computer equipment, and all fire protection and life safety related equipment.

3.6.3 REQUIREMENTS

The organization preparing the purchase requisition shall include the SFAB as the first reviewer/approver for fire protection concerns.

SFAB personnel shall forward purchase requisitions for capital equipment and Center equipment costing \$5,000 or more (except computer equipment) and all fire protection and life safety related equipment to the LaRC Fire Chief.

October 3, 2004

LPR 1710.11

The LaRC Fire Chief shall review the requisition to ensure that all fire protection concerns pertaining to capital and Center equipment or materials are adequately addressed and that all fire protection equipment has been tested or approved for its intended use by a nationally recognized laboratory. In cases where specific components are not available with a listing or approval, they must be evaluated to determine their acceptability for use.

The LaRC Fire Chief shall indicate approval or rejection on the purchase requisition.

Upon approval, the requisition shall be returned to the appropriate personnel in the Office of Procurement.

Upon rejection, the LaRC Fire Chief shall return the requisition to the Office of Procurement.

3.6.4 RESPONSIBILITIES

Originating Organization shall include the SFAB as first reviewer/approver for fire protection concerns when entering requisitions for capital and Center equipment costing \$5,000 or more and all fire protection and life safety related equipment.

SFAB Head shall review and forwards all purchase requisitions for capital and Center equipment costing \$5,000 or more and all fire protection and life safety related equipment to the LaRC Fire Chief.

LaRC Fire Chief shall review all purchase requisitions for capital and Center equipment costing \$5,000 or more and all fire protection and equipment and approve or reject requisitions.

LaRC Office of Procurement shall ensure that purchase requisitions are approved by the LaRC Fire Chief, as necessary, prior to further processing.

3.7 AUTHORITY HAVING JURISDICTION

3.7.1 PURPOSE

This section establishes the authority having jurisdiction (AHJ) for the administration and enforcement of fire protection codes, standards, and recommended guides and practices.

3.7.2 SCOPE

This section shall apply to all fire protection issues, codes, standards, at LaRC.

3.7.3 REQUIREMENTS

3.7.3.1 General

The SFAB Head may delegate an individual to be the AHJ for all fire protection matters.

The individual delegated by the SFAB Head as the AHJ is the LaRC Fire Chief, and he shall assume such powers as necessary for the administration and enforcement of the LaRC fire protection program.

October 3, 2004

LPR 1710.11

LaRC Security Management and Safeguards Team and other enforcement agencies shall have authority to render necessary assistance in the enforcement of the fire protection program when requested to do so by the AHJ.

3.7.3.2 Authority of the AHJ

The AHJ or designee shall be authorized to inspect any facility or premises for dangerous or hazardous conditions or materials.

The AHJ shall order any person(s) to remove or remedy such dangerous or hazardous conditions or materials.

Where conditions exist and are deemed hazardous to life and property by the AHJ, he or she shall have the authority to abate such hazardous conditions that are in violation of the fire protection program.

The AHJ shall investigate the cause, origin, and circumstances of any fire, explosion, or other hazardous condition:

1. The AHJ shall take custody of all physical evidence relating to the cause of the fire, explosion, or other hazardous condition.
2. Information that may relate to trade secrets or processes shall not be made part of the public record except as may be directed by a court of law.

The AHJ shall access plans and specifications to ensure compliance with applicable codes and standards.

When any construction or installation work is being performed in violation of the plans and specifications approved by the AHJ, a NASA LaRC Notice of Violation (Contractor) shall be issued to the responsible party to stop work on the portion of the work that is in violation

The notice shall state the nature of the violation, and no work shall be continued on that portion until the violation is corrected.

Whenever any installation subject to inspection prior to use is covered or concealed without having first been inspected (e.g., buried piping), the AHJ shall require that such work be exposed for inspection.

The AHJ shall be notified when the installation is ready for inspection and conducts the inspection within a reasonable time.

The AHJ shall have the authority to approve alternative materials or methods of construction provided (1) the proposed alternative shall be satisfactory and complies with the intent of the provisions of the fire protection program; and (2) the material, method or work offered shall be, for the purpose intended, at least the equivalent of that prescribed in the fire protection program in quality, strength, effectiveness, fire resistance, durability, and safety:

1. Sufficient technical data shall be submitted to substantiate the proposed installation of any material or assembly.

October 3, 2004

LPR 1710.11

2. If the AHJ determines that the evidence submitted is satisfactory proof of performance for the proposed installation, he or she shall approve such an alternative subject to the provisions of the fire protection program.
3. The cost of all tests, reports, and investigations required under this provision shall be paid by the applicant.
4. Supporting data, where necessary to assist in the approval of all materials or assemblies not specifically provided for in the fire protection program, shall consist of valid research reports from approved sources.

The AHJ shall order the immediate evacuation of any occupied facility deemed unsafe when such a facility has hazardous conditions that present an imminent danger to facility occupants.

The AHJ shall develop and implement a fire protection program as deemed necessary for the general welfare with respect to the potential fire hazards at LaRC.

The AHJ shall ensure that appropriate or duly authorized fire safety education programs or public fire safety messages are disseminated to LaRC employees and contractors.

3.7.4 RESPONSIBILITIES

SFAB Head shall:

1. Designate the LaRC Fire Chief as the AHJ.
2. Ensure that the duties and authorities of the AHJ are developed.

Authority Having Jurisdiction (LaRC Fire Chief) shall:

1. Perform the duties delineated in this section.
2. Enforce the provisions of the LaRC fire protection program.

LaRC Fire Chief shall act as the AHJ for fire protection and life safety related issues.

3.8 FIRE INVESTIGATION AND REPORTING

3.8.1 PURPOSE

This section identifies the requirements and describes the method of conducting fire investigations and preparing the investigation reports.

3.8.2 SCOPE

These requirements shall apply to all personnel designated to investigate fires, determine cause, and properly report their findings.

3.8.3 REQUIREMENTS

This section is not intended to cover every aspect of a fire investigation. However, certain steps shall be necessary to assure an accurate report of any fire, large or small. The statistics of a fire are vital in every respect. All facts must be exposed. Any information obtained from knowledgeable persons shall be considered very important, until otherwise determined.

October 3, 2004

LPR 1710.11

Fire investigations and reports shall be performed and prepared in accordance with the STD8719.11 and NPR 8715.3.

All field reporting shall be performed in accordance with NFPA 902M, Fire Reporting Field Incident Manual.

The LaRC Fire Chief shall conduct the fire investigations with assistance from the LaRC Fire Department station officer, Security Management and Safeguards Team, Hampton Fire Department investigation unit, or other organizations as requested.

Basic information relative to the facility at which the fire occurred shall be obtained, including the following:

1. Facility Number and Name
2. The specific location of the fire occurrence shall be identified.
3. Facility Function - The type of facility or the activity/function performed by the facility shall be reported. One of the following functions shall be used:
 - Wind tunnel testing facility
 - Computer/Data processing facility
 - Other testing facility.
 - Balance-of-center (e.g., offices, machine shops, site/outside utilities, safeguards/security, and transportation)
4. Facility Coordinator and/or Facility Safety Head - The name, title, and telephone number of the Facility Coordinator and/or Facility Safety Head who has direct line responsibility for operation of the facility shall be reported.
5. Originator - The name, title, and telephone number of the person who obtained the information and documented the facts shall be included.

The response related information shall be identified and documented, including the following:

1. Method used to provide notification of the fire.
2. Beginning and ending recording index.
3. Run number.
4. Individual notifying the LaRC Fire Department.
5. Fire related information provided during initial notification.
6. All responding vehicles/apparatus, including time out and time in.
7. Any vehicle/apparatus not in service at time of response and reason for being out of service.
8. Approach used; position of apparatus.
9. Whether or not equipment functioned properly.
10. Weather conditions and wind direction.

October 3, 2004

LPR 1710.11

11. Extent of fire spread or containment.
12. Content or fire load, fuel, ventilation, and facility accessibility.
13. Personal protective equipment properly worn by responders.
14. Equipment damage.
15. Fire fighter, pedestrian, or occupant injuries.
16. Amount of agent used to extinguish the fire.

The point of origin and cause of fire shall be determined and documented.

Photographs taken of the complete area shall be included.

The previous information and any other pertinent information shall be documented in a consistent, organized manner.

3.8.4 RESPONSIBILITIES

LaRC Fire Chief shall investigate all fires and follow these requirements in the performance of his or her duties.

Fire Department Station Officer shall assist in investigation of fires, as needed.

The Security Management and Safeguards Team shall assist LaRC Fire Chief or designee in investigation of fires, as needed.

CHAPTER 4**4. DESIGN CRITERIA****4.1 FIRE PROTECTION DESIGN CRITERIA****4.1.1 PURPOSE**

This section identifies the fire protection design criteria for new facility designs, upgrades, and modifications.

4.1.2 SCOPE

This section shall apply to all designs, upgrades, and modifications to NASA-owned facilities. This criteria shall be applied to NASA-leased facilities to the maximum extent permitted by the local building code or official.

4.1.3 REQUIREMENTS**4.1.3.1 Original Design Codes**

The fire protection related codes and standards in effect when facility design commences (code of record) shall remain in effect for the life of the facility unless a significant hazard that endangers the facility occupants or the public is identified. In these cases, the facility shall be upgraded to the current requirements of the applicable code or standard.

Note: If the code of record cannot readily be determined, the Authority Having Jurisdiction shall stipulate the code to be utilized.

4.1.3.2 Current Codes

When upgrades or modifications are made, the current edition of the code shall apply to the upgrade or modification. When substantial upgrades or modifications are made on fire protection systems, the entire system shall be upgraded to the current code or standard.

4.1.3.3 Equipment Testing and Approval

All fire protection designs shall use equipment that has been tested and listed or approved by a nationally recognized testing laboratory for its intended use.

The LaRC Fire Chief shall issue written approval for substitute, equivalent items if no listed or approved item can be procured because the equipment has never been tested for fire protection use.

4.1.3.4 Equipment Compatibility

All equipment components specified in designs shall be compatible with existing equipment and installed as required by the applicable NFPA codes and standards.

October 3, 2004

LPR 1710.11

4.1.3.5 Acceptance/Operating Test Procedures

Written acceptance tests or operating procedures shall be prepared and executed for all new system installations and/or modifications to verify that the systems perform as required. Any deficiencies noted during the tests must be documented and tracked until resolved or corrected.

4.1.3.6 Site-Specific Requirements

When site-specific guides or design specifications exist, they shall be included in all fire protection design packages as applicable.

4.1.3.7 Mandatory Design Criteria

Provided in each section of this document are the orders, codes, standards, and other applicable documents that shall be followed for all fire protection designs, modifications, upgrades, and other fire protection related activities.

4.1.4 RESPONSIBILITIES

LaRC Fire Chief (or Designee) shall ensure that design submittals are reviewed in accordance with and meet the design criteria listed herein.

Facility Coordinator and/or Facility Safety Head shall ensure that design submittals meet all applicable design criteria prior to activity initiation.

4.2 PROPERTY LOSS DESIGN CRITERIA

4.2.1 PURPOSE

This section provides requirements for limiting property loss from fire.

4.2.2 SCOPE

These requirements shall apply to all LaRC-managed facilities, operations, programs, and activities. This shall include NASA-managed equipment and components located in leased facilities.

4.2.3 REQUIREMENTS

4.2.3.1 Minimum Requirements for Installing Automatic Fire Suppression Systems

Complete automatic fire suppression systems shall be provided and installed according to the applicable NFPA standards for the following:

All new permanent structures or renovations with total floor area involved is greater than 2,500 square feet.

All projects (regardless of funding sources) where the maximum credible fire loss (MCFL) will result in the loss of use of a vital structure or equipment for a period longer than that specified as acceptable by the program director.

October 3, 2004

LPR 1710.11

When the criteria above do not apply, automatic fire suppression and/or detection may still be warranted based on any of the following factors:

1. Programmatic importance
2. Effects on operations
3. Cost vs. benefit
4. Exposure
5. Future conditions

4.2.3.2 Criteria for Installing Redundant Fire Protection Systems

A redundant fire protection system shall be provided when the maximum possible fire loss (MPFL) exceeds \$50 million, to limit the loss to this figure, or in situations deemed appropriate by sound fire protection engineering judgment.

In some cases, a fully staffed, trained, and equipped on-site fire department with adequate water supply (including location of hydrants) and automatic means of notification (such as a smoke detection system installed per NFPA 72) shall serve as a redundant system.

4.2.3.3 Redundant System and Fire Barriers/Physical Separation

A redundant fire protection system and a 3-hour rated fire barrier or physical separation shall be provided when the MPFL exceeds \$75 million, to limit the loss to this figure.

4.2.3.4 Two-Way Water Flow

Fire protection water supply distribution systems for all new installations shall be looped to provide two-way flow, with sectional valving arranged to provide alternate water flow paths to any point in the system.

Note: The exception, a single feed, shall be allowed, provided the system is reviewed and approved by the LaRC Fire Chief.

4.2.3.5 Water Supply Duration and Main Size Criteria

The water supply for fire protection shall have a minimum supply duration of 2 hours. New primary distribution mains in no case shall be smaller than 12 inches, building/facility loops shall be 8 inches or larger, and fixed suppression feeds in no case shall be smaller than 6 inches.

4.2.3.6 Independent Water Supply Sources

Facilities having an MPFL in excess of \$50 million shall have two independent sources of fire protection water.

4.2.3.7 Noncombustible Construction Materials

New structures shall be of noncombustible or fire resistive construction. Materials used in renovations shall also be of noncombustible construction. Allowances for a limited

October 3, 2004

LPR 1710.11

amount of combustible trim in accordance with NFPA 101 shall be permitted in the majority of circumstances.

4.2.3.8 Special Fire Protection Criteria for Portable Structures

Portable structures shall comply with Section 8.4, "Fire Protection for Portable Structures."

4.2.3.9 Criteria for Computer and Data Processing Equipment

Electronic computer systems shall comply with Section 8.10, "Fire Protection for Computer Facilities."

4.2.3.10 Sitewide Fire Alarm System Connection

When fire protection systems are installed in facilities on the LaRC site, they shall be compatible with and connected to the sitewide fire alarm system.

4.2.3.11 Special Hazards

Special hazards unique to site operations and not addressed by mandatory codes or standards must be protected per STD 8719.11 and/or other criteria as outlined by Factory Mutual (FM) or Industrial Risk Insurers (IRI).

4.2.3.12 Seismic Design Criteria for Fire Protection Systems

The design of fire protection systems to withstand seismic events shall be according to the applicable NFPA standard, except as required by other criteria for safety class equipment.

4.2.4 RESPONSIBILITIES

Project Engineer and/or Facility Coordinator/Facility Safety Head shall ensure that all facilities, operations, programs, and activities are designed and built according to the requirements of this section.

4.3 FACILITY MODIFICATIONS AFFECTING FIRE PROTECTION AND/OR LIFE SAFETY ASPECTS

4.3.1 PURPOSE

This section delineates the criteria for facility modifications which affect fire protection and/or life safety aspects. It also establishes the requirements for the LaRC Fire Chief's participation in the facility acceptance process.

4.3.2 SCOPE

This section shall apply to the acceptance of modifications to existing facilities or new facilities.

October 3, 2004

LPR 1710.11

4.3.3 REQUIREMENTS

4.3.3.1 Facility Modifications Affecting Fire Protection and/or Life Safety Aspects

No modifications in the use or occupancy of any facility or portion thereof which could affect fire protection and/or life safety aspects shall be made without the approval of the LaRC Fire Chief.

Modifications which could affect fire protection and/or life safety aspects shall include (but are not limited to) the following:

1. Changes in the use of a facility
2. Permit increases in the number of occupants within a facility or anytime the occupant load reaches its maximum limit
3. Introduction of high-value and/or hazardous equipment, materials, or processes
4. Changes to corridors, lobbies, exits, or other required means of egress components such as doors and door hardware
5. Changes of any type to fire protection systems
6. Elimination of facility walls and barriers or any portion thereof
7. Rearrangements of structural components affecting the exit requirements
8. Significant changes in existing utilities
9. Addition of new utilities to an existing facility

Ordinary repairs may be made to any facility without requiring notice to the LaRC Fire Chief, provided the repair does not include any item listed above.

Alterations or repairs shall not cause an existing facility to become unsafe or adversely affect the performance of the building.

The unaltered portion of the existing facility shall continue to comply with the fire protection related codes and standards in effect when the facility design commenced (code-of-record), provided the altered portion of the facility or work being completed conforms to Section 4.1 of this document. Situations that present an unusual life safety hazard in the opinion of the LaRC Fire Chief, shall not be allowed to continue regardless of the code in effect at the time of facility construction.

Alterations must be submitted and reviewed in accordance with Section 4.4 of this document prior to beginning work.

Modifications to an existing facility must be inspected and accepted by the LaRC Fire Chief in accordance with Section 4.3.3.2 of this section.

4.3.3.2 Facility Acceptance

Construction Supervisor or Contractor shall provide advance notice of facility acceptance to the Facility Coordinator/Facility Safety Head for existing facility modifications or to the project engineer for new construction.

October 3, 2004

LPR 1710.11

LaRC Fire Chief shall:

1. Receive advance notification of the required preliminary facility walkthrough for facilities being released by the construction supervisor or contractor. A minimum advance notice of 3 working days is required to allow for scheduling of personnel.
2. Participate in the preliminary walkthrough of the facility.
3. Ensure that all fire protection systems have been accepted (i.e., successfully acceptance-tested) according to Section 5.6 of this document.
4. Develop a list of fire protection and life safety deficiencies or concerns.
5. Submit the list of deficiencies or concerns generated during the preliminary walkthrough to the responsible Facility Coordinator and/or facility safety head for existing facility modifications or to the project engineer for new construction.
6. Validate the closure of identified fire protection and life safety deficiencies and concerns.
7. Shall notify the Facility Coordinator/Facility Safety Head or the project engineer of proper closure of fire protection and life safety deficiencies and concerns.
8. Shall notify the Facility Coordinator/Facility Safety Head or the project engineer of remaining fire protection and life safety deficiencies and concerns.

Facility Coordinator/Facility Safety Head or Project Engineer shall notify the LaRC Fire Chief when all identified fire protection and life safety deficiencies and concerns have been corrected.

4.3.4 RESPONSIBILITIES

Facility Coordinator/Facility Safety Head or Project Engineer shall notify the LaRC Fire Chief when facility modifications or new construction is scheduled for acceptance walkthrough.

LaRC Fire Chief shall complete the duties outlined in this section.

Construction Supervisor or shall provide advanced notice of acceptance tests.

4.4 FIRE PROTECTION DESIGN/DOCUMENT REVIEW PROCESS

4.4.1 PURPOSE

This section delineates the documents requiring LaRC Fire Chief or designee review.

4.4.2 SCOPE

This section shall apply to the review of work orders/job packages, preliminary planning documents, and design documents for construction projects, including construction submittals for fire protection systems.

October 3, 2004

LPR 1710.11

4.4.3 REQUIREMENTS

4.4.3.1 Work Orders/Maintenance Job Packages

LaRC Fire Chief or Designee shall perform fire protection review of work orders provided by the Center Operations Directorate for fire protection and life safety concerns.

The reviewer shall:

1. Sign the work order package if, after reviewing work orders, it is determined that there are no fire protection or life safety concerns or that such concerns are adequately addressed.
2. Note special fire protection/life safety/building safety/system safety requirements or unaddressed concerns in writing as deemed necessary to indicate additional action required before plans are acceptable.
3. Sign the review form after appropriate action has been taken to correct/address the noted concerns.

Work shall not commence until work orders are signed by the LaRC Fire Chief or designee and other required reviewers.

4.4.3.2 Preliminary Planning Documents

Center Operations Directorate shall submit preliminary planning documents and/or drawings for review at the earliest possible time.

LaRC Fire Chief or Designee shall:

1. Perform fire protection reviews of all preliminary planning documents including the following:
 - Data sheets
 - Conceptual design reports
 - Project design standards
 - Conceptual design drawings
2. Prepare and submit written comments on the fire protection review comment record.
3. Consult with document originator to clarify review comments, as necessary.

4.4.3.3 Design Documents

Center Operations Directorate shall submit preliminary planning documents, including sketches, plot plans, drawings, calculations, and other pertinent design data for review.

LaRC Fire Chief or Designee shall:

1. Perform fire protection reviews of all design documents including:
 - Design criteria reports

October 3, 2004

LPR 1710.11

- Design/Construction criteria
 - Design basis documents (including fire hazard analyses)
 - Job plans
 - Quality Control checklist
 - Design calculations (related to fire protection)
 - Preliminary safety analysis reports
 - Fire hazard analysis (To the extent required)
2. Prepare and submit written comments.
 3. Consult with document originator to clarify review comments, if necessary.

4.4.3.4 Construction Submittals for Fire Protection Systems

Center Operations Directorate shall submit construction submittals for review.

LaRC Fire Chief or Designee shall:

1. Perform fire protection reviews of all construction submittals (shop drawings, catalog data including manufacturer's installation instructions, test plans, and special test reports) for all fire protection systems including the following:
 - Automatic sprinkler systems
 - Special extinguishing systems (e.g., carbon dioxide, dry chemical, water spray)
 - Underground fire mains, valves, etc.
 - Fire hydrants
 - Fire pumps and water storage structures
 - Fire detection and alarm systems
 - Safety interlocks for fuel-fired equipment
2. Stamp and sign construction submittals for fire protection systems which are acceptable. Reviewer may stamp plans as "Acceptable, With Comments." Submittal originator properly addresses comments.
3. Prepare and submit written comments for those submittals not acceptable.
4. Consult with document originator to clarify review comments, as necessary.

4.4.4 RESPONSIBILITIES

Document Originator (Center Operations Directorate) shall:

1. Submit work order, preliminary planning documents for construction projects, design document for construction projects, and construction submittals for fire protection systems for review by LaRC Fire Chief or designee.

October 3, 2004

LPR 1710.11

2. Initiate comment resolution and ensures that prompt action is taken with the design team to resolve comments prior to permitting work to commence.

Center Operations Directorate shall

1. Provide the work orders to the LaRC Fire Chief for review.
2. Ensure that fire protection and life safety concerns are adequately addressed before releasing work orders.

LaRC Fire Chief or Designee shall conduct the reviews as outlined in this section.

CHAPTER 5**5. FIRE PROTECTION EQUIPMENT AND SYSTEMS
(OPERATIONS AND RELIABILITY)****5.1 FIRE PROTECTION SYSTEM IMPAIRMENTS****5.1.1 PURPOSE**

This section establishes a means to control fire protection system impairments.

Note: Fire protection system impairments are controlled by limiting impairments to those that are essential, by ensuring that the impairments are restored as quickly as possible, and by ensuring that adequate interim compensatory measures are specified and implemented during impairments.

5.1.2 SCOPE

This standard shall apply to all personnel who may impair a fire protection system at LaRC.

Note: This standard shall not apply to impairments during the normal and usual preventive maintenance inspections and testing of fire protection systems as required by NFPA standards and LaRC standards. However, if a fire protection system must be left impaired following a normal preventive maintenance inspection or test, this impairment standard does apply.

5.1.3 REQUIREMENTS

Requests for fire protection system impairments shall be made to the LaRC Fire Chief by the Facility Coordinator and/or Facility Safety Head, or the maintenance supervisor.

The impairment request shall be evaluated to determine the effect on the overall Center fire protection system and shall include the following:

1. Reason for the impairment.
2. Number of hydrants, sprinkler systems, detection systems, and other equipment affected. Provide the fire department with a diagram or map of all adjacent fire protection which is in service.
4. Estimated duration of impairment.
5. Other sections or systems already out of service.
6. Impact on overall Center operation.

In an emergency, such as an underground main rupture, prompt action shall be taken to isolate the area prior to permit completion.

An emergency condition shall be immediately reported to the Emergency Dispatch Office (EDO) and duty officer. The EDO shall notify the LaRC Fire Chief.

The LaRC Fire Chief shall log the affected fire protection systems as out-of-service.

October 3, 2004

LPR 1710.11

Before a fire protection system is shut off, interim protective measures to reduce the fire risk shall be taken.

Work shall begin as soon as interim protective measures are instituted and the system(s) are shut off. If the impairment involves a fixed system (such as automatic sprinkler or standpipe systems), work shall continue around the clock until the system is returned to service.

The Facility Coordinator and/or Facility Safety Head shall assign an employee to patrol (fire watch) the area, as prescribed in Section 7.4 of this document, until protection is restored. If a fire occurs, the fire watch must notify the LaRC Fire Department. If the impairment continues after normal working hours, a request for Security Management and Safeguards Team personnel to perform fire watch duties shall be made.

Any valve affected by the impairment shall be tagged after the valve is closed. The fire systems maintenance personnel shall prepare a red tag in accordance with LPR 1710.10, " Safety Clearance Procedures."

If additional protection is required, temporary feed lines (such as temporary piping, hose lines, or electrical service) shall be installed.

The emergency fire dispatcher shall enter the following information in a manner approved by the NASA Fire Chief:

1. Date of impairment.
2. Time of impairment (military).
3. Control tag number.
4. Equipment tagged out.
5. Reason for impairment.
6. Name and badge number of person placing the control tag.
7. Interim protective measures.

The fire system maintenance personnel shall check repair progress, including tagged equipment, at least once per shift.

When the fire protection system is restored, the fire system maintenance personnel shall inspect the affected system to ensure that equipment is operational.

A 2-inch drain test shall be conducted on sprinkler systems affected by an impairment, and the results shall be recorded on the impairment control tag. Hydrostatic testing shall be witnessed if requested by the fire system maintenance personnel.

After removing the red tag, the fire system maintenance personnel shall enter the following information on the Fire Protection Impairment Log:

1. Date and time the control was terminated.
2. System tested.

The LaRC Fire Chief shall be notified that testing is completed.

October 3, 2004

LPR 1710.11

The fire system maintenance personnel shall notify the emergency fire dispatcher that the repairs are completed and all systems are in service.

The EDO shall reset supervisory alarms and log all systems in service.

5.1.4 RESPONSIBILITIES

Fire System Maintenance Personnel shall

1. Comply with requirements delineated in this section when impairing a fire protection system and those applicable requirements contained in NFPA Codes.
2. Ensure that impairments are restored in a timely manner.
3. Monitor the restoration process until the fire protection system is fully operational.
4. Identify to the Facility Coordinator and/or Facility Safety Head actions required to minimize the damage from fire during outages.

LaRC Fire Chief shall perform tasks as delineated in this section.

Emergency Fire Dispatcher shall perform tasks as delineated in this section.

5.2 UTILITY IMPAIRMENTS AFFECTING FIRE PROTECTION SYSTEMS

5.2.1 PURPOSE

This section establishes the requirements for planned and emergency utility outages that affect fire protection.

5.2.2 SCOPE

This standard shall apply to all personnel who may impair a utility system which affects fire protection at LaRC.

Note: This standard shall not apply to impairments during the normal and usual preventive maintenance inspections and testing of utility systems as required by LaRC standards. However, if a fire protection system is impaired as a result of a normal and usual preventive maintenance inspection or test, this impairment standard shall apply.

5.2.3 REQUIREMENTS

The Center Operations Directorate shall notify the Emergency Dispatch Office (EDO) 24 hours in advance of all planned utility outages. Immediate notification shall be made to the LaRC Fire Chief in the event of an emergency outage:

1. The emergency fire dispatcher shall notify the LaRC Fire Chief and fire system maintenance personnel.
2. Utility outages in excess of 24 hours shall require the implementation of Section 5.1 of this document.

The LaRC Fire Chief shall determine if fire protection systems will be affected by the utility outage. If fire protection is affected, the LaRC Fire Chief shall follow the requirements of Section 5.1.

October 3, 2004

LPR 1710.11

The LaRC Fire Chief shall ensure that the affected fire protection system is logged out-of-service.

The Facility Coordinator and/or Facility Safety Head shall assign an employee to patrol (fire watch) the area, as prescribed in Sections 5.1 and 7.4 of this document until protection is restored.

If additional protection is required, temporary feed lines (such as temporary piping, hose lines, or electrical service) shall be installed.

The Center Operations Directorate shall notify the emergency fire dispatcher when the utility system is placed back in regular service.

5.2.4 RESPONSIBILITIES

Center Operations Directorate shall:

1. Comply with requirements delineated in this section when impairing a utility system which affects fire protection aspects.
2. Ensure that utility impairments are restored in a timely manner.

LaRC Fire Chief shall:

1. Perform tasks as delineated in this standard.
2. Identify to the Facility Coordinator and/or Facility Safety Head actions required to minimize the damage from fire during outages.

Facility Coordinator and/or Facility Safety Head shall implement the necessary interim compensatory measures as required by the LaRC Fire Chief.

Emergency Fire Dispatcher shall complete the tasks delineated in this section.

5.3 FIRE PROTECTION SYSTEM WINTERIZATION

5.3.1 PURPOSE

This section establishes the requirements for developing a winterization plan to ensure that fire protection systems are protected against cold weather conditions.

5.3.2 SCOPE

This standard shall apply to all water-based fire protection systems at LaRC.

5.3.3 REQUIREMENTS

5.3.3.1 Annual Inspections

The fire system maintenance personnel shall inspect each facility each October to ensure that all areas are winterized to protect the installed fire protection systems.

This annual inspection shall include the following items (as a minimum):

1. Condition/operation and adequacy of heating systems (e.g., forced air, radiant heaters, portable heaters).
2. Condition/operation of thermostats and filters.

October 3, 2004

LPR 1710.11

3. Condition/operation/installation of heat tape systems.
4. Draining of sprinkler system drip lines, fire pump hose headers, dry pipe sprinkler system air compressors, and dry system drum drip auxiliary drains.

5.3.3.2 Documenting and Correcting Deficiencies Resulting from Annual Inspections

Any deficiencies identified must be documented. Corrective action to repair or resolve the deficient condition shall be initiated immediately.

5.3.3.3 Inspection Records of Inspections

Winterization inspection records shall be maintained.

5.3.3.4 Preventing Fire Systems from Freezing

All areas where fire systems are installed shall be provided with sufficient heat and/or noncombustible insulation to prevent freezing and/or equipment damage.

5.3.3.5 Permanent Engineered Freeze Protection

Temporary freeze protection measures (such as portable heaters) shall not be used as a permanent means of freeze protection for fire protection systems. Permanent protection (such as forced hot air, fixed radiant heaters, insulation) must be provided.

5.3.3.6 Use of Heat Tape and Portable Heaters for Freeze Protection

Heat tape and portable heaters shall be used to winterize existing fire protection systems only if and when engineered protection measures are not readily available or feasible. If such measures must be used, the following restrictions must be observed.

Portable heaters used for temporary fire protection system freeze protection must comply with Section 7.5 of this document.

If heat tape is to be used as the primary heat source to prevent existing fire suppression system piping from freezing, the following conditions must be met:

1. The heat tape used shall be Underwriters Laboratories Inc. (UL) listed for its intended use (e.g., specifically tested for the use on metal pipe with insulation).
2. The heat tape shall be self-regulating.
3. Noncombustible insulation shall be used over the pipe and heat tape.
4. The fire system pipe temperature shall be monitored by a system that includes a mechanism to transmit a trouble alarm to the communication center if the pipe temperature drops below 45°F.
5. Heat tape shall not be used for new system designs. An exception to this rule is that heat tape in compliance with the other requirements of this standard may be used to prevent fire system risers in unheated trailer crawl spaces from freezing.
6. All heat tape installations shall be approved by the LaRC Fire Chief.

October 3, 2004

LPR 1710.11

5.4 NONEMERGENCY USE OF FIRE HYDRANTS

5.4.1 PURPOSE

This section provides the requirements and responsibilities for the nonemergency use of fire hydrants.

5.4.2 SCOPE

This standard shall apply to NASA facilities, operations and activities where water is being drawn from a LaRC fire hydrant.

Note: This standard shall not apply to fire hydrant/water supply testing.

5.4.3 REQUIREMENTS

Requests for the nonemergency use of fire hydrants shall be made to the LaRC Fire Chief prior to use. The request for use must contain the following information:

1. Hydrant(s) location(s) and number(s).
2. Date and duration of use.
3. Responsible contact person.
4. Duty officer notified.

Requests for nonemergency use of fire hydrants shall be approved by the LaRC Fire Chief with the following restrictions:

1. The hydrant user shall install one valve on the 4-inch port on each hydrant being used. This 4-inch port with the valve installed must be reserved for LaRC Fire Department use only.
2. One or both of the 2 1/2 -inch fire hydrant ports must be reserved for nonemergency use only. The hydrant user shall provide an approved 2 1/2-inch gate valve on one or both of the 2 1/2-inch fire hydrant ports, reduced down to 1 1/2 inches.
3. The hydrant user shall provide the estimated duration of impairment and the amount of water to be used
4. Other sections or systems are not already out of service.
5. The requested use does not affect overall Center operation.

5.5 INSPECTION, TESTING, AND MAINTENANCE DOCUMENTATION REVIEW AND ANALYSIS

5.5.1 PURPOSE

This section establishes a system for controlling fire protection inspection, testing, and maintenance documentation to ensure review for determining the expected remaining life for fire protection equipment and, when necessary, for extending that life.

October 3, 2004

LPR 1710.11

A life extension program shall provide the technical rationale for allowing aging fire protection equipment, particularly equipment beyond its nominal life expectancy, to continue to operate.

5.5.2 SCOPE

This section shall apply to all fire protection inspection, testing, and maintenance activities at LaRC.

5.5.3 REQUIREMENTS

5.5.3.1 General

Documentation must be generated for all inspection, testing, and maintenance activities. Thorough inspection, testing, and maintenance activities in association with detailed documentation shall reduce costs:

1. Anticipate failures, allowing downtime to be scheduled when it causes the least disruption
2. Assess the consequences of failures, allowing maintenance resources to be targeted in a manner to minimize the probability of occurrence of the worst consequences
3. Prevent failures and the consequences which are unacceptable or more costly than the effort to prevent them
4. Expedite repairs in the most effective way and identify the alternate means of operation to be used when failures occur
5. Provide the tools for self-diagnosis and correction where the program is ineffective

Inspection, testing, and maintenance activities shall provide meaningful evaluation of the adequacy of the equipment for both deployment and implementation.

5.5.3.2 Generation and Management of Documentation

Surveillances and inspections shall be key activities in both maintenance and life extension.

Maintenance inspections shall be designed to determine whether or not the equipment being inspected will operate safely until the next scheduled inspection.

Each inspection, testing, and maintenance activity shall be designed to add confidence to a calculated estimated remaining life.

Inspection, testing, and maintenance documentation shall be reviewed for evidence of equipment aging and wear.

Because every piece of equipment ages differently, records shall be reviewed to determine if the equipment has reached the end of its useful life by one of the following three ways:

October 3, 2004

LPR 1710.11

1. Accumulated damage producing conditions in a major component that prevent the equipment from being safely operated
2. Grouped components deteriorating to the point where the effort needed to inspect and replace individual components becomes intolerable, or the components begin to fail in service between inspections
3. A catastrophic failure damaging the equipment beyond repair

The nominal life expectancy of equipment shall be established using accepted industry practices and experience, based on design specification. The design life may or may not equal the nominal life expectancy.

The expected remaining life for each piece of equipment or system shall be estimated based on the review of the inspection, testing, and maintenance documentation. The expected remaining life shall be represented as a range of values or a period of time after which the probability of failure becomes unacceptably high. The remaining life estimate shall be refined based on equipment history, measurements of accumulated damage, and mathematical techniques. Not all equipment can be analyzed for remaining life. For example, motors, generators, and transformers have electrical winding insulation systems that cannot be economically and reliably modeled

Inspection, testing, and maintenance records (including plans, checklists, notes, reports, and other records associated with the establishment, completion and verification of corrective actions for fire protection issues) shall be temporary records maintained by the appropriate section or department. Inspection, testing, and maintenance documentation shall be retained for the life of the system.

5.5.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Establish a facility fire protection equipment inspection program which produces useful documentation.
2. Maintain and review the fire protection equipment inspection, testing, and maintenance documentation to determine life expectancy.

LaRC Fire Chief shall:

1. Establish the nominal life expectancy for fire protection equipment.
2. Assist the Facility Coordinator and/or Facility Safety Head in reviewing the inspection, testing, and maintenance documentation.

5.6 INSPECTION, TESTING, AND, MAINTENANCE MATRIX

5.6.1 PURPOSE

This section establishes the inspection, testing, and maintenance frequencies for equipment and systems used at LaRC.

5.6.2 SCOPE

This section shall apply to all fire protection equipment and systems at LaRC.

October 3, 2004

LPR 1710.11

5.6.3 REQUIREMENTS

5.6.3.1 General

All water-based fire protection equipment and systems shall be inspected at the frequencies indicated in National Fire Protection Association (NFPA) 25, except for specified deviations approved by the LaRC Fire Chief

When supported by historical documentation, technology, or sound fire protection engineering judgment, the NFPA inspection, testing, and maintenance frequency shall be modified by the LaRC Fire Chief.

5.6.3.2 Fire Barriers and Walls

Floor-ceiling assemblies and bearing and nonbearing wall or partition assemblies used as fire barriers to form fire compartments shall be designed and construction tested to meet the conditions of acceptance in NFPA 251.

Once accepted, the fire barrier shall not require further attention unless it is modified.

5.6.3.3 Fire Doors and Dampers

Fire door and damper assemblies shall be designed and constructed to meet the requirements of NFPA 80.

Fire door and dampers shall be inspected, tested and maintained in accordance with Table 5.1.

Table 5.1, Inspecting, Testing, and Maintaining: Fire Doors and Dampers.

Component	Activity	LaRC Frequency	Component	Activity	LaRC Frequency
Door	Inspection	Annually	Auto closing doors	Test	Annually
Closer	Inspection	Annually	Sliding/Rolling doors	Test	Annually
Latch	Inspection	Annually	Doors	Maintenance	As needed
Hinges	Inspection	Annually	Fire dampers	Inspection	Annually
Coordinator	Inspection	Annually	Fire dampers	Test	Annually
Chains and cables	Inspection	Annually	Fire dampers	Maintenance	Annually

5.6.3.4 Valves and Fire Department Connections

Valves and fire department connections shall be designed and installed to meet the requirements of NFPA 13.

Valves and fire department connections shall be inspected, tested and maintained in accordance with Table 5.2.

October 3, 2004

LPR 1710.11

Table 5.2, Inspecting, Testing, and Maintaining: Valves and Fire Department Connections.

Component	Activity	LaRC Frequency	Component	Activity	LaRC Frequency
Control Valve Sealed Locked Tamper switch	Inspection Inspection Inspection	Monthly Monthly Monthly	Preaction/Deluge Valve Priming water Low air pressure alarms Full flow	Test Test Test	Quarterly Quarterly Quarterly
Alarm Valve Exterior Interior Strainers, filters, orifices	Inspection Inspection Inspection	Monthly 5 years 5 years	Control Valve Position Operation Supervisory	Test Test Test	Quarterly Annually Quarterly
Check Valve Interior	Inspection	5 years	Water Flow Alarm	Test	Quarterly
Preaction/Deluge Valve Enclosure (during cold weather) Exterior Interior Strainers, filters, orifices	Inspection Inspection Inspection Inspection	Monthly Monthly Annually Annually	Dry Pipe Valves/Quick-Opening Devices Priming water Low air pressure alarm Quick-opening devices Trip test Full flow trip test	Test Test Test Test Test	Annually Quarterly Quarterly Annually 3 years
Dry Pipe Valves/Quick-Opening Devices Enclosure Enclosure (during cold weather) Exterior Interior Strainers, filters, orifices	Inspection Inspection Inspection Inspection	Monthly Monthly Monthly Annually	Pressure Regulating and Relief Valves Sprinkler system Circulation relief Pressure relief valve Hose connection Hose rack	Test Test Test Test Test	Annually Annually Annually Annually 5 years
Pressure Regulating and Relief Valves Sprinkler systems Hose connection Hose rack Fire pump: Casing relief valve Pressure relief valve	Inspection Inspection Inspection Inspection Inspection	Monthly Annually Annually Annually Annually	Backflow Prevention Assemblies Reduced pressure Reduced pressure detector	Inspection Inspection	Monthly Monthly
Backflow Prevention Assemblies	Test	Annually	Control Valve	Maintenance	Annually
Fire Department Connections	Inspection	Monthly	Preaction/Deluge Valve	Maintenance	Annually
Main Drain	Test	Quarterly	Dry Pipe Valve/Quick-Opening Device	Maintenance	Annually

5.6.3.5 Deluge/Water Spray Systems

Deluge/water spray systems shall be designed and installed to meet the requirements of NFPA 15 and/or NFPA 16.

Deluge and water spray systems shall be inspected, tested and maintained in accordance with Table 5.3.

October 3, 2004

LPR 1710.11

Table 5.3, Inspecting, Testing, and Maintaining: Deluge/Water Spray Fixed Systems.

Component	Activity	LaRC Frequency
Check valves (interior)	Inspection	Monthly
Control valves (sealed)	Inspection	Monthly
Control valves (locked, supervised)	Inspection	Monthly
Deluge valve (exterior)	Inspection	Monthly
Detection systems	Inspection	Monthly
Drainage	Inspection	Quarterly
Fittings	Inspection	Monthly
Fittings (rubber-gasketed)	Inspection	Monthly
Hangers	Inspection	Monthly
Nozzles	Inspection	Monthly
Pipe	Inspection	Monthly
Strainers	Inspection	Annually
Supports	Inspection	Annually
Water supply piping	Inspection	Monthly
Heat (deluge valve house)	Inspection	Daily/weekly
Control valves	Operational test	Quarterly
Deluge valve	Operational test	Quarterly
Detection systems	Operational test	Annually
Flushing	Operational test	Quarterly
Main drain test	Operational test	Quarterly
Manual release	Operational test	Annually
Nozzles	Operational test	Annually
Strainers	Operational test	Annually
Water flow alarm	Operational test	Weekly
Water spray system test	Operational test	Quarterly
Deluge valve	Maintenance	Annually
Detection systems	Maintenance	Annually
Strainers	Maintenance	Annually
Strainers (baskets/screen)	Maintenance	5 years
Water spray system	Maintenance	Annually

5.6.3.6 Carbon Dioxide Suppression Systems

Carbon dioxide suppression systems shall be designed and installed to meet the requirements of NFPA 12. Carbon dioxide suppression systems shall be inspected, tested and maintained in accordance with Table 5.4.

October 3, 2004

LPR 1710.11

Table 5.4, Inspecting, Testing, and Maintaining: Carbon Dioxide Suppression Systems.

Component	Activity	LaRC Frequency
Nozzles	Inspection	Annually
Enclosure doors	Inspection	Annually
Protected hazards	Inspection	Annually
Liquid level	Inspection	Annually
Cylinders (leakage)	Inspection	Annually
Flexible hoses and connections	Inspection	Annually
High-pressure cylinders weighed	Test	Annually
High-pressure control valves	Test	Annually
System actuation	Test	Annually
Full system discharge	Test	12 years
System components	Maintenance	As needed
Hose hydrostatic test	Maintenance	5 years
Cylinder hydrostatic test	Maintenance	12 years

5.6.3.7 Portable Fire Extinguishers

Portable fire extinguishers shall be installed to meet the requirements of NFPA 10. Portable fire extinguishers shall be inspected, tested and maintained in accordance with Table 5.5.

Table 5.5, Inspecting, Testing, and Maintaining: Portable Fire Extinguishers.

Extinguisher Type	Visual Inspection	Hydrostatic Test Interval	Maintenance
Stored pressure	Monthly	5 years	Annually
Wetting agent	Monthly	5 years	Annually
Foam/ AFFF	Monthly	5 years	Annually
Dry chemical (SS)	Monthly	5 years	Annually*
Carbon dioxide	Monthly	5 years	Annually
Dry chemical (stored pressure; AS, BB, MS, SS)	Monthly	12 years	Annually*
Dry chemical (cartridge operated, MS)	Monthly	12 years	Annually
Halon 1301	Monthly	12 years	Annually
Halon 1211 (MS)	Monthly	12 years	Annually

AS - Aluminum Shell; BB - Brazed Brass Shell; MS - Mild Steel Shell; SS - Stainless Steel Shell

* Internal examination is not required at annual maintenance for stored pressure dry chemical fire extinguishers.

5.6.3.8 Fire Pumps

Fire pumps shall be designed and installed to meet the requirements of NFPA 20.

Fire pumps shall be inspected, tested and maintained in accordance with Table 5.6.

October 3, 2004

LPR 1710.11

Table 5.6, Inspecting, Testing, and Maintaining: Fire Pumps

Component	Activity	LaRC Frequency
Pump house, heating	Inspection	Weekly
Pump house, ventilating louvers	Inspection	Weekly
Fire pump system	Inspection	Weekly
Pump operation, no-flow condition	Test	Weekly
Pump operation, flow condition	Test	Annually
Hydraulic	Maintenance	Annually
Mechanical transmission	Maintenance	Annually
Electrical system	Maintenance	As needed
Controller, various components	Maintenance	As needed
Motor	Maintenance	Annually
Diesel engine system, various components	Maintenance	As needed

5.6.3.9 Fire Water Systems and Fire Hydrants

Fire water systems and fire hydrants shall be designed and installed to meet the requirements of NFPA 24.

Fire water systems and fire hydrants shall be inspected, tested and maintained in accordance with Table 5.7.

Table 5.7, Inspecting, Testing, and Maintaining: Private Fire Service Mains.

Component	Activity	LaRC Frequency
Hydrants (dry barrel and wall)	Inspection	Annually and after each operation
Monitor nozzles	Inspection	Semiannually
Mainline strainers	Inspection	Annually and after each significant flow
Piping (exposed)	Inspection	Annually
Monitor nozzles	Test	Flow annually
Hydrants	Test	Semiannually
Piping (exposed and underground)	Gradient flow test	5 years
Mainline strainers	Maintenance	Annually and after each operation
Hydrants	Maintenance	Annually
Monitor nozzles	Maintenance	Annually

5.6.3.10 Standpipe Systems

Standpipe systems shall be designed and installed to meet the requirements of NFPA 14.

Standpipe systems shall be inspected, tested and maintained in accordance with Table 5.8.

October 3, 2004

LPR 1710.11

Table 5.8, Inspecting, Testing, and Maintaining: Standpipe and Hose Systems.

Component	Activity	LaRC Frequency
Control valves	Inspection	Weekly/Monthly
Pressure regulating devices	Inspection	Quarterly
Piping	Inspection	Quarterly
Hose connections	Inspection	Annually
Cabinet	Inspection	Annually
Hose	Inspection	Removing hose
Hose storage device	Inspection	Annually
Alarm device	Test	Quarterly
Hose nozzle	Test	Annually
Hose storage device	Test	Annually
Hose	Test	Removing hose
Pressure control valve	Test	5 years
Pressure reducing valve	Test	5 years
Hydrostatic test	Test	5 years
Flow test	Test	5 years
Hose connections	Maintenance	Annually
Valves (all types)	Maintenance	Annually

5.6.3.11 Facility Emergency Lights

Facility emergency lights shall be designed and installed to meet the requirements of NFPA 101.

Facility emergency lights shall be inspected, tested and maintained in accordance with Table 5.9 and Section 6.3 of this LPR.

Table 5.9, Inspecting, Testing, and Maintaining: Facility Emergency Lights.

Component	Activity	LaRC Frequency
Battery operated unit	Inspection	Biannually
Battery operated unit	30-second test	Biannually
Battery operated unit	1.5-hour test	Not performed

October 3, 2004

LPR 1710.11

5.6.3.12 Water Storage Tanks

Water storage tanks are designed and installed to meet the requirements of NFPA 22.

Water storage tanks are inspected, tested and maintained in accordance with Table 5.10.

Table 5.10, Inspecting, Testing, and Maintaining: Water Storage Tanks.

Component	Activity	LaRC Frequency
Condition of water in tank	Inspection	Annually
Water temperature	Inspection	Daily/Weekly*
Heating system	Inspection	Daily/Weekly
Control valves	Inspection	Daily/Weekly
Water level	Inspection	Weekly/Monthly
Tank exterior	Inspection	Quarterly
Support structure	Inspection	Quarterly
Catwalks and ladders	Inspection	Quarterly
Surrounding area	Inspection	Quarterly
Hoops and grille	Inspection	Annually
Painted/coated surfaces	Inspection	Annually
Expansion joints	Inspection	Annually
Interior	Inspection	5 years/3 years
Check valves	Inspection	5 years
Temperature alarms	Test	Monthly
High-temp. limit switches	Test	Monthly
Water level alarms	Test	Semiannually
Level indicators	Test	5 years
Pressure gauges	Test	5 years
Water level	Maintenance	As needed
Drain sediment	Maintenance	Semiannually
Thermostats	Maintenance	As Needed
Cathodic protection	Maintenance	Annually
Drain valves cycled	Maintenance	Annually
Vent screen	Maintenance	Annually
Control valves	Maintenance	Annually
Repainting—steel	Maintenance	As needed
Embankment-supported rubberized fabric (ESRF)	Maintenance	As needed
Check valves	Maintenance	As needed

* Cold weather/heating season only.

October 3, 2004

LPR 1710.11

5.6.3.13 Fire Alarm and Detection Systems

Fire alarm and detection systems shall be designed and installed to meet the requirements of NFPA 72.

Fire alarm and detection systems shall be inspected, tested and maintained in accordance with Table 5.11.

Table 5.11, Inspecting, Testing, and Maintaining: Fire Alarm and Detection Systems.

Component	Activity	LaRC Frequency
Alarm Appliances		
Audible devices	Inspection	Annually
Speakers	Inspection	Annually
Visible devices	Inspection	Annually
Batteries	Inspection	Monthly
Charger test (replace battery as needed)	Test	Annually
Discharge test (30 minutes)	Test	Annually
Load voltage test	Test	Annually
Specific gravity	Test	Annually
Control Equipment		
Functions	Test	Annually
Fuses	Inspection/Test	Annually/Annually
Interfaced equipment	Inspection/Test	Annually/Annually
Lamps and LEDs	Inspection/Test	Annually/Annually
Primary (main) power supply	Inspection/Test	Annually/Annually
Transponders	Test	Annually
Control Panel Trouble Signals	Inspection/Test	Annually
Voice Communications Equipment	Inspection/Test	Annually
Fiber-Optic Cable Connections	Inspection/Test	Annually/Annually
Guard's Tour Equipment	Inspection/Test	Annually
Initiating Devices		
Air sampling	Inspection	Annually
Duct detectors	Inspection/Test	Annually
Electromechanical Releasing device	Inspection/Test	Annually
Extinguishing system switches	Inspection/Test	Annually
Fire alarm boxes	Inspection/Test	Annually
Heat detectors	Inspection/Test	Annually
Radiant energy fire Detectors	Inspection/Test	Annually
Smoke detectors	Inspection	Annually
Functional	Test	Annually
Sensitivity (see 7-3.2.1.)	Test	Annually
Supervisory signal devices	Inspection/Test	Annually
Water flow devices	Inspection/Test	Quarterly
Fuel-gas and other detectors	Test	Semiannually
Special Procedures	Inspection/Test	Annually
Transient Suppressors	Inspection	Annually

October 3, 2004

LPR 1710.11

5.6.4 RESPONSIBILITIES

The LaRC Fire Chief is responsible for ensuring that inspection, testing, and maintenance operations are conducted as noted in this section.

October 3, 2004

LPR 1710.11

CHAPTER 6**6. LIFE SAFETY****6.1 MEANS OF EGRESS****6.1.1 PURPOSE**

This section delineates the processes and requirements for maintaining the means of egress in LaRC facilities.

6.1.2 SCOPE

This section shall apply to all normally occupied LaRC facilities, structures, facilities, and operations.

6.1.3 REQUIREMENTS**6.1.3.1 Design and Construction of Means of Egress**

Center Operations Directorate shall:

1. Ensure that all new facility designs or modifications under their jurisdiction incorporate the requirements of NFPA 101, Code for the Safety to Life from Fire in Buildings and Structures (a.k.a., Life Safety Code).
2. Ensure that all new facility designs or modifications under its jurisdiction incorporate the requirements of Section 4.1 of this document.
3. Submit all facility designs and modifications to the LaRC Fire Chief for review and approval.

The LaRC Fire Chief shall review and approve all new designs and modifications to ensure that life safety is adequate to meet the specified criteria.

6.1.3.2 Maintaining Life Safety in Facilities

Facility Coordinator and/or Facility Safety Head shall:

1. Ensure that all facility exits and means of egress are maintained clear and unobstructed.
2. Ensure that material is not stored in stairwells or corridors of facilities.
3. Ensure that operations barriers such as roped areas do not affect exit routes.
4. Ensure that life safety features take precedence over security or operations features.
5. Ensure that no furnishings, decorations, or other objects obstruct the means of egress.

October 3, 2004

LPR 1710.11

6. Ensure that exit doors are maintained in good operating condition:
 - Doors in the means of egress shall not be locked to prevent unobstructed exiting, unless specific approval is obtained from the LaRC Fire Chief.
 - Doors in the means of egress shall not require more than one action to open, unless specific approval is obtained from the LaRC Fire Chief
 - Fire doors must not be blocked open.
7. Ensure that automatic sprinkler systems, fire detection and alarm systems, exit lighting, fire doors, and other fire protection features required by the Life Safety Code are continuously maintained in operating condition or that interim compensatory measures are implemented.
8. Ensure that interior finishes are maintained noncombustible or flame resistant.
9. Ensure that freestanding partitions and space dividers are manufactured of limited combustible materials and that fabric coverings are flame resistant.

The LaRC Fire Chief shall ensure performance of routine fire protection facility assessments to evaluate life safety components and shall ensure that an acceptable degree of life safety is provided.

The Fire Department station officer shall perform housekeeping inspections of facilities on a routine basis to ensure that means of egress are maintained free of storage and are unobstructed.

6.1.4 RESPONSIBILITIES

Center Operations Directorate shall ensure that each facility is designed with the required life safety features.

Facility Coordinator and/or Facility Safety Head shall:

1. Ensures that an acceptable degree of life safety is provided by following the practices delineated in this section.
2. Contacts the LaRC Fire Chief before establishing a new use for a facility or structure or modifying existing facilities or structures.

LaRC Fire Chief shall evaluate the design and operation of facilities and structures to ensure that the requirements of this section are met.

Fire Department Station Officer shall ensure that an acceptable degree of life safety is provided in facilities by performing periodic facility inspections and maintaining documentation of all inspections.

6.2 FACILITY EVACUATION PLANS

6.2.1 PURPOSE

This section delineates the guidelines for evacuating personnel from LaRC facilities.

October 3, 2004

LPR 1710.11

6.2.2 SCOPE

This section shall apply to all normally occupied LaRC facilities, structures, facilities, and operations.

6.2.3 REQUIREMENTS/RESPONSIBILITIES

6.2.3.1 Facility Evacuation Diagrams

A facility evacuation diagram may be developed by a Facility Coordinator and/or Facility Safety Head. If one is developed, it must follow the requirements of this section.

Facility Coordinator and/or Facility Safety Head shall ensure that all evacuation routes are noted on a facility floor plan/diagram. To develop the evacuation diagrams, the following directions shall be used:

1. The facility floor diagram shall be as simple as possible. Note only walls, doors, stairs, or other pertinent structural features that are essential to egress.
2. Use directional arrows to illustrate the evacuation path.
3. Note on the diagram an assembly point for evacuating personnel that is a safe distance away from the facility.
4. Do not note other features, such as fire extinguishers, pull stations, nonrequired egress paths, and safety showers, as they only complicate the diagrams.

The LaRC Fire Chief shall review and approve all facility evacuation diagrams to ensure a safe and orderly evacuation of personnel. A sample facility evacuation plan is shown in Figure 6.1.

6.2.3.2 Personnel Evacuation Directions

All staff shall respond to an evacuation alarm by leaving the affected and/or alarmed area without delay and reporting to the designated assembly point, avoiding any obviously unsafe route while on the way. Special facility/operation hazards may require personnel to shelter in place.

Personnel shall make a visual check along the evacuation route for persons unable to evacuate, guide and assist them if possible without delaying evacuation or jeopardizing one's personal safety, and report such cases to the responding emergency personnel. Personnel shall perform only those necessary crash, panic, or scram shutdowns which can be done without delaying evacuation. Personnel shall stay at the designated assembly point until released by the emergency personnel.


6.2.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Ensure that evacuation routes are posted throughout the facility.
2. Ensure that an evacuation assembly point is designated for each facility.

LaRC Fire Chief shall evaluate the facility evacuation diagrams and the designated assembly points.

Figure 6.1, Sample Facility Evacuation Plan.

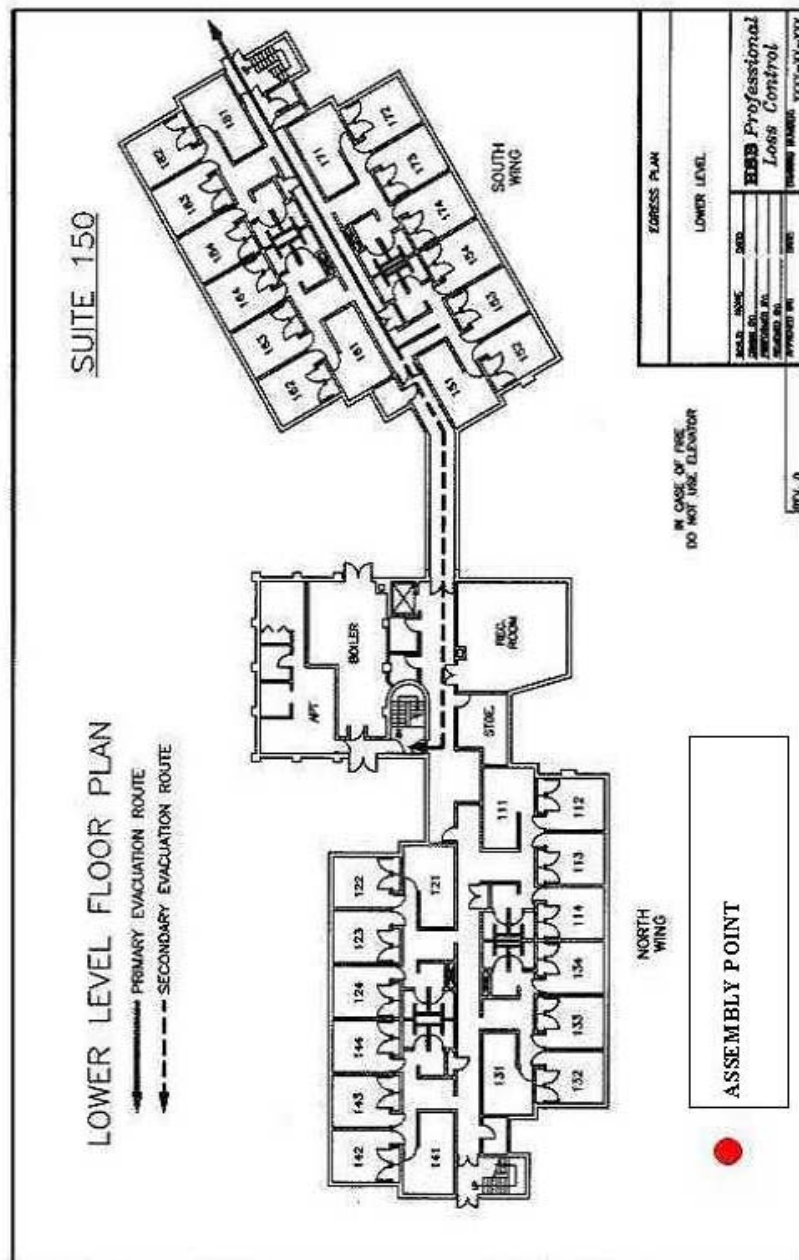

October 3, 2004

LPR 1710.11

6.3 FACILITY EMERGENCY LIGHTS

6.3.1 PURPOSE

This section provides the requirements and responsibilities pertaining to battery powered emergency lighting systems.

6.3.2 SCOPE

These requirements shall apply to all LaRC-managed facilities, operations, and activities, including facilities leased by NASA (to the extent that leased facility owners must be notified of emergency exit features in need of repair or maintenance).

6.3.3 REQUIREMENTS

6.3.3.1 Required Emergency Light Testing Program

Emergency lights shall be operationally tested semiannually for a minimum of 30 seconds. During this test, the lights shall be inspected to verify the following:

1. Electrical cords shall not be damaged, frayed, or longer than 36 inches
2. Lamps shall not be cracked or damaged
3. Units shall be securely mounted
4. Lamps shall be properly positioned to provide illumination for the required area(s)
5. Lamps shall illuminate within 10 seconds of switching to the backup power supply

All emergency lights shall be operationally tested annually. NFPA standards recommend a 1 1/2-hour operational test.

6.3.3.2 Operational Testing Documentation

All emergency light tests shall be documented and written records maintained at the LaRC Fire Department by assigned maintenance personnel.

Emergency lights that are found deficient shall be repaired within 24 hours, or portable emergency lights shall be provided at the affected area(s) until the permanent lights are restored to service.

6.3.4 RESPONSIBILITIES

The assigned maintenance personnel shall be responsible for testing all the battery powered emergency lighting units within their facility.

6.4 OCCUPANCY PERMIT APPROVAL

6.4.1 PURPOSE

This section outlines the occupancy requirements that must be completed and complied with before LaRC personnel occupy any newly constructed or renovated

October 3, 2004

LPR 1710.11

facilities/structures or areas, or before any changes in an existing occupancy classification are made.

6.4.2 SCOPE

This section shall apply to all activities at LaRC and all off-site locations leased by NASA for routine occupancy by LaRC personnel.

6.4.3 REQUIREMENTS

6.4.3.1 General

A Certificate of Beneficial Occupancy shall cover the period of time following construction/modification of an area or facility when the area substantially complies with all fire protection and Life Safety Code requirements but is not in full literal compliance with all Occupational Safety and Health Administration (OSHA), National Fire Protection Association (NFPA), NASA, and LaRC safety requirements. A Certificate of Final Occupancy shall cover the period of time following completion of all aspects of literal compliance with the referenced codes and standards.

A copy of the certificate shall be kept by the facility. The certificate shall be renewed as part of the fire protection engineering survey process.

No LaRC supervisor or employee shall attempt to occupy an area or facility or to operate any processes prior to the issuance of a Certificate of Beneficial Occupancy or a Certificate of Final Occupancy.

Before a Certificate of Beneficial Occupancy shall be issued, the area or facility must be inspected by the LaRC Fire Chief or designee to verify that no imminent danger or serious OSHA violations exist as the facility is presently constructed.

Technical safety deficiencies resulting in the issuance of a Certificate of Beneficial Occupancy rather than a Certificate of Final Occupancy shall be corrected in an expeditious manner, but in no case shall the Certificate of Beneficial Occupancy be valid in excess of 45 days.

Whenever a hazard which would be classified as an imminent danger violation of the OSHA standards is identified, the Facility Coordinator and/or Facility Safety Head immediately must take interim corrective actions (barricade, evacuate, and lock out). Permanent corrective actions shall be completed within 24 hours. Failure to complete corrective actions within 24 hours shall result in revocation of the Beneficial or Final Occupancy status, and the SMAO Director shall be notified of the OSHA noncompliance status.

Whenever a condition which would be classified as a serious violation of the OSHA standards is reported to or observed by the LaRC Fire Chief, the Facility Coordinator and/or Facility Safety Head shall immediately barricade the hazardous condition. Permanent corrective actions shall be taken within 10 working days. Noncompletion of corrective actions within 10 working days shall result in the revocation of the Certificate of Beneficial or Final Occupancy.

October 3, 2004

LPR 1710.11

6.4.3.2 Items/Features Required Prior to Issuance of a Certificate of Beneficial Occupancy

Portable fire extinguishers shall be located as required by NFPA 10 (Portable Fire Extinguishers) and identified by conspicuous signs visible from all angles. The LaRC Fire Chief shall concur with the location and identification methods for the extinguishers.

A request for the completion of a Life Safety Code Review shall be submitted to the LaRC Fire Chief at least 2 weeks before the desired effective date of a Certificate of Beneficial Occupancy. This review shall include the following:

1. Emergency lighting, if required.
2. Employee emergency evacuation routes.
3. Method to summon emergency response team.
4. Means to notify employees of local facility evacuation.

Emergency lighting shall be required if the area or facility is to be occupied at night or if there are interior areas where windows do not provide minimum lighting (1 foot-candle at floor level) in the means of egress.

Employee emergency evacuation routes shall be identified by the Facility Coordinator and/or Facility Safety Head and approved by the LaRC Fire Chief. Diagrams of the emergency evacuation routes are displayed on the wall adjacent to each required exit. These routes shall take into consideration interface with any ongoing construction activities.

A fully functional employee evacuation alarm system must be operational prior to the issuance of a Certificate of Beneficial Occupancy.

No combustibles shall be stored in the means of egress. This shall require removal of all packing materials for fixtures and furniture before personnel are assigned to work in the area or facility.

Floor plans showing all dimensions of the permanent offices and temporary work spaces shall be approved by the LaRC Fire Chief prior to the issuance of a Certificate of Beneficial Occupancy.

No flammable/combustible liquid processing or any other high-hazard operations shall be performed, even if an area is designed to process such liquids or is classified as high hazard, while an area or building/ structure is being occupied under a Certificate of Beneficial Occupancy.

A Certificate of Final Occupancy shall be required prior to any processing of flammable or combustible liquids. An interim flammable/combustible liquids handling plan shall be developed if such liquids are to be present as part of the construction necessary to achieve the Certificate of Final Occupancy.

Permanent/Temporary identification of all hazards required by OSHA and NFPA shall include temporary hazards related to unfinished construction which shall be provided by signs, painting/color coding of hazards, and barricading. Hazard identification signs that

October 3, 2004

LPR 1710.11

will still exist once the Certificate of Final Occupancy is granted shall be installed before the issuance of a Certificate of Beneficial Occupancy.

Preplanned impairments of automatic sprinkler and/or fire alarm systems during the period of Certificate of Beneficial Occupancy are authorized, in writing, by the LaRC Fire Chief. All impairments of the fire protection system(s) shall be conducted in accordance with Section 5.1 of this document.

Electrical installation and modifications which are part of new construction shall be verified to confirm their compliance with NFPA 70 (National Electrical Code).

6.4.3.3 Items/Features Required Prior to Issuance of Certificate of Final Occupancy

Emergency evacuation alarms used on-site shall be connected to the sitewide supervised system and shall be audible in all public parts of the area requesting Final Occupancy. Off-site locations shall have a plan approved by the LaRC Fire Chief.

Central station fire alarm monitoring of all fire alarm boxes at on-site locations must be verified by the LaRC Fire Department inspector as part of the sitewide fire alarm. Systems at off-site locations shall be connected to a central station alarm monitoring location and shall be tested to ensure functional operation. This shall be accomplished in conjunction with the local authority having jurisdiction over the leased space location.

A flammable/combustible liquids storage plan must be prepared by the Facility Coordinator and/or Facility Safety Head. This plan shall meet the requirements of NFPA 30 (Flammable and Combustible Liquids Code) and shall be approved by the LaRC Fire Chief or designee.

Permanently established and identified aisles shall be provided in nonoffice areas and shall be clearly apparent in office areas. The aisles must be free of any obstructions, including storage of transient materials.

Exit signs shall be in place. Emergency lighting shall be required if the area or building/structure is to be occupied at night or if it contains interior areas where windows do not provide minimum lighting (1 foot-candle at floor) in the means of egress.

Fire preplans shall be developed in accordance with Section 10.10 of this document prior to issuance of the Certificate of Final Occupancy.

Unobstructed 36-inch access to utility rooms/electrical disconnects shall comply with NFPA 70 (National Electrical Code). All areas in front of electrical disconnects and circuit breaker boxes shall be identified by markings on the floor or by appropriate signs notifying the occupants to keep the area clear at all times.

Permanent signs and postings shall be required by OSHA, NFPA, NASA, and LaRC performance requirements conform to the requirements of 29 CFR 1910.145 for the marking of hazards. Temporary (handwritten or typewritten signs) or other nonstandard signs shall not be acceptable under a Certificate of Final Occupancy.

6.4.3.4 Requirements for On-Site Construction and Modifications

All facilities constructed or modified on-site shall be designed to meet an improved risk level of fire protection.

October 3, 2004

LPR 1710.11

All off-site leased facilities shall fully comply with the local building and fire codes. Additionally, all off-site leased space shall be protected by an automatic sprinkler system equipped with a fire alarm monitoring system that shall automatically notify the local fire department, and the portion of the facility occupied by LaRC personnel shall fully comply with NFPA 101 (Life Safety Code).

6.4.3.5 Issuance of Certificate of Beneficial Occupancy

The Facility Coordinator/Facility Safety Head/project engineer shall submit a written request for the issuance of a Certificate of Beneficial Occupancy by the LaRC Fire Chief. The LaRC Fire Chief shall verify that all required items of this section are present and that no imminent danger or serious hazards exist in the area. Any item that is in technical noncompliance with OSHA, NFPA, NASA, or LaRC safety performance requirements is noted on the Certificate of Beneficial Occupancy. Where appropriate, the noncompliances shall be identified by tags, barricades, or other interim corrective measures.

The LaRC Fire Chief shall identify to the Facility Coordinator/Facility Safety Head/project engineer, all actions necessary prior to the issuance of Certificate of Final Occupancy.

Note: The Certificate of Beneficial Occupancy shall not be issued until all interim corrective measures are physically in place and functional.

6.4.3.6 Issuance of Certificate of Final Occupancy

To obtain a Certificate of Final Occupancy, the Facility Coordinator/Facility Safety Head/project manager shall notify the LaRC Fire Chief that all technical deficiencies identified by the inspection (that was part of the issuance of the Certificate of Beneficial Occupancy) have been corrected.

The LaRC Fire Chief shall assign professional staff members from affected disciplines to reinspect the area to verify that all identified deficiencies are corrected and that no new deficiencies have arisen in the area applying for Certification of Final Occupancy.

6.4.4 RESPONSIBILITIES

Center Operations Directorate shall:

1. Request the assistance of the LaRC Fire Chief in determining if proposed on-site or off-site space is suitable for proposed occupancy.
2. Submit drawings, sketches, etc., to the SFAB for approval prior to structural modifications by LaRC or subcontractor personnel.
3. Ensure that all new construction at LaRC is designed and constructed to the improved risk level of fire protection and that no known violations of OSHA, NFPA, NASA, or LaRC safety requirements are included as part of the final construction turnover packages.
4. Request the LaRC Fire Chief to issue a Certificate of Beneficial Occupancy and/or a Certificate of Final Occupancy.

October 3, 2004

LPR 1710.11

Facility Coordinator and/or Facility Safety Head shall:

1. Request the assistance of the LaRC Fire Chief in determining if proposed changes in on-site use will affect the occupancy of an area or facility.
2. Initiate work orders, construction projects and purchase requisitions necessary to bring the area or facility into full compliance with all applicable standards.
3. Ensure that all proposed modifications meet an improved risk level of fire protection.
4. Submit design plans for temporary work space for approval.
5. Request the LaRC Fire Chief to issue a Certificate of Beneficial Occupancy and to issue a Certificate of Final Occupancy for all nonproject on-site facility modifications.

LaRC Fire Chief shall:

1. Review all proposed structural modifications to existing areas or facilities/structures and construction proposal drawings/packages to verify that an on-site proposed usage qualifies as an improved risk level of fire protection.
2. Review drawings of off-site office areas and facilities/structures to ensure that they meet all local fire codes and that whatever portion is used by LaRC personnel fully complies with NFPA 101 (Life Safety Code).
3. Review all drawings for the installation of temporary workspace to ensure that the installation does not invalidate the Certificate of Final Occupancy.
4. Issue Certificates of Beneficial and Final Occupancy using LF 112, "Certificate of Occupancy."

Fire Department Station Officer shall:

1. Perform specified fire inspections of all LaRC on-site and off-site locations to verify ongoing compliance with OSHA, NFPA, NASA, and LaRC safety requirements.
2. Inform and identify to the LaRC Fire Chief any condition that appears to be an imminent danger of fire protection concern.
3. Verify that no apparent changes in occupancy have occurred since the issuance of the Certificate of Final Occupancy.

CHAPTER 7**7. FIRE PROTECTION****7.1 SMOKING REGULATIONS****7.1.1 PURPOSE**

This section reinforces the LaRC smoking policy and regulations.

7.1.2 SCOPE

This section shall apply to all facilities and areas that lie within the boundaries of LaRC.

7.1.3 REQUIREMENTS

Smoking shall be permitted only in designated smoking areas.

Adequate receptacles shall be provided in designated smoking areas.

Locations of fire extinguishers shall be noted at designated smoking areas.

Lighters, matches, or other flame-producing devices must be used as intended.

Carrying/using "strike anywhere" matches is prohibited at LaRC. Safety matches shall be permitted.

7.1.4 RESPONSIBILITIES

Office of Human Resources shall:

1. Be responsible for smoking policy at LaRC.
2. Coordinate requests for designated smoking areas with SFAB.

LaRC Fire Chief or Designee shall:

1. Determine if requested smoking areas are within a fire hazard area.
2. Ensure that all fire protection requirements of smoking areas are maintained.

7.2 FIRE LANES**7.2.1 PURPOSE**

This section establishes general operating practices to ensure facility accessibility for fire fighting forces.

7.2.2 SCOPE

This section shall apply to all personnel and all facilities at LaRC.

October 3, 2004

LPR 1710.11

7.2.3 REQUIREMENTS

7.2.3.1 General

Provisions for facility fire lane accessibility in new facilities or existing facility modifications or additions shall be considered in the design.

Facility entry/access points and response routes (fire lanes) shall be identified in the LaRC Fire Department prefire plan as required in Section 10.9 of this document. The Facility Coordinator and/or Facility Safety Head shall notify the LaRC Fire Chief prior to facility configuration alteration to review and approve the potential fire lane impairments and to allow the LaRC Fire Department to update its prefire plan.

Access points and ingress/egress routes shall be maintained free of equipment, furniture, stored materials, and other items which impede interior access.

The arrangement of stored materials shall be such that all portions of the materials can be reached by fire fighting hose streams.

7.2.3.2 Fire Lanes

Fire lanes shall be provided to within 150 feet of all portions of a structure or outside storage area. Where fire lanes are longer than 150 feet and terminate at a dead end, approved provisions for turning around fire department apparatus must be provided. Figure 7.1 provides an illustration of the approved turnarounds.

Fire lanes shall not be less than 20 feet of unobstructed width.

Fire lanes shall be designed with an appropriate 25-foot inside turning radius and a 50-foot outside turning radius at turns to accommodate fire department apparatus.

Access roads shall be furnished by application of an all-weather driving surface of hot mix asphaltic concrete or concrete pavement over a flexible base capable of supporting loads imposed by LaRC Fire Department apparatus (not less than 80,000-pound live vehicle load). Access roads shall also have a minimum of 13 feet 6 inches of vertical clearance.

Fire lanes shall be marked with freestanding signs or marked curbs, sidewalks, or other traffic surfaces with the words "FIRE LANE – NO PARKING" painted in black letters on a yellow background.

7.2.4 RESPONSIBILITIES

Fire Department Station Officer shall conduct facility walkthrough inspections, as part of the prefire planning, to identify facility access points.

Facility Coordinator and/or Facility Safety Head shall:

1. Ensure that access points and ingress/egress routes are not obstructed.
2. Ensure that proper configuration of stored items is maintained.
3. Notify LaRC Fire Chief of any facility configuration changes.

October 3, 2004

LPR 1710.11

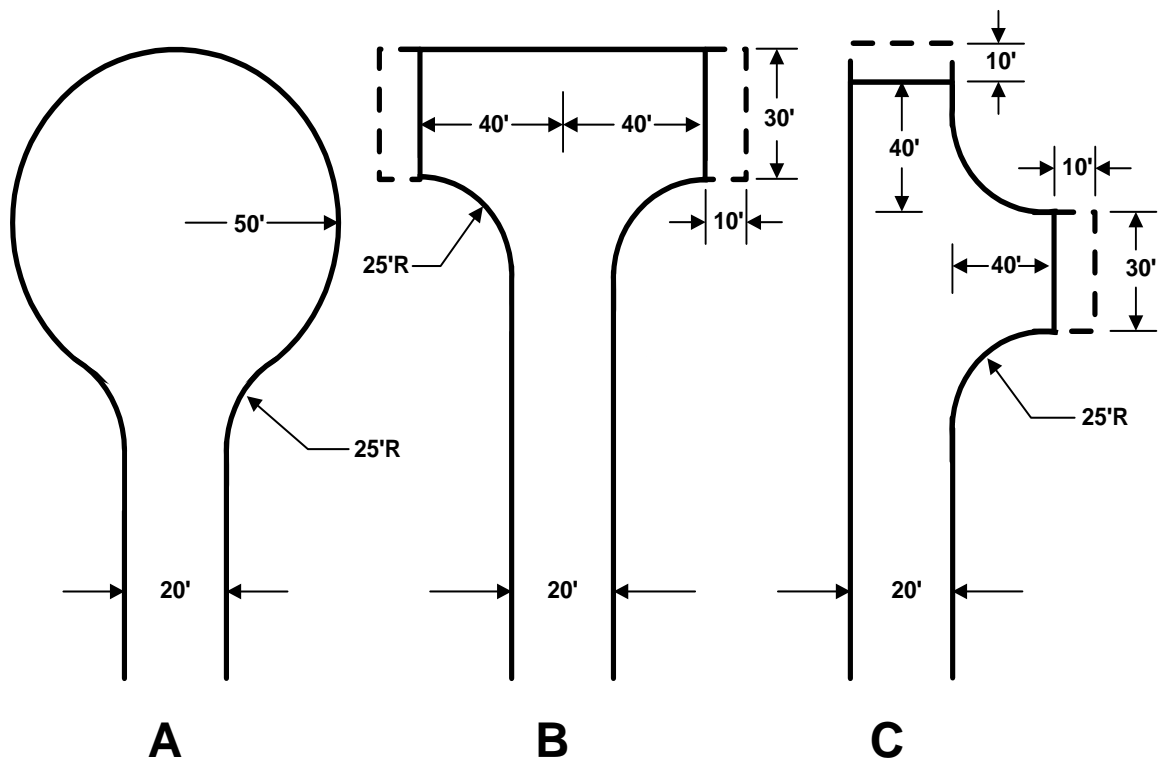


Figure 7.1, Approved Fire Lane Turnarounds.

The LaRC Fire Chief shall approve a cul-de-sac with a minimum 50-foot unobstructed radius and 30-foot by 80-foot "T" section of "Hammerhead" turn around, provided that an additional 10 feet of right of way around the 30-foot by 80-foot dimension can be provided with no obstructions over 1 foot high.

7.3 HOT WORK/OPEN FLAME AND WELDING PERMIT SYSTEM

7.3.1 PURPOSE

This section establishes fire protection requirements for work or activities which require the use of flame-, heat-, smoke-, or spark-producing tools. These include, but are not limited to, acetylene and propane torches, grinders, electric arc welders, and activities such as grinding or brazing outside of designated shop facilities. The requirements for designated hot work shops are stipulated in Section 7.3.3.4 of this document.

7.3.2 SCOPE

This section shall apply to all organizations at LaRC, as well as to all contractors that operate at the facility. Deviations or waivers from the standard for specialized operations must be submitted to the LaRC Fire Chief in writing for review and consideration in accordance with Section 2.3. Only the LaRC Fire Chief shall grant deviation or waiver approval.

October 3, 2004

LPR 1710.11

7.3.3 REQUIREMENTS

7.3.3.1 General Precautions

Hot work activities shall not be performed on the following:

1. Combustible walls or ceilings or those containing combustible insulation.
2. Tanks or pipes that have held flammable liquids (unless they have been thoroughly purged and tested for residual vapors).
3. Pipes or other metal in contact with combustible materials if ignition of material is possible due to conduction.
4. Metal partitions, walls, ceilings, or roofs having a combustible covering.
5. Walls or partitions of combustible sandwich-type panel construction.

The Hot Work Permit shall be in effect for no longer than 24 hours except as permitted in Section 7.3.3.4. If conditions related to the permit change during this time, the permit shall be void and a new permit issued. The permit must be posted in the area where the work is performed.

Industrial Hygiene personnel shall review the process for special ventilation or respiratory requirements when hot work is being performed on metals such as stainless steel, lead, nickel, chromium, or metals with special coatings.

Nearby personnel shall be protected from heat, sparks, and/or slag. This may be accomplished through the use of fire resistive screens or shields.

7.3.3.2 Hot Work Requirements

A NASA Langley Form 71, "Hot Work Permit (Non-fixed)," must be completed and approved prior to the start of work.

A flammable vapors test must be conducted when flammable liquids, vapors, or gases may be present. If test results exceed 25% of the lower explosive limit (LEL) for liquids and 0% LEL for gases, additional precautions shall be required.

Automatic sprinkler protection must be in service where provided. (Hot work activities shall be specifically prohibited in areas that have automatic sprinkler protection which is out of service. Additionally, welding or torch cutting on automatic sprinkler systems after installation is prohibited.)

Portable fire extinguishers must be available for fire watch use. Facility fire extinguishers shall not be used to satisfy this requirement.

Flammable liquids within 35 feet of the hot work area must be removed.

Oily deposits within 35 feet of the hot work area must be cleaned/ removed.

Combustible materials within 35 feet of the hot work area must be removed.

Combustible materials which cannot be removed must be covered or shielded with flameproof covers, fire resistant guards, or fire resistant curtains.

October 3, 2004

LPR 1710.11

Cracks in walls, floors, ducts, or other concealed spaces within 35 feet of the hot work area must be covered to prevent the passage of sparks or slag to adjacent areas.

Combustible materials must be removed from the other side of walls where hot work is performed near walls, partitions, ceilings or roofs of combustible construction.

Special precautions, as recommended by the LaRC Fire Chief, must be taken to avoid unwanted activation of automatic detection or suppression systems due to the use of hot work equipment. This shall include impairment of the smoke detectors in the work area through the correct fire protection impairment protocol as outlined in Section 5.1.

7.3.3.3 Fire Watch Requirements for Hot Work Activities

A fire watch must be provided for all hot work operations performed outside of a dedicated "fixed" hot work shop location.

The fire watch shall ensure that a portable fire extinguisher of adequate size and type is available for the hot work operation. The extinguisher shall be in addition to the portable extinguishers located throughout the facility.

The fire watch shall locate the nearest emergency pull station and telephone to report an emergency.

The fire watch shall continuously monitor the work area for hazards and must immediately notify the other worker(s) of the hazards.

The fire watch shall not have any other collateral duties.

The fire watch shall monitor the work area for any smoldering fires or hot spots for at least 30 minutes following the hot work operation.

7.3.3.4 Shop Welding and Cutting Areas

Shops that perform hot work activities must be located in noncombustible or fire resistant structures unless otherwise approved by the LaRC Fire Chief.

The area or shop must be located in the sprinklered portion of the facility. Hot work activities shall not be permitted while sprinkler protection is out of service, unless approved by the LaRC Fire Chief. The LaRC Fire Chief shall notify the Facility Coordinator and/or Facility Safety Head of any impairments to the automatic sprinkler system within the shop area.

The area or shop boundary must be constructed to prevent sparks and/or slag migration outside the approved area, or the immediate space surrounding the defined hot work area must be kept clear of all combustibles or at least 35 feet in any direction in which sparks may travel. This 35-foot buffer shall not be considered part of the hot work area or shop.

Screens must be provided to protect other workers from ultraviolet radiation hazards.

Unconnected gas cylinders stored in the areas or shops must be limited to a 1-day supply.

Fixed shop areas that perform hot work operations shall be issued a Hot Work Permit (a single permit can cover multiple operations) by the LaRC Fire Chief after review of the

October 3, 2004

LPR 1710.11

proposed area or shop for conformance to this standard. Shop permits shall be written for a period not to exceed 1 year, with a 6-month evaluation.

The NASA Langley Form 70, "Hot Work Permit (Fixed)," must be completed and posted within the shop or work area.

The shop or area supervisor must request a new shop or area inspection whenever the configuration and/or occupancy of the fixed hot work area is changed.

A fire watch shall be required under specific circumstances in approved fixed hot work shops or areas at the discretion of the shop/area supervisor or the LaRC Fire Chief.

7.3.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Serve as the interface for special hazard situations and provides oversight and guidance to facility personnel performing hot work activities.
2. Ensure that all fixed hot work shop areas have permits posted as outlined in the standard.

LaRC Fire Chief or Designee shall:

1. Ensure that Hot Work Permits are issued in accordance with this standard.
2. Review special hazard situations and recommends practices and compensatory measures to prevent fires or explosions related to hot work activities.
3. Inspect fixed weld shop areas upon request from the shop supervisor or Facility Coordinator/Facility Safety Head and issues fixed weld shop permits.
4. Reinspect the shops annually at the request of the shop supervisor or Facility Coordinator/Facility Safety Head.

Fire Watch shall ensure that the requirements of this section are followed.

Personnel Performing Hot Work shall

1. Ensure that all aspects of the Hot Work Permit are in place and that the parameters of the permit are not breached.
2. Conduct hot work in accordance with the permit requirements.
3. Shop Welding Area Supervisor shall request a new Hot Work Permit prior to the expiration of the existing permit.

7.4 FACILITY FIRE WATCH REQUIREMENTS

7.4.1 PURPOSE

This section establishes the requirements for performing facility fire watch duties at LaRC.

7.4.2 SCOPE

This section shall apply to all personnel performing facility fire watch duties.

October 3, 2004

LPR 1710.11

7.4.3 REQUIREMENTS

Facility fire watch personnel must understand the specific nature of the fire system impairment and the specific area(s) affected.

Facility fire watch personnel shall patrol all areas affected by a fire system impairment.

Facility fire watch personnel shall be instructed in the frequency of the facility fire watch tours by the LaRC Fire Chief. The frequency of tours typically shall be as follows:

1. Continuous, when required by facility process standards or process controls.
2. Hourly, when automatic suppression systems are out of service.
3. Once every 2 hours if only automatic alarm capability is out of service.
4. As dictated by the LaRC Fire Chief.

Facility fire watch personnel shall be given instruction before standing facility fire watch.

Each facility fire watch personnel shall be instructed on the following:

1. Areas to be watched.
2. Frequency of tours required.
3. Specifics of the fire protection impairment.
4. Appropriate emergency procedures and actions.
5. Methods for sounding the alarms.
6. Procedure for manually activating fire suppression systems.
7. Use of fire extinguishers (hands-on training required).
8. Methods for recording conduct of tours.
9. Other pertinent information in the log.

A log or other documentation system shall be established and used to provide an auditable record of compliance with the requirements of this standard. The log or other documentation shall include (but is not limited to) the following:

1. Facility, building, and area under facility fire watch.
2. Nature of fire protection impairment.
3. Date of first fire protection impairment.
4. Dates and frequencies of facility fire watch.
5. Signatures of personnel serving as facility fire watch.
6. Date of fire protection restoration.

Facility fire watches for welding, cutting, grinding, or open flame activity are performed in accordance with Section 7.3 of this document.

October 3, 2004

LPR 1710.11

7.5 HEAT-PRODUCING APPLIANCES

7.5.1 PURPOSE

This section establishes the requirements for the use of portable heat-producing appliances.

7.5.2 SCOPE

This section shall apply to the use of portable heating appliances at LaRC.

7.5.3 REQUIREMENTS

7.5.3.1 General Requirements

Heat-producing devices shall not be used on or near combustible surfaces unless provided with adequate insulation. See manufacturer's recommendations for required separation distances.

Only those heat-producing devices that have been approved for the service intended by a nationally recognized testing/certification laboratory shall be used. They must be disconnected from their power source or de-energized by an approved switch when tilted or tipped over.

When open-flame equipment is used, a special written permit shall be required for each use.

Coffee makers and similar appliances shall be installed so that they are in plain view and shall be separated and insulated from combustibles. They must be de-energized when not in use.

Combustible liquids used for refueling shall be stored in safety cans.

Heaters using gasoline (or other Class I Flammable and Class II Combustible liquids) shall be prohibited in any location (see National Fire Protection Association [NFPA] 30 for definitions).

Hourly fire watches shall be provided for burner-type heaters which are in use during other than normal working hours, except where the heaters used are house-type furnaces or space heaters that are provided with fully automatic controls. In such cases, hot flues, unless appropriately insulated, must be 10 feet or more from combustibles.

The use of burner-type heaters shall not be permitted in areas where painting or other activities may create possible explosive atmospheres. Heat furnished to such areas must be indirect (steam or forced ducted air).

7.5.3.2 Melting Kettles or Pots

An approved type of fire extinguisher must be available at all locations where heating or melting kettles are used or hot substances are applied. The extinguisher shall be in addition to the portable extinguishers located throughout the facility.

All heating or melting kettles or pots must be mechanically stable. Appropriate barriers must be provided so the kettles/pots are isolated from pedestrian and vehicular traffic.

October 3, 2004

LPR 1710.11

Kettles/pots shall not be used in combustible facilities, nor shall they to pose a fire risk to nearby structures. They shall be covered and equipped with temperature indicating devices appropriate for the materials being heated. Thinning with flammable solvents is not permitted.

Protective equipment and clothing must be provided and must be used by all persons handling hot substances.

7.5.3.3 Space Heaters

When heating an occupied area, heaters shall be of the indirect-fired type with combustion exhaust gases discharged to the outside atmosphere. However, if direct-fired units are used or if combustion gases do not discharge outside, a monitoring program for toxic gases shall be established which is acceptable to the responsible safety organization.

Portable heaters requiring liquid or gaseous fuel shall not be located within facilities. They shall be located outside with the heated air ducted to the point-of-use.

Heaters of the pot type shall be prohibited, as are open fires or fires in open end drums. Heater combustion controls are UL listed or American Gas Association (AGA) approved. If AGA approval is accepted in lieu of UL listing for combustion controls, the full complement of personnel safety devices required for UL listing shall be provided.

Permanent fixed boilers, fixed heaters, or heaters without watchmen or heater tenders shall be equipped with the full complement of combustion controls.

7.5.3.4 Heater Fuel Supply and Storage

Oil or liquefied petroleum gas (LPG) fuel supply tanks for heaters must be installed or contained outside of facilities or enclosures. Fuel lines shall be protected against mechanical damage.

Supply or storage tanks shall be buried. If installing the tanks above ground is necessary, they must be labeled with their contents, "No Smoking" labels shall be placed on them, and barricades placed around them. Such tanks shall meet the requirements of NFPA 30 or NFPA 31.

LPG supply tanks of less than a 125-gallon aggregate cylinder content shall be installed in racks immediately outside an enclosure. Larger supply tanks are installed in accordance with NFPA 58.

The fuel supply tank is permitted to be an integral part of the heating unit if the minimum distance separating it from any combustible material is 10 feet. Such units shall be shut down and cooled before being refueled or moved.

7.5.3.5 Temporary Portable Electric Heaters

Temporary portable heaters shall not be approved except for freeze protection or when facility heat is lost.

Before requesting a portable heater, all options available to improve comfort and to ensure maximum efficiency and conservation of energy through existing fixed systems

October 3, 2004

LPR 1710.11

shall be examined. Facility managers shall investigate ways to improve the central heating distribution. If, as a final solution, a portable heater is necessary in an area, two major safety concerns must be considered:

1. Portable heaters are an additional ignition source and must be well separated from all combustible materials.
2. Portable heaters produce an additional electrical load which may cause an overload in the existing electrical circuits and cause conduit breakers to trip. This interrupts power to the circuit, which may be serving a computer, lights, or other electrical appliance.

With respect to these safety concerns and applicable safety and fire protection requirements, the following instructions have been established for the selection and use of temporary portable electric heaters:

1. Approval for use shall be obtained from the SFAB Head and cognizant Facility Coordinator/Facility Safety Head after review and concurrence of the proposed use by the LaRC Fire Chief and the facility electrician.
2. The heater shall be approved by a nationally recognized testing/certification laboratory such as UL. Only oil-filled portable electric heaters will be approved. In addition, the heater must not exceed 1800 watts.
3. Due to the additional electrical load, the proposed heater usage shall be reviewed by the facility electrician or other electrical specialist to verify that the circuit is not overloaded. Some facilities have specific electrical load restrictions which must be adhered to.
4. The location of the unit shall be considered. It shall not be placed against combustible materials or where a tripping hazard may be created because of the unit or its electrical cord.
5. Administrative controls shall be implemented to ensure the unit is unplugged or turned off when space being heated is unoccupied.

7.5.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure that practices delineated in this procedure are followed and shall contact the LaRC Fire Chief prior to the use of portable heating equipment.

Fire Department Inspector shall:

1. Inspect the work area, prior to the use of portable heating appliances, to ensure that the work area is properly prepared to prevent fires.
2. Determine if additional protective measures are necessary during the use of portable heating appliances.
3. Consult with the LaRC Fire Chief to determine the adequacy of heat-producing appliances, as necessary.

October 3, 2004

LPR 1710.11

7.6 FIRE PROTECTION DURING CONSTRUCTION

7.6.1 PURPOSE

This section prescribes minimum fire protection safeguards for construction and demolition activities, including alteration and demolition.

7.6.2 SCOPE

This section shall apply to all construction and demolition activities at LaRC. This shall include operations performed by NASA and contract personnel.

7.6.3 REQUIREMENTS

7.6.3.1 Preconstruction Conference

Before construction and demolition activities shall be initiated, a preconstruction conference shall be held.

Items to be discussed in the preconstruction meeting shall include:

1. Emergency and business telephone numbers for the LaRC Fire Department.
2. Requirements for construction contractor-provided fire extinguishers.
3. Use of specified fire hydrants in accordance with Section 5.4 of this document.
4. Smoking policy (cessation of smoking 30 minutes prior to end of shift).
5. Pre-entry inspection of construction vehicles.
6. Transport and storage of flammable liquids:
 - Capacity of 5 gallons or less shall be transported only in approved safety containers
 - No bulk storage of flammable liquids shall be permitted without LaRC Fire Chief approval
7. Requirements for accumulation of combustibles, form lumber, forms, waste, and debris.
8. Temporary heating equipment.
9. Maintenance of required exit components.
10. Maintenance of existing fire protection systems and fire resistive assemblies.
11. Any other items pertaining to fire protection/prevention.

7.6.3.2 Fire Safety Plan

A fire safety plan shall be included in all construction or demolition projects

The construction safety inspector, LaRC Fire Chief, and fire department station officer have the authority to enforce the plan even though the facility, during construction, is under the jurisdiction of the construction contractor. Upon request by the LaRC Fire

October 3, 2004

LPR 1710.11

Chief, the construction contractor shall conduct a construction area tour for emergency response personnel.

The plan shall include full compliance with requirements set forth in NFPA 241 as well as the following:

1. Good housekeeping practices in accordance with Section 7.9 of this document.
2. Installation of new fire protection systems as construction progresses.
3. Preservation of existing fire protection systems during demolition.
4. A prefire plan developed with assistance from the LaRC Fire Department station officer in accordance with Section 10.9 of this document.
5. Rapid notification of fires in accordance with Section 7.10 of this document.
6. Consideration of special hazards resulting from previous operations:
 - Any cutting, welding, or other types of hot work at construction sites comply with Section 7.3 of this document.
 - The storage of flammable compressed gases at construction sites complies with Section 8.3 of this document.

7.6.4 RESPONSIBILITIES

LaRC Fire Chief or Designee shall:

1. Answer questions relative to fire protection/prevention asked by construction contractor.
2. Enforce the construction fire safety plan with assistance from the construction safety inspector.

Construction Safety Inspector shall:

1. Enforce the construction fire safety plan with assistance from the LaRC Fire Department and LaRC Fire Chief.
2. Attend preconstruction meeting.
3. Discuss fire protection and prevention policies with construction contractor.
4. Answer questions relative to fire protection/prevention asked by construction contractor.

7.7 STANDARD FIRE SYMBOLS FOR LaRC

7.7.1 PURPOSE

This section establishes the requirements for the posting of symbols to identify the most severe hazard(s) associated with materials stored in a facility or storage site in order to alert responding fire fighters of the expected hazards and to identify outside fire protection equipment.

October 3, 2004

LPR 1710.11

7.7.2 SCOPE

This section shall apply to all facilities at LaRC.

7.7.3 REQUIREMENTS

7.7.3.1 General

All existing facilities or storage sites containing explosive materials, flammable liquids or gases, or other hazardous substances shall be posted with National Fire Protection Association (NFPA) 704 symbols to identify the hazard classification of the material within the facility or site. Additionally, all facilities shall be posted with appropriate outside markings for fire protection equipment in accordance with Section 7.7.3.3 of this section.

7.7.3.2 NFPA 704 Posting

All facilities shall be posted with the NFPA 704 diamond. This symbol provides visual information on four categories of hazard: health, flammability, reactivity (stability), and special hazards such as oxidizers or water reactivity.

The NFPA 704 diamond is divided into four intrinsic diamonds, each representing the four hazard categories. The left-hand diamond represents the health hazard of the material within the facility. The top diamond represents the flammability hazard of the material within the facility. The right-hand diamond represents the reactivity hazard of the material within the facility. The bottom diamond is used to provide special information relative to the material in the facility.

Each of the four diamonds of the main symbol shall be color coded. The background color of the diamond representing the health hazard is blue. The background color of the diamond representing the flammability hazard is red. The background color of the diamond representing the reactivity hazard is yellow. The background color for the diamond providing special information is white.

Each hazard category shall be assigned a hazard classification based on the properties of the material. Table 7.1 lists the five classifications of hazards and the general meaning to fire fighters. The hazard classification for each hazard category is placed within the diamond representing the respective hazard category.

The assigned hazard classification shall reflect the most severe hazard expected in the area, whether it be from material itself or breakdown products of the material.

The color of each number representing the hazard classification shall be black.

The size and location of the diamond shall comply with recommendations contained in NFPA 704.

October 3, 2004

LPR 1710.11

Table 7.1, Degrees of Hazards

DEGREE OF HAZARD	HAZARD INVOLVED
4	Fire is too dangerous to approach with standard fire fighting equipment and procedures. Withdraw and obtain expert advice.
3	Fire can be fought using methods intended for extremely hazardous situations, such as remote-control monitors or personal protective equipment that prevents bodily contact.
2	Fire can be fought with standard procedures, but hazards are present that can be handled safely only with certain special equipment or procedures.
1	Nuisance hazards are present that require some care, but standard fire fighting procedures can be used.
0	No special hazards are present.

7.7.3.3 Marking of Outside Fire Protection Equipment

All outside fire protection equipment shall be posted with the applicable markings to aid in identification and operation during emergency response.

Signs shall be permanently marked and constructed of weather resistant metal or rigid plastic materials. Signs shall be nominally 12 inches high and 18 inches wide. Signs shall have a red background and white letters and border. Letters shall be at least 2 inches and of retroreflective material. The border shall be at least 1 inch in width and of retroreflective material.

Signs shall contain the following information in three distinct lines (See Figure 7.2):

- Line 1: The service design (e.g., AUTOSPKR, OPEN SPKR, STANDPIPE, or AUTOSPKR and STANDPIPE)
- Line 2: The portions of the facility served (e.g., entire facility, 1st floor computer room)
- Line 3: System information (e.g., inlet pressure to deliver the greatest system demand [125 psi], manual valve locations)

Each line of information shall be separated from the next adjacent line or border by at least 1 inch of space.

The sign shall be permanently attached or mounted within 2 feet of the applicable outside fire protection equipment. When multiple pieces of equipment are present, signs shall be mounted in a manner to eliminate confusion.

October 3, 2004

LPR 1710.11

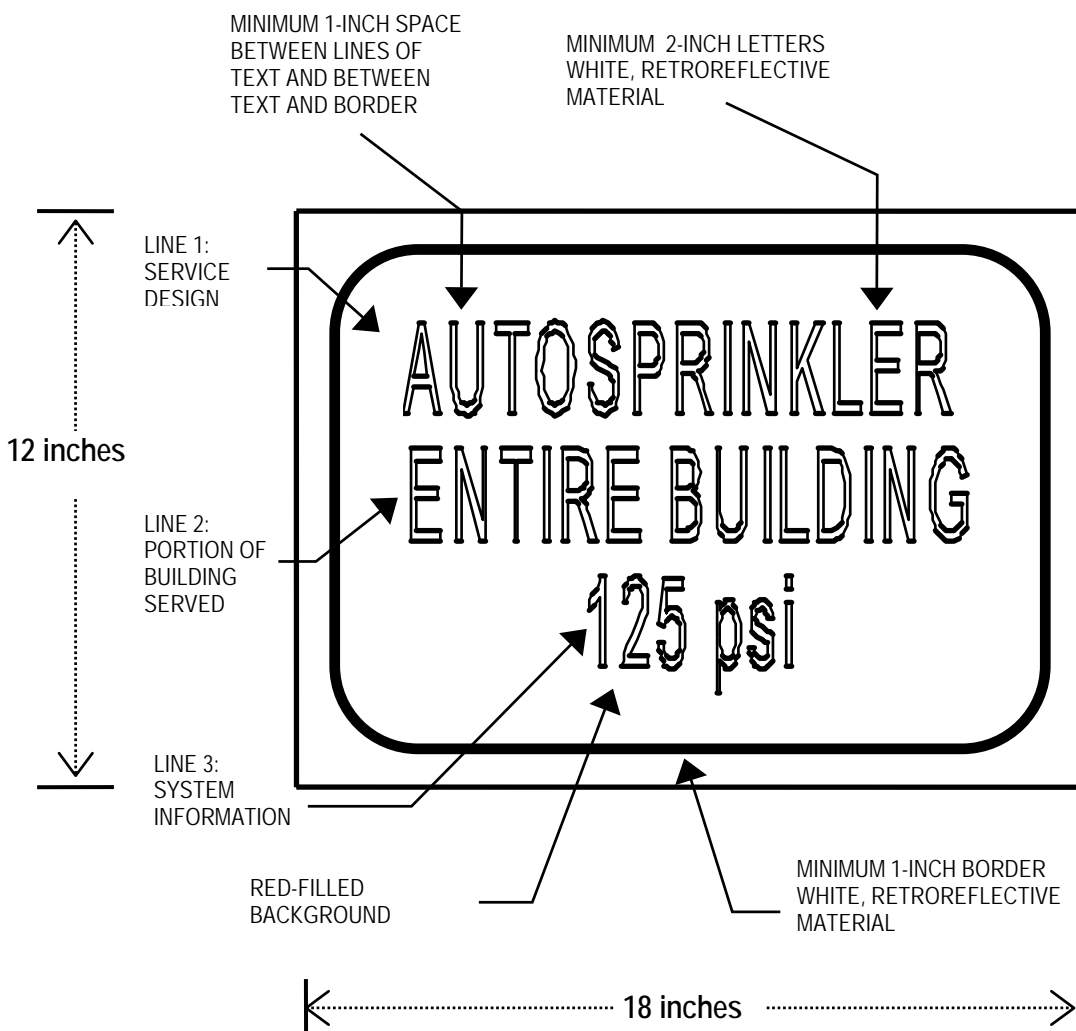


Figure 7.2, Outside Fire Protection Equipment Signage.

7.7.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Ensure that the flammable liquids or gases and other hazardous materials are identified and assigned a proper hazard classification for all facilities.
2. Display symbol on the facility or site to reflect the most serious hazard classification pertaining to the facility or site.

LaRC Fire Chief shall:

1. Assist Facility Coordinator and/or Facility Safety Head in identifying hazardous materials and determining hazard classification for each material.
2. Ensure response to emergencies involving facilities or sites containing hazardous materials.

October 3, 2004

LPR 1710.11

7.8 CONTROL OF COMBUSTIBLES

7.8.1 PURPOSE

This section establishes administrative controls for combustibles (transient fire loads [TFL's]) at LaRC and to ensure that provisions are adequate for fire prevention, control, and suppression.

7.8.2 SCOPE

These controls and protection philosophies shall apply to safety related systems, high-value structures, and sensitive components. They shall be extended to other areas to the extent possible.

7.8.3 REQUIREMENTS

7.8.3.1 General

The control of TFL's is essential to the defend-in-place fire protection philosophy for safety related systems, structures, and components and to prevent economic loss due to exposure fires to auxiliary facilities and equipment necessary for LaRC operation.

7.8.3.2 Normal Combustibles

The location of TFL's in safety related areas shall be restricted to minimize potential fire hazard exposures to safety related cables, equipment, and fire rated barriers. TFL's shall not be positioned within 6 feet of a fire door, measured perpendicularly, or within less than 0.8 times the door width, measured from the edge of the nearest door opening.

The LaRC Fire Chief shall ensure that the total transient and permanent fire loading in any safety related area does not exceed the capabilities of the installed fire protection systems and equipment as outlined in the fire hazard analysis (FHA), except in approved controlled conditions where adequate supplemental protection and supervision are provided. In safety related areas where there is a heavy concentration of safety related cables or equipment protected by fixed fire protection systems for those specific hazards, no credit shall be taken for those systems to provide extinguishment capability for the TFL's. TFL's, when allowed in these areas, shall be strictly controlled and require adequate protection measures, such as supplemental fire protection and/or fire watches.

The LaRC Fire Department station officer shall perform and document LaRC inspections to determine the adequacy of the TFL controls. Deficiencies shall be identified and documented, and corrective action shall be promptly pursued. The appropriate Facility Coordinator and/or Facility Safety Head shall be advised when it is determined that TFL precautions do not meet section requirements.

Combustible materials and flammable and combustible liquids shall be limited in quantity to the minimum amounts necessary to perform operations for one shift. All materials shall be removed from safety related areas at the completion of the work and taken to a suitable location for disposal/storage.

October 3, 2004

LPR 1710.11

Equipment located in safety related areas that requires periodic replenishment with combustible material (e.g., lubricating oil, charcoal filters) shall be controlled as follows:

1. Only the replenishment amount that will be used during the work shift shall be brought into the area.
2. Used combustible materials such as dirty oil and spent filters shall be removed from the safety related area when work is completed and taken to a suitable location for storage or disposal.

Waste, debris, scrap, rags, oil spills, or other combustibles resulting from the work activity shall be removed from safety related areas following the completion of the activity, or at the end of each work shift, whichever is sooner.

Paper, dirty dressout gear, and other trash which has been bagged for removal shall not be left to accumulate in safety related areas. This material shall be removed or placed in an approved storage location at the end of each shift. Storage locations inside safety related areas shall be approved by the LaRC Fire Chief in accordance with the controls of this section.

The use of welding/burning equipment shall be in accordance with Section 7.3 of this document.

Equipment or supplies shipped in untreated combustible packaging or containers shall be unpacked in safety related areas only if:

1. A continuous fire watch has been established in accordance with Section 7.4 of this LPR.
2. A valid reason exists for equipment and supplies not being unpacked in an area separate from the safety related area (e.g., sensitive equipment, material handling, or fragility).
3. All combustible packing materials and containers shall be removed immediately following unpacking.
4. Loose combustible packing materials, such as wood or paper excelsior or plastic sheeting, shall have been placed in metal containers with tight fitting, self-closing metal covers until removal from the area.

Gasoline, liquefied petroleum gas (LPG), or diesel operated vehicles that enter any safety related area shall have met the requirements of this section.

Insulation on high-temperature casings or pipes that shall become soaked or suspected of being soaked with hydraulic fluids is replaced as soon as possible. Generally, hydraulic fluids have an autoignition temperature of 1150°F, but when soaked into insulation, this fluid will ignite at temperatures as low as 600°F. Because of this phenomenon, cleanup of all spills and elimination of all leaks that may soak insulation in high-temperature casings or pipes shall be undertaken immediately.

Rags shall be removed from safety related areas at the completion of the work and taken to a suitable location for disposal. Care shall be taken to prevent accumulation of rags in the safety related area while work is in progress. Soiled rags in safety related areas shall be temporarily stored in covered metal containers.

October 3, 2004

LPR 1710.11

Work activities shall be evaluated by the LaRC Fire Chief or designee to determine if additional controls are required to minimize the additional fire load.

Ion exchange resins shall not be stored in areas that contain or expose safety related equipment.

7.8.3.3 Flammable/Combustible Liquids or Gasses

Flammable or combustible liquids shall not be stored in safety related areas of LaRC. Incidental use shall be controlled by the requirements of Section 8.2 of this document.

Compressed gas cylinders containing flammable gases shall meet the requirements of Section 8.3 of this document.

7.8.3.4 Building Materials

Fire retardant, pressure treated lumber and any other related combustible materials that are to be used in any area of LaRC for temporary structures shall be in accordance with Section 8.12 of this document. The use of nonpressure treated wood materials and other combustible building materials shall be prohibited unless specifically evaluated and approved by the LaRC Fire Chief.

7.8.4 RESPONSIBILITIES

LaRC Fire Chief or Designee shall:

1. Interpret the guidelines in this section and specifies the controls and protective measures required by the TFL's introduced.
2. Process the TFL in accordance with this document section.

Supervisor Directly Responsible for Work shall:

1. Review proposed work activities to identify those involving TFL's.
2. Ensure that this review and authorization process has been completed and any needed safeguards are in place before the introduction of the TFL.
3. Provide the equipment and arrange for the fire watch coverage (through the LaRC Fire Chief) when controls are specified requiring supplemental fire protection or fire watch coverage.
4. Inspect the TFL each workday to ensure that it is properly controlled.
5. Before weekends, holidays, or other nonwork periods, the supervisor shall ensure that the material is properly stored.

7.9 HOUSEKEEPING PRACTICES TO MINIMIZE FIRE LOSS

7.9.1 PURPOSE

This section establishes good housekeeping practices to minimize the risk of life and property losses from fire.

7.9.2 SCOPE

This section shall apply to all LaRC personnel, subcontractors, and visitors.

October 3, 2004

LPR 1710.11

7.9.3 REQUIREMENTS

7.9.3.1 General

Housekeeping comprises the basic aspects of facility care and maintenance, cleanliness and order, and control of operating supplies and wastes.

The housekeeping program shall include, but is not limited to the following:

1. Control of operating supplies and wastes.
2. Use and storage of flammable and combustible materials.
3. Control of daily working supplies of flammable and combustible materials in the workplace.
4. Daily removal of waste and packaging materials.
5. Daily inspection of assigned areas to detect and correct problems.

Storage and use of hazardous chemicals shall be in accordance with Section 8.16 of this document.

Each facility shall be inspected to ensure general housekeeping practices are met. These practices shall include the following.

7.9.3.2 Storage and Removal of Rubbish (Trash)

Approved trash receptacles/containers shall be provided for rubbish.

Trash containers shall have either self-closing lids or are of the self-extinguishing type (flame arrestor).

Trash carts shall have the doors closed when not in use. The carts shall be emptied into dumpsters before overflowing or before the end of the work shift.

Trash carts shall be staged in the areas approved and designated for these receptacles.

Combustible wastes shall not be allowed to accumulate in the work bays, in cells, or outside of waste receptacles.

Specific guidelines on the handling, storage, and disposal of Environmental Protection Agency (EPA) and Resource Conservation and Recovery Act (RCRA) regulated waste must be followed.

7.9.3.3 Maintaining Areas Around Fire Protection Equipment Free of Stored Materials or Equipment

Exits and exit accesses shall be clear and unobstructed.

Fire doors shall be kept clear of obstructions to ensure operation.

Access to portable fire extinguishers, sprinkler system control valves, and manual actuation devices shall be clear and unobstructed.

Sprinkler heads shall not be obstructed by equipment or stored materials. A minimum vertical clearance of 18 inches shall be maintained between sprinkler heads and equipment or storage.

October 3, 2004

LPR 1710.11

Fire hydrants shall be accessible at all times. The area around hydrants shall be kept free of weeds and other obstructions.

Fire alarm control panels shall be clear and unobstructed at all times.

7.9.3.4 Prevention of Excessive Combustible Loading

Combustible materials shall be controlled in accordance with Section 7.8 of this document.

Dust and oil mops shall be stored to ensure adequate ventilation in order to prevent spontaneous ignition.

Areas between facilities shall be maintained so they are clear of combustible materials, such as stored lumber, rubbish, or weeds.

7.9.3.5 Maintaining Electrical Equipment in Good Condition

Electrical wall plates and junction and outlet box covers shall be in place and tight.

Breaker box covers shall be in place, and there is no exposed wiring in the breaker box.

Equipment shall be grounded.

Equipment shall be permanently wired where practical.

Extension cords shall be listed by a recognized testing laboratory.

Extension cords shall be in good condition, not abraded or worn.

Motors and equipment shall be clean and free of excess lubricants and dust.

Lights shall have protective covers in place.

7.9.3.6 Maintaining Smoking Areas in Acceptable Order

An acceptable number of receptacles shall be provided.

Ash trays shall not be dumped into waste paper or trash receptacles:

Ash trays shall be emptied into a separate metal container daily.

The metal container shall not be used to dispose of smoking materials into waste paper or trash receptacles.

7.9.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Enforce an effective housekeeping program within areas of his or her responsibility.
2. Ensure that unsafe conditions are corrected immediately.

Fire Inspector shall:

1. Observe housekeeping conditions of facilities during routine inspections (weekly, monthly or quarterly, based on facility contents, fire potential, and impact on LaRC mission).

October 3, 2004

LPR 1710.11

2. Report unsafe conditions to the Facility Coordinator and/or Facility Safety Head.

LaRC Fire Chief shall:

1. Observe housekeeping conditions of facilities during routine inspections (weekly, monthly or quarterly, based on facility contents, fire potential, and impact on LaRC mission).
2. Report unsafe conditions to the Facility Coordinator and/or Facility Safety Head.
3. Close facility or area if unsafe conditions cannot be immediately corrected.
4. Conduct facility assessments.

7.10 FIRE NOTIFICATION/FACILITY EVACUATION

7.10.1 PURPOSE

This section establishes the requirements for notifying the LaRC Fire Department of fires and provides personnel with the minimum information necessary to evacuate a facility in fire situations at LaRC.

7.10.2 SCOPE

This section shall apply to all LaRC employees, subcontractors, and visitors.

7.10.3 REQUIREMENTS

Any person observing a fire or explosion shall promptly evacuate the affected area or facility as quickly as possible, and if possible, activating a manual fire alarm pull station on the way outside should the fire alarm not already be sounding.

During evacuations, all work in the affected area cease, except those activities directly relating to the evacuation effort. All personnel, except those assigned to operations where evacuation present a more serious hazard than sheltering in place, shall immediately leave the area. The person(s) to remain shall be determined by the Facility Coordinator and/or Facility Safety Head.

All personnel shall proceed to the safest and most convenient mustering station assigned for that facility and shall stand by for further instructions.

Once at your mustering point and safe, someone in your group should promptly call 911 to relay the following type of information:

1. Exact location of fire or explosion.
2. Type of fire or explosion (e.g., material involved).
3. Whether explosives or highly flammable substances are present and, if so, the identity of the substances.
4. Progress of fire and how long it has been burning.
5. Name of individual reporting fire or explosion.
6. Any other pertinent information requested by the dispatcher.
 - Phone number

October 3, 2004

LPR 1710.11

- Personnel requiring assistance

In the event of a fire or explosion in a structure protected by an automatic fire protection system (automatic sprinkler or deluge system, or automatic detection system), the facility alarm shall activate, and the location is automatically transmitted to the LaRC EDO upon activation of the system. If the structure is occupied or an individual observes a fire or explosion in the structure, all personnel must evacuate the facility in accordance with this section.

Any supervisor present shall make a roster of all personnel at that mustering station. The supervisor who executes the mustering station roster shall forward it to the responding fire departments.

All fire alarms and fire drills shall coordinate with the Facility Coordinator and/or Facility Safety Head. A person shall be designated to monitor the area(s) when time does not permit for classified material to be placed in secure repositories (this applies only to fire drills).

Fire drills shall be held at least annually in all facilities. Fire drills shall be conducted on a random basis by the LaRC Fire Department station officer. A drill report shall be completed by the LaRC Fire Department station officer for each drill conducted. The following information is required to complete the drill report:

1. Date of drill.
2. Facility number.
3. Time of alarm.
4. Type of alarm.
5. Number and type of emergency vehicles that responded.
6. Arrival time of LaRC Fire Department vehicles.
7. Time facility check was completed.
8. Time "All Clear" was given.
9. Any other pertinent information relative to the drill.

The buddy system shall be used to assist physically challenged personnel in evacuating the facility/area during evacuations, both actual and drill. A person of adequate strength shall be assigned to each physically challenged employee to assist in evacuation. Responding emergency forces shall be notified if physically challenged personnel require assistance with evacuation.

7.10.4 RESPONSIBILITIES

LaRC Employees, Subcontractors, and Visitors shall:

1. Notify the LaRC emergency fire dispatcher of any observed fire or explosion by dialing 911 from any LaRC onsite telephone.

October 3, 2004

LPR 1710.11

2. Know evacuation routes and mustering stations for facilities where normally assigned.
3. Contact Facility Coordinator or Facility Safety Head for evacuation routes and mustering stations when working in areas different than normally assigned location.

LaRC Fire Chief shall:

1. Ensure that a continually staffed EDO is provided to receive incoming telephone, radio, or coded messages relative to fire or explosion reports.
2. Ensure quick responses to all fires or explosions at LaRC.
3. Ensure familiarity with facility layouts by conducting preplans.

Fire Department Station Officer shall:

1. Schedule and conduct fire drills.
2. Complete drill report after fire drill has been conducted.
3. Assess and approve, through coordination with LaRC Fire Chief, all mustering station/assembly point locations.

Facility Coordinator and/or Facility Safety Head shall:

1. Know the evacuation routes and all mustering stations for his or her work areas.
2. Inform employees of the following:
 - Location of emergency exits.
 - Evacuation routes and procedures.
 - Evacuation alarm signals.
 - Locations of mustering stations.
3. Ensure that all personnel have evacuated the affected area.
4. Direct LaRC Fire Department personnel to the location of the fire and convey the nature of the fire (from outside of the facility).

Area Supervisors shall ensure each machine operator shuts off any machine which is being operated, unless shutting off the machine creates a greater danger than running it unattended.

Equipment and Transportation Operators shall:

1. Cease operations in affected areas and close doors to areas and freight cars or trucks.
2. Restrict any unauthorized traffic into the area.
3. Ensure that trucks, loaded and empty, proceed to safe location outside of area.

October 3, 2004

LPR 1710.11

7.11 EMPLOYEE FIRE PROTECTION TRAINING

7.11.1 PURPOSE

This section establishes the required information, relative to the LaRC fire protection program, to be included in General Employee Training.

7.11.2 SCOPE

This section shall apply to all new hire employees required to receive General Employee Training at LaRC.

7.11.3 REQUIREMENTS

Each employee shall receive reinforcement of the following topics: (New employee video)

1. LaRC evacuation procedures.
2. LaRC smoking policies.
3. Notification and reporting of fires at LaRC.
4. Emergency telephone numbers for reporting fires and medical emergencies at LaRC.

Each employee shall receive fire extinguisher education including the discussion of the following topics: (Only if training is requested)

1. Four types of fire extinguishers available at LaRC.
2. Four classes of fires.
3. Proper procedures if employee discovers a fire at LaRC.
4. How to use a portable fire extinguisher.

7.11.4 RESPONSIBILITIES

LaRC Fire Chief shall:

1. Develop training material relative to fire protection for General Employee Training.
2. Review and revise training material as necessary.
3. Ensure that training sessions relative to fire protection are conducted during scheduled employee training course.
4. Obtain necessary audiovisual aids and printed material to be used by the trainer.

7.12 FIRE PROTECTION IN FACILITY OPERATING PROCEDURES

7.12.1 PURPOSE

This section ensures that fire protection standards and the accompanying guides are incorporated into LaRC facility operating procedures.

October 3, 2004

LPR 1710.11

7.12.2 SCOPE

This section shall apply to all facility operating procedures which are developed for use at LaRC.

7.12.3 REQUIREMENTS

The fire protection standards are compulsory. In some instances, the fire protection standard will refer to another code or standard. In those instances where a fire protection standard refers to another code or standard, this reference shall be deemed compulsory.

New or revised operating procedures must include the applicable requirements of these fire protection standards.

New and revised operating procedures which affect fire protection program issues must be reviewed by the LaRC Fire Chief.

7.12.4 RESPONSIBILITIES

SMAO Manager ensures that new operating procedures incorporate fire protection criteria.

Operating Procedure Author shall review the fire protection standards and incorporates the applicable requirements in new operations procedures and contact the LaRC Fire Chief if new procedures affect the fire protection program.

LaRC Fire Chief shall assist procedure developer, as requested, in determining if new procedure will affect the fire protection program and review and approve procedures affecting fire protection aspects.

CHAPTER 8**8. FIRE HAZARD PROTECTION****8.1 ELECTRICAL INSTALLATION IN HAZARDOUS LOCATIONS****8.1.1 PURPOSE**

This section establishes the requirements controlling the installation and use of explosion proof electrical systems and equipment at LaRC.

8.1.2 SCOPE

This section shall apply to the design, operation requirements, and responsibilities for explosion proof electrical installations.

8.1.3 REQUIREMENTS

NFPA 70, Articles 500 through 504 cover the requirements for electrical equipment and wiring for all voltages in locations where fire or explosion hazards may exist due to flammable gases or vapors, flammable liquids, combustible dust, or ignitable fibers or flyings.

Locations shall be classified depending on the properties of the flammable vapors, liquids or gases, or the combustible dusts or fibers that may be present and on the likelihood that a flammable or combustible concentration or quantity is present. Each room, section, or area shall be considered individually in determining its classification.

Explosion proof electrical equipment of the proper classification shall be provided in locations where flammable vapors, liquids, gases, or combustible dusts or fibers may be present in concentrations sufficient to produce explosive or ignitable mixtures.

All explosion proof electrical equipment used shall be UL listed or FM approved for use in the appropriate hazardous atmosphere.

No alterations or modifications shall be made to listed or approved equipment for hazardous locations. If modifications are made, the equipment shall be void for use in a classified hazardous location.

8.1.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Ensure that practices delineated in this section are followed.
2. Contact the LaRC Fire Chief prior to installation of new electrical systems and equipment or modification of existing electrical systems and equipment.

LaRC Fire Chief shall evaluate locations requested for the installation of electrical systems and equipment and modifications to existing electrical systems and equipment.

October 3, 2004

LPR 1710.11

8.2 FLAMMABLE AND COMBUSTIBLE LIQUIDS

8.2.1 PURPOSE

This section establishes the requirements for the safe use, storage, and handling of flammable and combustible liquids at LaRC.

8.2.2 SCOPE

This section shall apply to the use, storage, and handling of flammable and combustible liquids at LaRC.

8.2.3 REQUIREMENTS

8.2.3.1 General

Users of flammable/combustible liquids shall be familiar with the hazard classification for the purpose of complying with this section and NFPA 30.

All flammable and combustible liquid handling equipment and storage areas shall be labeled in accordance with Section 7.7 of this document.

8.2.3.2 Storage

Flammable or combustible liquids shall be stored in designated locations which have been approved by the LaRC Fire Chief or designee. All flammable storage cabinet locations shall be approved by the LaRC Fire Chief.

Flammable/combustible liquids storage shall provide for segregation and/or separation from incompatible materials.

The storage of flammable and combustible liquid shall not obstruct corridors, aisles, or exit doors; and flammable/combustible liquids are not stored in exit enclosures (e.g., stairwells).

Flammable liquids shall be stored in UL listed or FM approved flammable liquids storage cabinets and safety cans. Exception: Oil-based paints, varnish, shellac, and similar substances may be stored in their approved shipping containers in designated storage locations and may be used from these containers:

1. When flammable liquid storage cabinets shall be used, not more than 120 gallons of Class I, II, and IIIA liquids are stored in the cabinet. Of this total, not more than 60 gallons shall contain Class I and II liquids.
2. When flammable liquid storage cabinets are used, not more than three cabinets shall be stored in a single fire area. In industrial facilities, additional cabinets (limited to groups of three) may be stored in the same fire area, provided the groups of cabinets are separated by 100 feet. When flammable liquid storage cabinets are used, the vent openings shall be sealed with fitted metal bungs. When the cabinets are required to be vented, they shall be vented to the outside.

When storage quantities exceed amounts outlined above, the liquids shall be stored in rooms or facilities complying with NFPA 30 and 29 CFR 1910.106.

October 3, 2004

LPR 1710.11

Flammable liquids shall be in closed containers at all times when not in actual use. Containers and drums which have contained flammable liquids shall have covers, caps, or bungs replaced immediately after emptying. Bungs shall be replaced with pressure and vacuum relief vents once the sealed drum is opened. Safety cans shall have self-closing caps and flame arrestor screens. A dip tank or other similar open vessel used to hold flammable liquids shall be provided with a hinged metal cover arranged with fusible links to close automatically in case of a fire. Portable containers for storage of flammable liquids shall not exceed 5 gallons.

In operating facilities, not more than a 1-day supply of flammable/ combustible liquid shall be stored in a single fire area outside of an approved flammable liquid storage cabinet.

8.2.3.3 Transferring, and Dispensing Flammable and Combustible Liquids

Air pressure shall not be used on a drum, portable tank, or small container for transferring flammable and combustible liquids. Hand-operated rotary pumps or metal faucets shall be used.

Liquids shall be transferred to or from safety cans by means of a hand pump drawing through the top, or by gravity through an approved self-closing valve.

When dispensing or transferring flammable/combustible liquids, containers shall be bonded together and grounded to eliminate buildup of static electricity. When transferring liquids between conductive containers, the containers shall be bonded with a wire. The bonding wire or one of the containers shall be grounded.

During transfer of bulk quantities of flammable/combustible liquids, the transport tractor shall not be uncoupled from the tanker without approval of the LaRC Fire Chief.

When dispensing from drums, the drums shall be equipped with UL listed or FM approved dispensing devices.

When transferring Class I liquids in laboratories from containers of less than 5-gallon capacity, the transfer shall be made by either; inside a laboratory hood or in an area provided with ventilation to prevent the accumulation of a flammable vapor/air mixture exceeding 10 percent of the lower flammable limit.

When transferring Class I liquids in laboratories from containers of 5-gallon capacity or more, the transfer shall be made either from a separate area outside the facility or in a separate, inside storage room that complies with the requirements of NFPA 30 and 29 CFR 1910.106.

Mechanical ventilation shall be provided, which meets the following criteria, when transferring Class I liquids in nonlaboratory areas:

1. The ventilation flow rate shall be 1 cubic foot per minute per square foot of floor area, but in no case less than 150 cubic feet per minute.
2. The intake and exhaust points shall be within 12 inches of the floor and are positioned at opposite sides or ends of the room.
3. A flow monitor or equivalent mechanism shall be provided so an audible alarm will sound if the ventilation system fails.

October 3, 2004

LPR 1710.11

8.2.3.4 Using or Transporting Flammable or Combustible Liquids

A UL listed or FM approved safety can shall be required when flammable or combustible liquids are used or transported in LaRC. The use of 1-gallon glass or plastic containers for storage of flammable liquids shall be authorized by the LaRC Fire Chief or designee if the liquid either would be rendered unfit for its intended use by contact with metal or would excessively corrode a metal container and cause leakage. A small approved plastic container shall be used to limit the quantity of flammable liquids taken into an area. Class IA and IB liquids shall be stored in glass containers of not more than 1 gallon, if required for liquid purity or to avoid excessive corrosion of metal containers.

Each area where flammable or combustible liquids shall be stored or dispensed is marked with DANGER signs stating "NO SMOKING OR OPEN FLAMES."

Combustible waste and residue shall be stored in closed, metal containers for daily disposal.

8.2.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Ensure that practices delineated in this section are followed.
2. Contact the LaRC Fire Chief prior to establishing new flammable and combustible liquids storage areas or modifying existing flammable and combustible liquids storage areas.

LaRC Fire Chief shall evaluate locations requested to be used as a flammable and combustible liquid storage areas and modifications to flammable and combustible liquids storage areas.

8.3 SAFE STORAGE AND USE OF FLAMMABLE GASES

8.3.1 PURPOSE

This section establishes the requirements for the use, storage, and handling of compressed gases at LaRC.

8.3.2 SCOPE

This section shall apply to the storage, transportation, identification, and use of compressed gases at LaRC.

8.3.3 REQUIREMENTS

8.3.3.1 Storage

Compressed gas cylinders in transit or storage shall be provided with protective valve caps and are secured in an upright position.

All storage areas shall be clearly identified. The storage of compressed gas cylinders within facilities shall be limited to the quantity required for daily operations unless additional quantities are permitted by the applicable National Fire Protection Association

October 3, 2004

LPR 1710.11

(NFPA) standard. The storage of compressed gas cylinders outside of facilities shall be in accordance with the applicable NFPA standard.

Flammable and oxidizing compressed gas cylinders shall be separated by 20 feet or a 5-foot high, 30-minute fire rated wall. Where gases of different types are stored at the same location, cylinders shall be grouped by types of gas.

Empty and full gas cylinders shall be segregated, and empty cylinders tagged "EMPTY." "NO SMOKING" signs shall be posted around the storage rooms.

8.3.3.2 Operation

Compressed gas cylinders shall not be exposed to temperatures above 125°F and are protected from direct sun and weather elements.

Compressed gas cylinders shall be identified according to their contents, free of defects, and within their hydrostatic test dates. All gas cylinders shall be hydrostatically tested and marked to meet Department of Transportation (DOT) requirements.

Gases shall not be mixed or transferred from one compressed gas cylinder to another. Cylinders are refilled only by trained personnel.

Cylinders shall not be lifted by magnetic devices or by their protective caps. They shall be secured to a cradle or platform and must never be dragged, dropped, or struck.

Compressed gas cylinders shall not come in contact with electrical circuits, open flames, or arcs.

Compressed gas cylinders shall not be used for any purpose other than compressed gas containment.

Gas from compressed gas cylinders shall not be used without approved reducing regulators.

Connecting devices shall be free of oil, grease, and dirt and have threads corresponding to the cylinder valving.

Valves shall be closed when cylinders are transported, moved at sites, and connected for use.

All devices used on compressed gas cylinders shall comply with the American National Standards Institute (ANSI) and Compressed Gas Association Standards C-4 and V-1.

All compressed gas manifolds shall be designed in accordance with the applicable NFPA standards.

8.3.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Ensure that practices delineated in this section are followed.
2. Contact the LaRC Fire Chief prior to establishing new compressed gas storage areas or modifying existing compressed gas storage areas.

October 3, 2004

LPR 1710.11

LaRC Fire Chief shall evaluate locations requested to be used as compressed gas storage areas and modifications to compressed gas storage areas.

8.4 FIRE PROTECTION FOR PORTABLE STRUCTURES

8.4.1 PURPOSE

This section establishes the requirements for the installation and use of portable structures at LaRC.

8.4.2 SCOPE

This section shall apply to all purchased, leased, or locally constructed portable structures at LaRC. (The requirements in this section apply to new portable structures, or existing portable structures where the use has been changed. This does not apply to existing portable structures already in place and where the use remains unchanged).

8.4.3 REQUIREMENTS

8.4.3.1 Construction

A graded fire hazard analysis (FHA), meeting the requirements of Section 9.2 of this document, shall be performed for all portable structures where any one of the following conditions exist:

1. Creates a life safety hazard.
2. Contains a daycare or classroom.
3. Endangers the public or environment.
4. Replacement value (structure and contents) exceeds \$1 million.
5. Is vital to a NASA program.

All trailers and mobile home units shall meet the appropriate construction, mechanical system, and electrical system installation requirements of ANSI A119.1 and 24 CFR 280. Trailer/mobile home complexes that exceed 3000 square feet (278.71 square meters) shall meet all requirements for permanent structures listed in this document and local codes. Requirements for smaller complexes shall be determined by the authority having jurisdiction (AHJ).

All portable structures shall meet the minimum requirements as specified in the BOCA National Building Code. All portable structures used to support construction/ demolition operations shall be in accordance with NFPA 241 and 29 CFR 1926. The use of portable structures for housing electronic computer and data processing systems shall meet the requirements of Section 8.10 of this document.

Trailers and mobile home units arranged for occupancy shall comply with the interior finish, concealed space and exit requirements of NFPA 101.

Trailers and mobile home units shall be located in accordance with NFPA 80A but in no case less than 25 feet (7.62 meters) from permanent facilities and 25 feet (7.62 meters) apart.

October 3, 2004

LPR 1710.11

A complete fire detection and evacuation alarm system shall be provided.

Complete automatic sprinkler protection designed in accordance with the applicable NFPA standards shall be provided for portable structures as follows:

1. In all new structures over 5000 square feet.
2. In all structures having a maximum possible fire loss (MPFL) in excess of \$1 million.
3. In all structures where the MPFL will affect a vital program for a period longer than that specified as acceptable by the LaRC Director.
4. In all structures where the quantities of hazardous materials used or stored exceed the limits delineated in the local fire code.
5. In all structures used for sleeping quarters, including daycare centers. (For such structures, "quick response" sprinklers should be utilized.) An exception is that limited supply suppression systems may be used where a reliable water supply is not available or where the application of water would increase the overall hazard in the event of a fire.

8.4.3.2 Anchors and Supports

Each portable structure shall have support and anchoring systems that will resist overturning and lateral movement of the unit. Support and anchoring equipment shall be in accordance with the manufacturer's specifications.

Deviations from approved stabilization plans shall be designed by a registered structural engineer. Such designs shall carry the seal and signature of the registered engineer.

8.4.3.3 Identification

Portable structures shall be identified by a unique, alphanumeric marking on each side of the unit (e.g., B-1299 T-7).

The identification marking shall consist of a painted, 11-inch x 17-inch orange square, bordered by a 1-inch black border; and the identification marking in black characters, 1/2 inch or wider and at least 4 inches high within the orange square.

All other numerical identification shall be removed from the structure.

8.4.3.4 Skirting

Each portable structure shall have the area under the floor enclosed to prevent the accumulation of windblown debris and to prevent the space from being used for storage. Semi trailers used exclusively for storage shall also require skirting.

The skirting shall be of noncombustible material and without openings. The only exceptions shall be service access doors and screened louvers installed for ventilation.

October 3, 2004

LPR 1710.11

8.4.3.5 Pedestrian and Handicapped Access

All walkways shall be constructed of weather resistant materials except for those walkways used for temporary construction trailers. These may be constructed of weather resistant lumber with a permanent nonskid surface.

There shall be means of egress from a portable structure discharges into a roadway or traffic flow area.

Stairs with platforms and handrails shall be provided for each exterior door.

Ramps or wheelchair lifts shall be provided for portable structures that are to be used by the physically handicapped.

Note: Facilities provided for the physically handicapped shall be in accordance with the Americans with Disabilities Act (ADA).

Stairs, platforms, ramps, and handrails shall be arranged to resist movement.

Stairs, ramps, and platforms shall be constructed of steel, concrete, fiberglass, or other weather resistant materials. All stairs shall comply with 29 CFR 1910 and NFPA 101.

Stairs, ramps, platforms, and walkways shall have a permanent nonskid walking surface.

8.4.3.6 Electrical

All electrical conductors and equipment shall be in accordance with the latest edition of NFPA 70, National Electric Code (NEC). NEC Article 305 (Temporary Wiring) shall not apply to any wiring for trailers. NEC Article 215 shall apply to all feeder circuits installed on-site. Article 305-4(b) shall not apply.

All electrical conductors shall be copper.

All electrical circuits shall have a separate grounding wire. The use of trailer frame or other metal parts is not a permitted method of grounding. All conductive parts of the portable structure, including frame and siding skirting shall be bonded (grounded) to the main circuit breaker box.

Any wiring presently being installed or installed after the portable structure has been delivered shall be in steel conduit and surface mounted. Conduit shall not be used as the grounding path (separate grounding wire is required).

All installed breakers shall be permanently identified for their use.

Main service disconnects shall be located on the outside of the portable structure and clearly identified.

8.4.3.7 Heating and Cooling Systems

Installed heating and cooling equipment shall be listed or labeled and shall be installed in accordance with its listed design and appropriate standards.

Air duct and plenum materials shall be UL Class I or better.

Only electric or steam units shall be installed.

October 3, 2004

LPR 1710.11

8.4.3.8 Exits

All normally occupied portable structures shall have a minimum of two exits remote from each other.

Note: Other egress arrangements shall be permitted as specified by NFPA 101, Life Safety Code.

The minimum width of any main egress corridor serving multiple exit passageways shall be 44 inches.

The minimum width of any aisle serving to gain access to a corridor or exit passageway shall be 36 inches in the clear.

Note: The LaRC Fire Chief shall be permitted to approve aisles serving a single occupant that are 28 inches in clear width.

Passageways, aisles and corridors, serving as access to a required exit shall not be used for any purpose that could interfere with their intended use, including storage of boxes, file cabinets, desks, or trash containers.

No door opening in the means of egress shall be less than 32 inches in clear width.

Doors shall be arranged to be readily opened from the egress side whenever the structure is occupied.

Exits shall be marked by an approved sign readily visible from any direction of exit access.

Note: An exception shall be the main exterior doors that are obviously and clearly identified as exits.

Every required exit sign shall be suitably illuminated by a reliable light source.

8.4.3.9 Emergency lighting

All portable structures having an occupancy of 50 persons or more or a total footage of 10,000 square feet shall be provided with emergency lighting.

8.4.3.10 Vehicle Access

Vehicle access shall be provided in accordance with Section 7.2 of this document.

8.4.3.11 Location of Portable Structures Inside Other Structures

Unprotected portable structures shall not be permitted inside permanent facilities where the combined potential loss exceeds \$500,000.

Portable structures that have complete sprinkler systems shall be permitted inside permanent structures but are limited to 1000 square feet in floor area per unit.

Automatic sprinklers shall be positioned over and under the unit when materials that will burn or support combustion are present.

A minimum of 10 feet of clear space, free of combustibles, shall be maintained around each unit.

October 3, 2004

LPR 1710.11

The location of portable structures shall not hinder safe movement of personnel in the permanent facility nor violate the requirements of NFPA 101, Life Safety Code.

8.4.3.12 Operation

Flammable and/or combustible liquids shall be kept to an absolute minimum and shall be stored in and dispensed from UL listed or FM approved safety cans. Flammable or combustible liquid-soaked clothes, rags, or waste shall be stored in UL listed or FM approved safety containers.

Combustible materials which are used in the portable structure must NOT be allowed to accumulate. All combustible waste must be removed from the portable structure after each work shift.

The required minimum clear width of exits, aisles, and passageways to a public way shall be maintained at all times as specified in NFPA 101 and 29 CFR 1926.

Cutting, welding, open flame, or grinding shall not be performed in portable structures without an approved permit in accordance with Section 7.3 of this document.

Access for use of heavy fire fighting equipment shall be provided to the portable structure at the start of the project and is maintained until completion.

8.4.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Ensure that practices delineated in this section are followed.
2. Contact the LaRC Fire Chief prior to constructing or placing new portable structures.

LaRC Fire Chief shall evaluate locations requested to be used for a portable structure.

8.5 FIRE PROTECTION FOR STORAGE FACILITIES AND AREAS

8.5.1 PURPOSE

This section establishes the requirements for controlling the construction and use of storage facilities at LaRC.

8.5.2 SCOPE

This section shall apply to all general storage facilities at LaRC. (This section does not apply to current storage facilities unless the use has changed or the hazard in increased from its original approved usage).

8.5.3 REQUIREMENTS

8.5.3.1 Construction

Storage facilities shall be constructed in accordance with the applicable sections of the BOCA National Building Code and NFPA 101.

Storage facilities storing vital and important equipment or supplies shall be located in noncombustible facilities protected with automatic sprinklers. Sprinkler systems

October 3, 2004

LPR 1710.11

installed in facilities used for solid pile, bin box, shelf, or palletized storage which is less than 12 feet in height shall be in accordance with NFPA 13. Sprinkler systems installed in facilities used for solid pile, bin box, shelf, or palletized storage which is greater than 12 feet in height shall be in accordance with NFPA 231, NFPA 231C, and the applicable sections of NFPA 13.

8.5.3.2 Operation

Appropriate fire extinguishers shall be provided for storage facilities.

Good housekeeping, orderliness, and maintenance of equipment shall be provided for storage facilities.

Storage facilities shall be posted as "No Smoking" areas.

Storage facilities shall not be used as working spaces, except as approved by the LaRC Fire Chief.

Combustible materials which are used in the storage facility operations (e.g., files, films, paper products) shall be removed from the storage facilities immediately after use or stored in approved metal containers with lids. All combustible waste shall be removed from the records storage facility after each work shift.

The required minimum clear width of exits, aisles, and passageways to a public way shall be maintained at all times as specified in NFPA 101.

Cutting, welding, open flame, or grinding shall not be performed in storage facilities without an approved permit in accordance with Section 7.3 of this document.

8.5.3.3 Yard/Outdoor Storage

Yard/Outdoor storage shall only be permitted in designated locations. The LaRC Fire Chief shall be notified prior to the establishment of new yard/outdoor storage locations in order to evaluate the site for determination of adequate protection and potential impact on the emergency evacuation of adjacent facilities / fire department access. The following requirements generally apply only to situations involving combustible storage. Where requirements apply to both combustible and noncombustible storage, a requirement will be immediately followed by an asterisk (*).

Materials shall be stored in piles as low in height and small in area as practical for material stored. The pile size shall be based on the following:

1. Stability of pile
2. Effective reach of fire fighting hose streams
3. Combustibility of material
4. Ease of pile breakdown under fire or salvage conditions

Clear aisles shall be maintained between the following*:

1. Individual piles.
2. Piles and buildings.
3. Piles and boundary of yard/outdoor storage site.

October 3, 2004

LPR 1710.11

All aisle widths shall be twice the pile height.

Yard/Outdoor storage locations shall be kept clear of rubbish (e.g., broken pallets, scrap paper, packing materials), vegetation, and any other unnecessary combustible materials*.

Cutting, welding, or other operations involving the use of flame-, heat-, or spark-producing tools shall not be performed within 50 feet of any yard/outdoor storage area.

Portable heating devices shall not be used or located within yard/outdoor storage areas.

Smoking shall not be permitted in yard/outdoor storage areas.

Tarpaulins or other covers used to protect the stored materials from the weather shall be of fire retardant material.

Means of expediently notifying the LaRC Fire Department in case of fire shall be provided at all yard/outdoor storage locations.

Portable fire extinguishers shall be provided at conspicuous, accessible locations throughout all yard/outdoor storage.

Access to fire hydrants must not be obstructed*.

Yard storage areas shall be inspected to ensure that storage practices comply with the requirements of this section*.

8.5.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Ensure that practices delineated in this section are followed.
2. Contact the LaRC Fire Chief prior to establishing new storage facilities*.

LaRC Fire Chief shall evaluate locations requested to be used as a storage facility*.

8.6 FIRE PROTECTION FOR COMBUSTIBLE SOLIDS, METALS, AND DUSTS

8.6.1 PURPOSE

This section establishes the requirements for the use, storage, and handling of combustible solids, metals, and dusts at LaRC.

8.6.2 SCOPE

This section shall apply to the design, operation requirements, and personnel responsibilities in locations where combustible solids, metals, and dusts are stored, processed, or handled.

8.6.3 REQUIREMENTS

8.6.3.1 Design

Facilities handling or storing combustible solids, metals, and dusts shall be in accordance with the local building code and applicable National Fire Protection Association (NFPA) standards.

October 3, 2004

LPR 1710.11

Whenever inert gas environment systems are used, a reserve supply of gas shall be available for emergency use.

8.6.3.2 Operation

The appropriate extinguishing agents shall be used where pyrophoric materials and combustible solids, metals, and dusts are processed, stored, or handled. Most pyrophoric materials react violently with water, foam agents, halogenated agents, and carbon dioxide gas. Some combustible metals cannot be extinguished with water and require special extinguishing powders (for Class D fires) or special inerting gases.

Processes involving pyrophoric materials shall be performed in an enclosed, oxygen free, oxygen deficient, or inerting atmosphere that is moisture-controlled (dry).

Ordinary combustible materials, such as paper, wood, cartons, and packing material, shall not be stored or allowed to accumulate near processes where pyrophoric materials and combustible solids, metals, and dusts are handled.

Smoking and uncontrolled use of open flames shall be prohibited where combustible solids, metals, and dusts are processed, stored or handled. Areas shall be clearly posted with "NO SMOKING" signs.

Nonsparking tools shall be used when handling combustible metal dusts.

8.6.3.3 Pyrophoric Materials

Plans for a designated pyrophoric materials storage area shall be forwarded to the LaRC Fire Chief for approval.

Class D portable fire extinguishers shall be provided and located so that the travel distance to an extinguisher does not exceed 75 feet.

Other combustible materials shall not be stored in the designated pyrophoric materials storage area. This designated storage area shall be separated from storage of Class A combustible materials by at least 30 feet or fire walls with a 2-hour rating shall be provided. Any opening in this wall shall be protected by listed, 1 -hour, automatically closing fire doors. The designated storage area shall be separated from combustible liquids storage by at least 50 feet or fire walls with a 4-hour rating shall be provided. Any opening in this wall shall be protected by listed, 3-hour, automatically closing fire doors on both sides of the opening. Appropriate secondary confinement must be provided to prevent any spilled liquids from entering the designated storage area. Noncombustible materials in noncombustible containers on metal pallets are permitted to be stored in the separation space.

Smoking and uncontrolled use of open flames shall be prohibited in the pyrophoric materials storage area.

8.6.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall:

1. Ensure that practices delineated in this section are followed.

October 3, 2004

LPR 1710.11

2. Contact the LaRC Fire Chief prior to establishing new pyrophoric materials and combustible solids, metals, and dusts operations areas or modifying existing pyrophoric materials and combustible solids, metals, and dusts operations areas.

LaRC Fire Chief shall evaluate locations requested to be used as combustible solids, metals, and dusts operations areas and modifications to existing pyrophoric materials and combustible solids, metals, and dusts operations areas.

8.7 FIRE PROTECTION FOR CLEAN ROOMS

8.7.1 PURPOSE

This section establishes the requirements for the construction and use of clean room facilities at LaRC.

8.7.2 SCOPE

This section shall apply to all new clean room facilities, and those existing clean rooms that undergo significant renovation at LaRC.

8.7.3 REQUIREMENTS

8.7.3.1 Construction

NASA clean rooms shall be constructed and protected in accordance with the appropriate provisions of National Fire Protection Association (NFPA) 318 and FM Data Sheet 1-56.

Automatic fire suppression shall be provided throughout facilities containing clean rooms and clean zones. Sprinklers shall be installed throughout all clean rooms regardless of classification. Sprinkler temperature rating within the clean room shall be 130°F. Special consideration shall be given for installation of local application, gaseous suppression systems to protect special hazards.

Clean rooms shall be separated from adjacent occupancies by 1-hour fire resistant construction. Operations within facilities shall be arranged in separate zones according to their clean room classification and in a manner compatible with operating efficiency. The cutoff construction shall have a fire resistance commensurate with both the clean room and exposing area hazards and values. Clean rooms shall be located to minimize external exposure from fires and other hazards. Floors over clean rooms shall be made watertight. Fire retardant plastic panels prone to producing large quantities of smoke shall not be used in the construction of clean rooms. Noncombustible panels shall be used instead. Benches and hoods shall be of noncombustible construction or protected with automatic sprinklers.

High-efficiency particulate air (HEPA) filtration systems shall be in accordance with Section 8.15 of this document. Clean room ventilating ducts and equipment shall be constructed of noncombustible materials.

A complete fire detection and evacuation alarm system shall be provided in facilities containing clean rooms and clean zones.

October 3, 2004

LPR 1710.11

8.7.3.2 Operation

Fire extinguishers shall be provided for clean room facilities in accordance with NFPA 10.

Good housekeeping, orderliness, and maintenance of equipment shall be provided for clean room facilities.

Clean room facilities shall be posted as "No Smoking" areas.

Combustible materials which are used in the clean room facility operations shall be removed from the clean room facilities immediately after use or shall be stored in approved metal containers with lids.

The required minimum clear width of exits, aisles, and passageways to a public way shall be maintained at all times as specified in NFPA 101.

8.7.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure that practices delineated in this section are followed.

LaRC Fire Chief shall evaluate clean rooms in accordance with this section.

Center Operations Directorate shall ensure that all new clean room facilities or modifications to existing facilities meet the requirements of this section.

8.8 FIRE PROTECTION FOR AIRCRAFT HANGARS

8.8.1 PURPOSE

This section establishes the requirements for the construction and use of aircraft hangar facilities at LaRC.

8.8.2 SCOPE

This section shall apply to all aircraft hangar facilities at LaRC.

8.8.3 REQUIREMENTS

8.8.3.1 General

NASA aircraft hangars shall be constructed and protected in accordance with the provisions of National Fire Protection Association (NFPA) 409 and FM Data Sheets 7-93 and 7-93N.

8.8.3.2 Protection Systems

New hangars shall be protected by one of the following methods:

1. Overhead, foam-water deluge systems, utilizing aqueous film forming foam (AFFF), and designed in accordance with NFPA 409.
2. Overhead foam-water wet pipe sprinkler systems and AFFF monitor nozzles.

October 3, 2004

LPR 1710.11

8.8.3.3 Construction

New aircraft hangars shall be of protected noncombustible construction with all principal supporting members protected by gypsum panels sufficient to achieve at least a 1-hour fire resistance rating.

In existing hangars, main structural elements need not be rendered fire resistant if the hangar is provided with a floor drainage system and is protected by a complete, automatic fire suppression system.

Aircraft ramps used for fueling operations shall be designed in accordance with NFPA 415.

8.8.3.4 Draft Curtains

Draft curtains shall be provided in accordance with the guidelines contained in NFPA 204M. The distance between curtains boards shall not exceed 100 feet.

8.8.3.5 Operation

Appropriate fire extinguishers shall be provided for aircraft hangar facilities.

Good housekeeping, orderliness, and maintenance of equipment shall be provided for aircraft hangar facilities.

Aircraft hangar facilities shall be posted as "No Smoking" areas.

Combustible materials which shall be used in the aircraft hangar facility operations shall be removed from the aircraft hangar facilities immediately after use or shall be stored in approved metal containers with lids.

The required minimum clear width of exits, aisles, and passageways to a public way shall be maintained at all times as specified in NFPA 101.

Aircraft fuel servicing operations shall be in accordance with NFPA 407.

Aircraft maintenance operations shall be in accordance with NFPA 410.

Cutting, welding, open flame, or grinding must not be performed in aircraft hangar facilities without an approved permit in accordance with Section 7.3 of this document.

8.8.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure that practices delineated in this section are followed.

LaRC Fire Chief shall evaluate aircraft hangars in accordance with this section.

Center Operations Directorate Director shall ensure that all new aircraft hangar facilities or modifications to existing facilities meet the requirements of this section.

8.9 FIRE PROTECTION FOR FLIGHT SIMULATORS

8.9.1 PURPOSE

This section establishes the requirements for the construction and use of flight simulator facilities at LaRC.

October 3, 2004

LPR 1710.11

8.9.2 SCOPE

This section shall apply to all new flight simulator facilities and existing flight simulator facilities undergoing significant renovation. Existing flight simulators not undergoing significant renovation shall comply with these requirements to the extent practicable.

8.9.3 REQUIREMENTS

8.9.3.1 Construction and Protection

NASA flight simulators shall be constructed and protected in accordance with the appropriate provisions of FM Data Sheet 7-3.

Facilities and rooms containing flight simulators as well as the training module shall be constructed of noncombustible materials.

The hydraulic fluid pump and reservoir shall be separated from other portions of the simulator facility by 1-hour fire resistant construction.

The training module for new simulators shall be protected by an approved automatic total-flooding fire extinguishing system to protect the cockpit, beneath the floor, behind the instrument panels, and inside the electronic switchgear and electronic data processing cabinets:

Actuation of the extinguishing system shall be done by ionization-type smoke detectors.

Electronic data processing equipment shall be in accordance with Section 8.10 of this document.

The hydraulic pump and storage facility shall be protected by automatic sprinklers over the hydraulic fluid pump room and storage facility.

The simulator system room and facility shall be protected with automatic sprinklers throughout all areas where there is combustible occupancy or construction or where hydraulic fluids are used.

Visual aid equipment shall require automatic sprinkler protection if the visual display is of combustible construction.

HEPA filtration systems shall be in accordance with Section 8.15 of this document.

A complete fire detection and evacuation alarm system shall be provided in facilities containing flight simulators. The signaling system shall be fully supervised and arranged to sound an alarm at a constantly attended location.

8.9.3.2 Operation

Appropriate fire extinguishers shall be provided for flight simulator facilities in accordance with NFPA 10.

Good housekeeping, orderliness, and maintenance of equipment shall be provided for flight simulator facilities.

Flight simulator facilities shall be posted as "No Smoking" areas.

October 3, 2004

LPR 1710.11

Combustible materials which are used in the flight simulator facility operations shall be removed from the flight simulator facilities immediately after use.

The required minimum clear width of exits, aisles, and passageways to a public way shall be maintained at all times as specified in NFPA 101.

8.9.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure that practices delineated in this section are followed.

LaRC Fire Chief shall evaluate flight simulators in accordance with this section.

Center Operations Directorate shall ensure that all new flight simulator facilities or modifications to existing facilities meet the requirements of this section.

8.10 FIRE PROTECTION FOR COMPUTER FACILITIES

8.10.1 PURPOSE

This section establishes the requirements for the installation and use of computer facilities at LaRC.

8.10.2 SCOPE

This section shall apply to computer facilities which meet one or more of the following conditions:

1. Designated as vital to the NASA mission.
2. Required for security.
3. Valued at \$1 million or more.
4. Required for operations which could be performed by substitute methods but where the substitute methods would result in unacceptable delays or would involve significant additional expenditures of personnel, facilities, and equipment.

8.10.3 REQUIREMENTS

8.10.3.1 Construction

All new computer facilities shall meet the minimum constructions requirements and shall be provided with the appropriate fire protection features specified in National Fire Protection Association (NFPA) 75 and STD 8719.11, Section 703, except as modified herein.

8.10.3.2 Operation

Waste shall not be allowed to accumulate..

Computer facilities with raised floors shall be provided with floor lifters which are mounted near the room exit door. The area under the raised floor shall be inspected annually to assure that no combustibles have accumulated.

October 3, 2004

LPR 1710.11

Employees who normally work in computer facilities must be familiar with the fire protection systems in their work area.

The required minimum clear width of exits, aisles, and passageways to a public way must be maintained at all times specified in NFPA 101.

8.10.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure that practices delineated in this section are followed and must contact the LaRC Fire Chief prior to establishing new computer facilities or modifying existing computer facilities.

LaRC Fire Chief shall evaluate locations requested to be used as computer facilities and modifications to existing computer facilities.

8.11 FIRE PROTECTION FOR ANECHOIC CHAMBERS

8.11.1 PURPOSE

This section establishes the requirements for the construction and use of anechoic chamber facilities at LaRC.

8.11.2 SCOPE

This section shall apply to all new anechoic chamber facilities, and those undergoing significant renovation at LaRC. Existing anechoic chamber facilities shall comply with the requirements listed below to the extent practicable.

8.11.3 REQUIREMENTS

8.11.3.1 General

No single protection approach is appropriate for all anechoic chambers. Because of the range of chamber sizes, purposes, contents, sensitivities and locations, a specific protection goal has been established and the following requirements developed to meet the criteria of STD 8719.11.

Anechoic chambers shall be constructed and protected in accordance with the appropriate provisions of STD 8719.11 and FM Data Sheets 1-53, 1-53S.1, and 1-53S.2, except as amended herein.

8.11.3.2 Construction

Control rooms shall be separated from the chamber by partitions having a fire resistance rating of 1 hour.

Note: Higher fire resistance ratings may be required based on the fire hazards associated with the chamber.

Vision panels shall be no more than 9 square feet and are wired glass in steel frames.

Air conditioning systems or other chamber ducting shall be independent of main facility systems.

October 3, 2004

LPR 1710.11

All new anechoic chamber foam materials shall meet the fire retardant criteria specified by FM.

Existing chambers with non-Naval Research Laboratory (NRL) foam shall be converted to NRL foam wherever possible.

Areas such as control rooms, concealed ceiling spaces, subfloor areas, and below pedestals shall be protected if combustibles are present. Protection shall be consistent with the protection of the chamber.

Electrical equipment in the chamber shall be arranged as follows:

1. Power supplies shall be in conduit, and outlets shall have watertight-type covers installed so that the spring-loaded cover is on the top when the outlet is in use.
2. Control cables shall have abrasion resistant, nonflammable insulation and screw-on or bayonet twist lock connectors.

Standpipe connections shall be provided just outside the doors of the chamber so that all points within the chamber shall be within reach of the hose stream.

If anechoic chambers are located in stories above other water damageable occupancies, their floors shall be watertight and built with curbs to protect against any penetration at the walls.

Floor drainage shall be incorporated into the design of new chambers as follows:

1. The drain outlets shall be arranged to drain to safe locations where other property will not be exposed to water damage.
2. The drainage system shall be designed with sufficient capacity to safely dispose of the sprinkler and hose stream water discharge during a fire.

Anechoic chambers shall be protected by a complete automatic sprinkler system.

Exception: Existing chambers shall be protected by a carbon dioxide or other suitable and approved gaseous fire extinguishing system.

The use of RF shielding gaskets in sprinkler systems shall be limited to those types that pose no obstruction to the waterway. If any portion of the gasket must protrude into the pipe interior, the resulting friction loss should be established and taken into account in the hydraulic calculations.

The sprinkler system shall be designed in accordance with Table 8.1 and is controlled by a separate indicating-type control valve.

HEPA filtration systems shall be in accordance with Section 8.15 of this document.

A complete smoke detection system shall be provided in facilities containing anechoic chambers.

October 3, 2004

LPR 1710.11

Table 8.1, Sprinklers for Anechoic Chambers

Protection	SMOOTH SURFACES		GEOMETRIC SHAPES (Pyramids)		
	Up to 10 in. thick (250 mm)	Over 10 in. thick (250 mm)	Up to 6 in. thick (150 mm)	6 to 12 in. thick (300 mm)	Over 12 in. thick (300 mm)
Automatic Sprinklers: 100-ft ² coverage, 10-ft max. spacing, 212°F, standard sprinkler heads, 1/2-in. extra hazard piping, 0.30-gpm/ft ² (12-l/min/m ²) average density (Note 2)	X		X		
Automatic Sprinklers: 50-ft ² coverage, 8-ft max. spacing, 212°F, standard sprinkler heads, 1/2-in. extra hazard piping, 0.60-gpm/ft ² (25-l/min/m ²) average density (Note 2)		X		X (Note 3)	
Automatic Sprinklers: 40-ft ² coverage, 7-ft max. spacing, 212°F, standard sprinkler heads, 1/2-in. extra hazard piping, 0.60-gpm/ft ² (25-l/min/m ²) average density (Note 2)					X (Note 3)
Side Wall Automatic Sprinklers (not over 7-ft spacing)	X (Note 4)	X (Note 4)	X (Notes 3,5)		
Side Wall Automatic Sprinklers (not over 5-ft spacing)				X (Notes 3, 5)	X (Notes 3, 5)

NOTES

1. Adapted from Factory Mutual Loss Prevention Data Sheets.
2. For chambers under 2000 ft² (186 m²) of floor area, the average density is for all heads. For chambers over 2000 ft², average density is for 3/4 of the sprinklers.
3. Sprinklers are located 1/3 the length of the pyramid from its base.
4. Required for walls over 15 ft (5 m) high and installed at approximately 15-ft vertical intervals.
5. Intermediate row required for walls over 15 ft high.

8.11.3.3 General Safeguards

No open flame equipment shall be allowed. All equipment shall have covers in place.

All equipment with fans shall have shields and screens installed to ensure free flow of inlet and outlet air. No exposed electrical terminals of any kind shall be permitted on any equipment.

Commonly used metal halide lamps shall be acceptable, but all incandescent lights shall be vented to prevent heat buildup.

The power density of any equipment operated in the chamber shall not exceed 1 watt per square inch incident upon the liner material. Where higher power densities are needed, the foam shall be laboratory tested for resistance to smoldering, and appropriate operating conditions shall be established.

October 3, 2004

LPR 1710.11

Prior to use of any electrical equipment in the chamber (including flexible wiring or exposed power supply terminals), the difference between the chamber ground and equipment chassis shall not exceed 0.5 volt.

Wiring in the chamber shall be repaired only by qualified personnel.

Fire extinguishers type and capacity shall be provided near the chamber door.

No equipment shall be left operating in the chamber while the control room is unattended. At the close of business each day, all exterior doors to the chamber shall be closed, and the main power to the chamber shall be secured.

Flammable or combustible liquids shall not be permitted inside the chamber unless approved by the LaRC Fire Chief. Alcohol used for cleaning electrical contacts shall be replaced by Freon 113.

Welding equipment, smoking, or open flames shall not be allowed in the chamber. A sign placed near each entrance shall outline restrictions affecting fire safety.

High-intensity flood lamps shall be used only with the approval of the LaRC Fire Chief.

Fire protection equipment shall be inspected and maintained as recommended in Section 5.6 of this document. Particular attention shall be given to the following:

1. The system activating devices shall be checked to see that they are functional.
2. The protection equipment shall be arranged so that it can be adequately tested every 6 months by simulating emergency mode conditions.
3. All equipment requiring servicing and testing shall be readily accessible and provided with a practical means for adequate cleaning.
4. Where protection systems use telescoping assemblies, they shall be moved through their full travel distance annually.

All employees having access to the chamber shall receive basic instruction in the general operation of the protection system, including the adverse consequences of using manual pulls or abort switches.

Chamber operators shall establish a salvage plan as part of their overall property conservation preparedness.

The required minimum clear width of exits, aisles, and passageways to a public way shall be maintained at all times as specified in National Fire Protection Association (NFPA) 101.

8.11.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure that practices delineated in this section are followed.

LaRC Fire Chief shall evaluate anechoic chambers in accordance with this section.

Center Operations Directorate shall ensure that all new anechoic chamber facilities or modifications to existing facilities meet the requirements of this section.

October 3, 2004

LPR 1710.11

8.12 FIRE PROTECTION FOR TEMPORARY ENCLOSURES AND MEMBRANE STRUCTURES

8.12.1 PURPOSE

This section establishes the requirements for the installation and use of temporary enclosures and membrane structures at LaRC.

8.12.2 SCOPE

This section shall apply to all temporary and rigid frame membrane enclosures at LaRC and includes requirements and personnel responsibilities for fire protection. The scope of this section also shall require compliance with the applicable sections of National Fire Protection Association (NFPA) 241.

8.12.3 REQUIREMENTS

Temporary enclosures erected within or around a facility shall not be structurally supported by piping arrangements designed for automatic sprinkler systems and other fire protection equipment.

Temporary enclosures shall be provided with adequate temporary fire protection systems and/or portable fire extinguishers, as approved by the LaRC Fire Chief. Fire protection systems installed in temporary enclosures shall comply with the applicable NFPA standards. Temporary enclosures shall require LaRC Fire Department inspections in accordance with Section 10.7 of this document.

Only noncombustible supports and panels, flame resistant tarpaulins, or approved materials of equivalent fire retardant characteristics shall be used for construction of temporary enclosures. Wood materials purchased for use in safety related areas at LaRC shall be designated as fire retardant, pressure-treated lumber suitable for exterior use. All wood materials shall comply with the requirements for flame spread of 25 or less, with no evidence of significant progressive combustion when tested for a 30-minute period under the standard test method for fire hazard classification of building materials (ASTM E 84) and with no increase in the listed classification when subjected to the UL standard rain test (ASTM D 2898). Each piece of wood shall permanently bear the mark of an accredited testing agency every 2 feet. Alternate markings shall be acceptable, if approved by the LaRC Fire Chief. The purchase of lumber not meeting the requirements specified above must be approved by the LaRC Fire Chief. The end use, location to be used, and justification for not using fire retardant, pressure-treated lumber shall be presented to the LaRC Fire Chief for review and approval before purchase of the lumber. Exemptions shall be granted by exception rather than by rule.

All plastic films and fabrics for general use shall be of the flame retardant type meeting or exceeding the flame resistant requirements of NFPA 701.

The material specified for the shell of a membrane structure shall pass the NFPA 701 large-scale test. The material specified for the shell of a membrane structure shall meet the requirements of the ASTM E 84-89a (maximum flame spread 25/maximum smoke development 450). The material specified for the shell of a membrane structure shall be submitted to a third-party, independent testing laboratory for evaluation, and the test

October 3, 2004

LPR 1710.11

results shall be submitted to the LaRC Fire Chief for review and authority. The material specified for the shell of a membrane structure shall be tested and evaluated, in accordance with Chapter 14 of NFPA 701, which outlines accelerated dry cleaning, laundering, and water leaching test protocols to determine the adequacy of fire retardant and ultraviolet protection to hold up over a period of time when exposed to weather.

Temporary is defined as any equipment or structure whose use will not exceed 6 months. Temporary equipment or structures shall not exceed 1 year. (Temporary units may be permitted one 6-month extension). Temporary equipment or structures in use or remaining at the Center for over one year shall be considered permanent and must meet all applicable requirements of said equipment or structure.

All enclosing material shall be fastened securely so it cannot be blown against heaters or other sources of ignition. Note: Temporary enclosures, trailers, sheds, security barricades, and other facilities, when located within a structure or within 30 feet of a structure, shall be of noncombustible construction.

Temporary enclosures and areas within 10 feet of the perimeter of the enclosures shall be posted as "No Smoking" areas.

All construction/operation electrical wiring and equipment for light, heat, or power supplies shall be in accordance with the applicable sections of NFPA 70.

Flammable and/or combustible liquids shall be kept to an absolute minimum and shall be stored in and dispensed from UL listed or FM approved safety cans. Flammable or combustible liquid-soaked clothes, rags, or waste shall be stored in UL listed or FM approved safety containers.

Combustible materials which are used in the enclosure operations (e.g., rags, paper products) must be removed from the enclosure immediately after use or are stored in approved metal containers with lids in place. All combustible waste must be removed from the enclosure after each work shift.

The required minimum clear width of exits, aisles, and passageways to a public way shall be maintained at all times as specified in NFPA 101 and 29 CFR 1926.

Cutting, welding, open flame, or grinding must not be performed in enclosures without an approved permit in accordance with Section 7.3 of this document.

Access for use of heavy fire fighting equipment shall be provided to the temporary enclosure or job site at the start of the project and maintained until completion.

8.12.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head or LaRC Engineering shall ensure that practices delineated in this section are followed and contact the LaRC Fire Chief prior to establishing new temporary enclosures.

LaRC Fire Chief shall evaluate locations requested to be used as a temporary enclosure.

October 3, 2004

LPR 1710.11

8.13 FIRE PROTECTION FOR VITAL RECORDS STORAGE

8.13.1 PURPOSE

This section establishes the requirements for the construction and use of new record storage facilities and those undergoing significant renovation, including record vaults, file rooms, archives, and records centers at LaRC. This section does not consider requirements that may be part of a security program needed to prohibit forcible entry.

8.13.2 SCOPE

This section shall apply to the collection of records in record storage facilities at LaRC.

8.13.3 REQUIREMENTS

8.13.3.1 Construction

Record storage facilities shall be constructed in accordance with the applicable sections of National Fire Protection Association (NFPA) 232. Record storage vaults and file rooms exceeding 50,000 cubic feet and all archives and records centers shall be in accordance with NFPA 232AM.

Record storage facilities which store vital and important records shall be located in noncombustible facilities protected with automatic sprinklers. Areas that provide storage of vital and important records shall be equipped with smoke detection systems.

8.13.3.2 Operation

Vital and important records (as defined by NFPA 232) shall be protected against fire.

Records that can be reproduced shall be duplicated and stored away from the originals so they will not be subject to the same fire incident.

Appropriate fire extinguishers shall be provided for record storage facilities.

Good housekeeping, orderliness, and maintenance of equipment shall be provided for record storage facilities.

Record storage facilities shall be posted as "No Smoking" areas.

Record storage facilities shall not be used as working spaces.

Unauthorized persons are not permitted in record storage facilities.

Combustible materials which are used in the record storage facility operations (e.g., files, films, paper products) shall be removed from the record storage facility immediately after use or transported and stored in approved metal containers with lids. All combustible waste shall be removed from the record storage facility after each work shift.

The required minimum clear width of exits, aisles, and passageways to a public way shall be maintained at all times as specified in NFPA 101.

Cutting, welding, open flame, or grinding must not be performed in record storage facilities without an approved permit in accordance with Section 7.3 of this document.

October 3, 2004

LPR 1710.11

8.14 FIRE PROTECTION FOR OVENS, FURNACES, AND ENVIRONMENTAL CHAMBERS

8.14.1 PURPOSE

This section establishes the fire protection requirements for the installation and use of ovens, furnaces, and environmental chambers at LaRC.

8.14.2 SCOPE

This section shall apply to the design, operation requirements, and personnel responsibilities for ovens, furnaces, and environmental chambers creating fire protection issues at LaRC.

8.14.3 REQUIREMENTS

8.14.3.1 Design

Before new equipment is installed or existing equipment is modified, complete plans, sequence of operations, and specifications shall be submitted to the LaRC Fire Chief for approval. Plans shall be drawn and show all essential details as to location, construction, ventilation, piping, and electrical safety equipment. A list of all combustion control and safety equipment, including manufacturer and type/model number, shall be included. Wiring diagrams and sequence of operations for all safety control shall be provided. All wiring in and around ovens, furnaces, and environmental chambers shall be in accordance with National Fire Protection Association (NFPA) 70.

Ovens, furnaces, and environmental chambers shall be located with consideration given to the possibility of fire resulting from overheating, quench tanks, ignition of hydraulic oil, overheating of material in the equipment, or the escape of fuel and to the possibility of facility damage and personal injury resulting from an explosion. Ovens, furnaces, and environmental chambers shall be located and erected so that the facility structural members will not be adversely affected by the maximum anticipated temperatures.

Ovens, furnaces, and environmental chambers that may contain flammable liquids, vapors, or gases shall be equipped with an unobstructed relief vent for freely relieving internal explosions.

Emergency shutoff valves shall be provided to permit turning off fuel in an emergency and are located so that fires and explosions in the ovens, furnaces, and environmental chambers will not prevent access to these valves.

Fuel-fired ovens, furnaces, and environmental chambers shall be provided with all safety devices in accordance with established safe practices.

Ovens, furnaces, and environmental chambers containing or processing sufficient combustible materials to sustain a fire shall be equipped with automatic sprinklers, as required by the LaRC Fire Chief. When oven, furnace, or environmental chamber temperatures are over 465°F or when a flash fire condition may exist, an open sprinkler system, supplied by an approved deluge valve equipped with a hand-pull for manual operation and controlled by heat-actuated devices, shall be recommended within the equipment.

October 3, 2004

LPR 1710.11

8.14.3.2 Operation

Operational and maintenance procedures shall be developed for each oven, furnace, and environmental chamber and include:

1. Entry requirements.
2. Maintenance checklist.
3. Cleaning requirements.
4. Combustible loading and usage limits.

Regular personnel shall receive scheduled training and testing to maintain a high level of proficiency and effectiveness. Operator training shall include:

1. Combustion of fuel-air mixtures.
2. Explosion hazards.
3. Sources of ignition including auto ignition.
4. Functions of control and safety devices.
5. Handling of special atmospheres.
6. Handling and processing of hazardous materials.

Portable fire extinguishers shall be provided for the appropriate hazards.

Accumulation of combustible materials such as cartons, papers, and packaging materials shall be prohibited in and around ovens, furnaces, and environmental chambers.

The required minimum clear width of exits, aisles, and passageways to a public way must be maintained at all times as specified in NFPA 101.

8.14.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure that practices delineated in this section are followed and contact the LaRC Fire Chief prior to installation of new ovens, furnaces, and environmental chambers or modification of existing ovens, furnaces, and environmental chambers.

LaRC Fire Chief shall evaluate locations requested for the installation of ovens, furnaces, and environmental chambers and modifications to existing ovens, furnaces, and environmental chambers.

Center Operations Directorate shall ensure that the design requirements delineated in this section are followed.

Operators/Employees shall follow the operational requirements delineated in this section.

October 3, 2004

LPR 1710.11

8.15 FIRE PROTECTION FOR HEPA FILTER SYSTEMS

8.15.1 PURPOSE

This section establishes the requirements for the installation and use of high-efficiency particulate air (HEPA) filters and equipment at LaRC.

8.15.2 SCOPE

This section shall apply to the installation and use of new permanent HEPA filters and equipment at LaRC as well as change outs made to permanent systems. These requirements do not apply to portable HEPA filtration systems used on a temporary basis.

8.15.3 REQUIREMENTS

8.15.3.1 Atmosphere Filtration

Air and inert gas shall enter each ventilated area through at least one fire resistant HEPA filter and shall be discharged through at least one fire resistant prefilter and one fire resistant HEPA filter to exhaust ductwork leading to a final filter system.

8.15.3.2 Ventilation System Fire Protection

The ventilation system shall be designed to withstand any credible fire or explosion and shall continue to act as a confinement barrier. Fire protection features of ventilation systems shall include fire resistant materials of construction, fire resistant filters, heat and smoke detectors, alarms, heat removal devices, fire suppression equipment, and fire doors and dampers or other proven devices to restrict the spread of fires.

Design of the system shall include an analysis to determine if the ventilation system is capable of operating under design basis fire conditions as specified in the design criteria. HEPA filtration systems serving as a final means of effluent cleaning shall have at least two stages of fire resistant filters in series in a filter plenum. If it can be determined that the filters can be subjected to sufficient heat to cause failure, the final filters shall be protected by heat removal or sprinkler systems that automatically activate at a preset temperature. If a heat removal system is deemed necessary, an inlet baffle and a spark arrestor and demister shall precede the first stage of filters. If a cooling spray is used for heat removal, it shall be followed by a combination spark arrestor/demister screen to remove entrained droplets. A roughing filter shall be mounted behind these components to remove the bulk of the draft-carried debris.

The cooling spray system shall operate automatically upon abnormal temperature increase indicated by detectors in the exhaust ducts feeding the cool chamber inlet. A manually operated valve actuating the spray system also shall be provided as a backup.

8.15.3.3 Instrumentation

Ventilation systems shall be provided with instrumentation to read out and alarm in one or more central control areas. These areas shall be designed to permit occupancy and the ability to operate ventilation systems safely during normal and abnormal conditions. The instrumentation system shall provide the following:

October 3, 2004

LPR 1710.11

1. Readout from appropriate surveillance instrumentation for all essential functions of the ventilation systems.
2. Visual and/or audible alarms for significant abnormal conditions, such as filter plugging or breakthrough, low airflow or reversal, fire protection system activation, high stack and effluent activity.
3. For normal or abnormal conditions, where combustible solvents, gases, and vapors could possibly be present in a ventilation system, continuous monitoring systems suitable for monitoring such substances shall be included in the design, with readout normally in the control room. The ventilation system shall be designed with flow rates or other features to preclude the possibility of an explosion, as evaluated in the safety analysis document.
4. All HEPA filters shall be equipped with differential pressure instrumentation.

8.15.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure that practices delineated in this section are followed and contact the LaRC Fire Chief prior to installation of new filter and plenum equipment or modification of existing filter and plenum equipment.

LaRC Fire Chief shall evaluate locations requested for the installation of new filter and plenum equipment or modifications of existing filter and plenum equipment.

8.16 FIRE PROTECTION FOR HAZARDOUS MATERIALS STORAGE

8.16.1 PURPOSE

This section establishes the requirements for the storage, handling, and use of hazardous materials at LaRC. Hazardous materials are defined by Section F-2303 of the BOCA National Fire Prevention code and can include flammable and combustible liquids, gases, corrosives, oxidizers, water reactive chemicals, and radioactive materials.

8.16.2 SCOPE

This section shall apply to the handling and storage of hazardous materials at LaRC.

8.16.3 REQUIREMENTS

8.16.3.1 Design

Hazardous material storage shall be separated by minimum distances from other facilities and personnel areas in accordance with the appropriate standard.

Incompatible hazardous materials stored outside of facilities shall be separated from one another by minimum distances as specified in the appropriate standard. Hazardous materials that may cause environmental damage in the event of fire shall be located in separate hazardous material containment buildings or tanks.

Hazardous material storage areas and buildings shall be provided with containment for liquid runoff control.

October 3, 2004

LPR 1710.11

Hazardous material storage buildings and aboveground tanks shall be provided with appropriate fire protection.

Separate hazardous material containment buildings shall be provided with fire sprinkler systems or other approved fire protection control and extinguishing systems.

8.16.3.2 Operation

Incompatible hazardous materials in the same facility shall be separated by suitable fire rated construction. A material that is incompatible with another is a material that can cause hazardous reactions or can promote or initiate combustion with the material.

Examples of materials that require separation from one another are flammable/combustible liquids, corrosive materials, oxidizers, and water reactives.

Hazardous materials shall be stored in appropriate containers.

Accumulation of combustible materials such as cartons, papers, and packaging materials shall be prohibited in and around hazardous material storage.

Weeds, rubbish, or similar combustibles shall not be permitted within 15 feet of hazardous material storage areas.

Portable fire extinguishers in hazardous storage buildings shall be provided for the hazard.

Personnel involved in hazardous material operations shall receive instructions in handling the materials in a safe manner.

Smoking shall not be permitted in or near hazardous materials storage areas.

Hazardous materials storage facilities shall not be used as dispensing facilities.

8.16.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure that practices delineated in this section are followed shall contact the LaRC Fire Chief prior to establishing new hazardous materials storage facilities.

LaRC Fire Chief shall evaluate locations requested to be used as hazardous materials storage facilities.

Center Operations Directorate shall ensure that the design requirements delineated in this section are followed.

Operators/employees shall follow the operational requirements delineated in this section.

8.17 FIRE PROTECTION FOR LABORATORY FACILITIES

8.17.1 PURPOSE

This section establishes the requirements for the installation and use of laboratory facilities at LaRC.

October 3, 2004

LPR 1710.11

8.17.2 SCOPE

This section shall apply to all laboratories at LaRC.

8.17.3 REQUIREMENTS

8.17.3.1 Construction

All laboratories shall meet the minimum constructions requirements specified in the local building code and National Fire Protection Association (NFPA) 45.

All laboratories shall be provided with the appropriate fire protection features in accordance with NFPA 45.

Pressure relief systems shall discharge to a safe location.

All permanent piping shall be identified as to its contents at the supply and discharge points.

Operating controls for apparatus shall be accessible under normal and emergency conditions.

Entrances to laboratory units or areas shall be identified with signs to warn emergency personnel of unusual or severe hazards that are not related to the fire hazard of contents.

8.17.3.2 Operation

The quantity of hazardous chemicals stored in the open in a laboratory work area shall be limited to the amount required for each specific task being performed.

Incompatible materials shall be segregated to prevent accidental contact with one another.

Containers of materials that may become hazardous over time shall be dated and inspected every 6 months to evaluate their condition. Materials that are safe shall be redated, and those that can be made safe by treating them shall be treated and redated. All other materials shall be safely discarded.

Documented monthly housekeeping inspections shall be performed for each laboratory, and corrective action shall be initiated immediately to resolve identified deficiencies.

The required minimum clear width of exits, aisles, and passageways to a public way shall be maintained at all times as specified in NFPA 101.

8.17.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure that practices delineated in this section are followed and contact the LaRC Fire Chief prior to establishing new laboratories or modifying existing laboratories.

LaRC Fire Chief shall evaluate locations requested to be used as laboratories and modifications to existing laboratories.

Center Operations Directorate shall ensure that the design requirements delineated in this section are followed.

October 3, 2004

LPR 1710.11

8.18 FIRE PROTECTION FOR VACANT FACILITIES

8.18.1 PURPOSE

This section establishes the requirements for protecting vacant facilities at LaRC from fire and other related perils.

8.18.2 SCOPE

This section shall apply to all vacant and abandoned facilities at LaRC.

8.18.3 REQUIREMENTS

Vacant facilities are a high-risk target property that require specialized fire protection solutions:

If left totally unsupervised, vacant facilities often are used for inappropriate activities, such as storage, leading to either accidental or intentional ignition.

If the exterior of the facility and the adjacent grounds are allowed to deteriorate, the probability of fire is increased.

Vacant facility shall be managed and protected in accordance with the appropriate provisions of FM Data Sheet 9-17.

Upon vacating or abandoning a facility or property, the occupant shall remove combustible and hazardous materials to the extent specified by the NASA Fire Chief in order to achieve an acceptable level of safety.

Vacant facilities and properties shall be maintained to be free of accumulations of combustible and hazardous materials.

Vacant facilities shall be maintained to be securely locked or barricaded to prevent entry by unauthorized persons.

Required sprinkler and standpipe systems and all component parts shall be maintained in an operable condition at all times. Exception: Where the type of construction, fire separation and security of the structure does not create a fire hazard as approved by the LaRC Fire Chief.

If maintaining sufficient facility heat to avoid freezing is impractical, the automatic sprinkler system shall be arranged for cold weather operation in accordance with FM Data Sheet 2-8N. It shall not be drained and removed from service. If the interruption of heat is likely to be long-term or permanent, wet pipe systems shall be fully converted to dry pipe systems.

Fire alarm systems shall be maintained in operable conditions at all times.

Vacant facilities shall be posted as "No Smoking" areas.

The required minimum clear width of exits, aisles, and passageways to a public way shall not be used for storage and shall be maintained at all times as specified in National Fire Protection Association (NFPA) 101.

October 3, 2004

LPR 1710.11

8.18.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head for Facility or Property Vacated shall ensure that practices delineated in this section are followed.

LaRC Fire Chief shall evaluate vacant facilities in accordance with this section.

CHAPTER 9**9. ASSESSMENT AND ANALYSIS****9.1 FIRE PROTECTION ENGINEERING SURVEY PROGRAM****9.1.1 PURPOSE**

This section identifies the requirements for the fire protection engineering (FPE) survey program.

9.1.2 SCOPE

The requirements of this section shall apply to the performance of FPE surveys at LaRC.

9.1.3 REQUIREMENTS

FPE surveys shall be performed on LaRC facilities with the following priority, and based upon the Fire Protection Engineering (FPE) resources available. FPE surveys shall be conducted for facilities (plus equipment) valued at \$50 million or more, or where a significant safety hazard or vital programs are involved. FPE surveys shall be conducted for facilities (plus equipment) valued at \$10 million to \$50 million. FPE surveys shall be conducted for facilities (plus equipment) valued at \$500,000 to \$10 million. Facilities valued at less than \$500,000 shall not require FPE surveys unless significant programmatic impacts, hazardous materials, or some other type of specialized hazard is involved. The FPE survey reports for each facility shall be retained in accordance with Section 3.8 of this LPR.

The facility FPE surveys shall address, as a minimum, the following items as they relate to fire protection:

1. General description of construction.
2. Fire protection.
3. Fire protection water supplies.
4. Occupancy.
5. Life safety.
6. Special hazards.
7. Exposures.
8. Property loss potential.
9. Programmatic loss potential.
10. Liquid runoff control.
11. Fire department.
12. Approved deviations and waivers for facility.
13. Administrative compliance and housekeeping.
14. Violations and recommendations.

October 3, 2004

LPR 1710.11

An FPE survey schedule shall be prepared annually based on the criteria stated above.

The FPE surveys shall consist of a standardized report covering the topics identified in above. The complete written report shall be issued every other time according to the required assessment frequency, unless significant changes have occurred to the facility. If significant changes have occurred, then the total report must be issued.

The engineer performing the survey shall conduct an opening meeting with the Facility Coordinator and/or Facility Safety Head to discuss the purpose of the review.

The finalized report shall be forwarded to the LaRC Fire Chief for distribution. The LaRC Fire Chief shall ensure all findings are entered on the Fire Protection Engineering Deficiency Database with a 45-day completion date. This date shall be changed when the 30-day response is received from the Facility Coordinator and/or facility safety head. This process shall be to aid the Facility Coordinator and/or Facility Safety Head at the opening meeting.

9.1.4 RESPONSIBILITIES

Facility Coordinator and/or Facility Safety Head shall ensure timely resolution of all findings as a result of a FPE survey.

LaRC Fire Chief shall ensure that FPE surveys are conducted according to the annual schedule and perform tasks as delineated in this section.

9.2 FIRE HAZARD ANALYSIS PROGRAM

9.2.1 PURPOSE

This section provides the requirements for a fire hazard analysis (FHA).

9.2.2 SCOPE

The requirements of this section shall apply to the performance of an FHA at LaRC.

9.2.3 REQUIREMENTS

9.2.3.1 Facilities Requiring an FHA

New facilities, existing high-value facilities, or facilities with significant fire protection issues or concerns generated in the fire protection engineering surveys may have an FHA prepared, as determined by the LaRC Fire Chief.

9.2.3.2 Facility Safety Analysis Report

Each facility required to have a safety analysis report shall include or reference an FHA as part of that report. The FHA shall be documented (including all assumptions).

9.2.3.3 Competent Individual

All FHA's shall be performed under the direction of, or are approved by, a fire protection engineer.

October 3, 2004

LPR 1710.11

9.2.3.4 Minimum Contents

FHA's, as a minimum, shall address the following items:

1. Description of construction.
2. Safety class systems.
3. Fire protection features.
4. Description of fire hazards.
5. Life safety considerations.
6. Critical process equipment.
7. High-value property.
8. Damage potential: maximum credible fire loss (MCFL) and maximum possible fire loss (MPFL).
9. Fire department/brigade response.
10. Recovery potential.
11. Potential for a toxic, biological, and/or radiological incident due to a fire.
12. Emergency planning.
13. Security and safeguards considerations related to fire protection.
14. Natural hazards (earthquake, flood, wind) impact on fire safety.
15. Exposure fire potentials.

9.2.3.5 Single Failure Criteria for FHA's

Each FHA shall assume that one installed, automatic fire protection system will malfunction.

If redundant automatic fire protection systems are provided in the area, only the system whose failure would cause the most vulnerable condition shall be assumed to fail.

Passive fire protection features (such as blank fire rated walls or continuous fire rated cable wraps) shall be assumed to remain viable.

9.2.3.6 Selecting the Analysis Boundary

The focus of the FHA shall be the individual fire areas that comprise the facility. The boundaries of exterior fire areas (yard areas) shall be as determined by the program secretarial officer or delegated authority. Where a facility is not subdivided by fire rated construction, the fire area shall be defined by the exterior walls and roof of the facility.

9.2.3.7 Effect of Fire on Vulnerable Safety Class Systems

An essential element of an acceptable FHA shall be an inventory of all safety class systems within the fire area that are susceptible to fire damage. This shall include those primary and supporting mechanical and electrical systems that must function effectively during and after a fire event to assure safety (including safe shutdown, where

October 3, 2004

LPR 1710.11

applicable). Such safety class systems shall include, but are not limited to, process monitoring instrumentation, instrument air, facility hydraulic system, and emergency lighting system.

For example, loss of the facility ventilation system in a fire (due to damage to power cables) may result in an ambient air temperature increase which may cause the failure of sensitive electrical safety class components such as relays.

9.2.3.8 Credible Failure Modes for Safety Class Systems

All credible fire related failure modes of safety class systems shall be considered.

For example, it is insufficient to assume that fire will merely cause the loss of function of safety class equipment when power cables to that equipment are within the fire area. It is also necessary to consider the potential for spurious signals which may cause the maloperation of such equipment. Similarly, fire induced electrical faults may trip upstream electrical disconnect devices in such a way as to render inoperable other safety class systems that may not even be located within the fire area. In addition, the effects of combustion products, manual fire fighting efforts, and the activation of automatic fire suppression systems must be assessed.

9.2.3.9 Ventilation System Operation and Failures

Fire propagation and the potential for fire induced material dispersal through the facility air distribution system must be considered for the normal operating mode of the air distribution system as well as alternate modes that may result from the fire, such as shutdown.

9.2.3.10 Computer Models

An acceptable tool that shall be used to aid in the development of an FHA is a fire model (such as FPETOOL, FAST, or HARVARD) as applied by fire protection engineers and approved by the authority having jurisdiction (AHJ).

9.2.3.11 Simplifying Assumptions

Where appropriate, as a simplification to the analysis, an assumption is permitted that all potentially vulnerable systems will be damaged within the fire area. Acceptable exceptions to this assumption shall be water filled steel pipes, tanks, and similar components of superior structural integrity with welded fittings and adequate pressure relief.

9.2.3.12 Combustible Material

The quantity and associated hazards of flammable and combustible materials that can be expected to be found within the fire area shall be factored into the analysis. Consideration should also be given to the presence of transient combustibles associated with storage and maintenance activities. Averaging combustible loading over the floor or fire area as a means to characterize the fire severity shall not be considered an acceptable technique.

October 3, 2004

LPR 1710.11

9.2.3.13 Special Considerations for High-Bay Facilities and Areas

FHA's for high-bay locations shall consider the effects of smoke/hot gas stratification that may occur at some intermediate point below the roof or ceiling. The effect of smoke movement through doors and dampers held open by fusible links shall be addressed.

9.2.4 RESPONSIBILITIES

The LaRC Fire Chief shall be responsible for ensuring that FHA's are conducted in accordance with this section.

9.3 FIRE PROTECTION PROGRAM REVIEW/SELF-ASSESSMENT

9.3.1 PURPOSE

This section identifies the requirements for the review and self-assessment of the fire protection program.

9.3.2 SCOPE

The requirements of this section shall apply to the performance of the LaRC fire protection program review and self-assessment.

9.3.3 REQUIREMENTS

LaRC shall conduct periodic reviews of the fire protection program elements and performs a self-assessment of the fire protection program effectiveness to ensure compliance with the NASA fire protection goals and requirements. The frequency shall be every five years.

The fire protection self-assessments must address, as a minimum, the following items:

1. Comprehensive nature of the fire protection program.
2. Procedures for engineering design and review.
3. Procedures for maintenance, testing, and inspection of fire protection equipment/systems, including water supplies.
4. Fire protection engineering staff (number, qualifications, training).
5. Fire suppression organization (personnel and training).
6. Fire suppression mutual aid agreements.
7. Management support.
8. Documented deviations and waivers.
9. Inspection, testing, and maintenance reports.
10. Adequacy of facility appraisal reports.
11. Administrative controls.
12. Temporary protection and interim compensatory measures.
13. Status of previous appraisal findings.
14. New appraisal findings.

October 3, 2004

LPR 1710.11

The fire protection program self-assessment reports shall be retained in accordance with Section 3.8 of this document.

9.3.4 RESPONSIBILITIES

The LaRC Fire Chief shall be responsible for ensuring that fire protection program self-assessments are conducted every five years.

October 3, 2004

LPR 1710.11

CHAPTER 10**10. FIRE DEPARTMENT OPERATIONS AND EMERGENCY RESPONSE****10.1 FIRE DEPARTMENT EMERGENCY EQUIPMENT****10.1.1 PURPOSE**

This section provides specific requirements for LaRC Fire Department emergency equipment, to ensure that it will meet the needs required by LaRC.

10.1.2 SCOPE

This section shall apply to LaRC Fire Department emergency equipment used for fire fighting, specialized rescue, hazardous materials, emergency medical, and other types of emergency response.

10.1.3 REQUIREMENTS**10.1.3.1 Procurement of Fire Department Emergency Equipment**

LaRC Fire Chief shall:

1. Ensure the development of the internal operations procedures to ensure that emergency response equipment meets the minimum specifications of the applicable referenced National Fire Protection Association (NFPA) standards.
2. Prepare the necessary procurement documentation according to the LaRC criteria pertaining to the procurement of equipment.

Office of Procurement shall:

1. Ensure that the ordered emergency equipment meets the specifications as developed by the LaRC Fire Department.
2. Prepare the necessary procurement documentation according to the LaRC criteria pertaining to the procurement of equipment.

10.1.3.2 Use of Fire Department Emergency Equipment

Fire Department Station Officer shall:

1. Develop the internal operating procedures to ensure that emergency equipment is used for its intended purpose.
2. Maintain emergency equipment according to the manufacturer's recommendations and the applicable referenced NFPA standards.
3. Ensure that emergency equipment which does not meet the minimum specifications or is unsafe for use is removed from service and replaced with compliant equipment.

10.1.3.3 Responsibilities

LaRC Fire Chief shall:

October 3, 2004

LPR 1710.11

1. Ensure the development of the internal operating procedures in accordance with this section.
2. Recommend and specify LaRC Fire Department emergency equipment to be purchased.
3. Prepare the appropriate procurement paperwork to purchase the LaRC Fire Department emergency equipment.

LaRC Fire Department Station Officer, in conjunction with the LaRC Fire Chief shall develop the internal operating procedures in accordance with this section and ensure the proper use, maintenance, and care of LaRC Fire Department emergency equipment.

LaRC Fire Department Personnel shall report unsafe emergency equipment to the LaRC Fire Department station officer.

10.2 FIRE DEPARTMENT PERSONNEL PROTECTIVE EQUIPMENT

10.2.1 PURPOSE

This section provides specific requirements for the purchase and care of personal protective equipment used for emergency operations.

10.2.2 SCOPE

This section shall apply to personal protective equipment used for fire fighting, rescue, hazardous materials, emergency medical, and other LaRC Fire Department emergency responses.

10.2.3 REQUIREMENTS

10.2.3.1 Procurement of Personal Protective Equipment

LaRC Fire Chief shall:

1. Ensure the development of the internal operations procedures to ensure that personal protective equipment meets the minimum specifications of the applicable referenced National Fire Protection Association (NFPA) standards.
2. Prepare the necessary procurement documentation according to the LaRC criteria pertaining to the procurement of equipment.

Office of Procurement shall

1. Ensure that the ordered personal protective equipment meets the specifications as developed by the LaRC Fire Chief.
2. Prepare the necessary procurement documentation according to the LaRC criteria pertaining to the procurement of equipment.

10.2.3.2 Use of Personal Protective Equipment

LaRC Fire Chief shall ensure the development of internal operating procedures to make sure that personal protective equipment is utilized for its intended purpose.

October 3, 2004

LPR 1710.11

LaRC Fire Department Station Officer shall:

1. Ensure that personal protective equipment is maintained according to the manufacturer's recommendations and the applicable referenced NFPA standards.
2. Ensure that the personal protective equipment which does not meet the minimum specifications is removed from service and replaced with compliant equipment.

10.2.4 RESPONSIBILITIES

LaRC Fire Chief shall:

1. Ensure the development of the internal operating procedures in accordance with this section.
2. Recommend and specify personal protective equipment to be purchased.
3. Prepare the appropriate procurement paperwork to purchase the personal protective equipment.

LaRC Fire Department Station Officer shall

1. Develop the internal operating procedures in conjunction with the LaRC Fire Chief in accordance with this section.
2. Ensure the proper use, maintenance, and care of personal protective equipment.

10.3 FIRE FIGHTING FORCES

10.3.1 PURPOSE

This section provides specific requirements for establishing the manual fire fighting forces for the fire protection of LaRC and outlines supplemental forces and support units to assist the LaRC fire companies when needed.

10.3.2 SCOPE

This section shall apply to the LaRC fire fighting forces, whether career or volunteer.

10.3.3 REQUIREMENTS

10.3.3.1 Fire Fighting/Fire Department Staffing

Staffing shall be arranged so that a crew with a minimum of six fire fighters is maintained on duty at all times.

10.3.3.2 Training of Fire Department Personnel

First time entrants into the LaRC Fire Department shall attend training as outlined in Section 10.5 of this document.

Fire fighting personnel shall be thoroughly instructed in the hazards of fires, explosions, and radiation, and in the safety precautions to be taken and methods to be used in preventing fires.

October 3, 2004

LPR 1710.11

Continuing education of personnel shall be coordinated between the Hampton Fire Department training officer, station officers and LaRC Fire Chief.

Fire fighting personnel shall have completed NASA Hazardous Materials and Hazardous Waste Operations and Emergency Response (HAZWOPER) training.

10.3.3.3 Fire Department Personnel

Fire Department Personnel shall:

1. Fight fires in accordance with established procedures.
2. Maintain equipment and fire station in accordance with established procedures.
3. Inspect vehicles and operating areas.
4. Render basic and advanced life support in emergencies.
5. Perform other duties as deemed necessary by the Fire Department station officer.

10.3.4 RESPONSIBILITIES

LaRC Fire Chief shall:

1. Ensure that LaRC Fire Department personnel are trained to meet all fire emergencies.
2. Ensure that any assigned volunteer personnel are trained to a level equal to career staff typically assigned.

Hampton Fire Department will coordinate the training of fire fighting forces.

LaRC Fire Fighting Personnel shall perform the tasks delineated in this section.

LaRC Fire Department Station Officer shall assist in the implementation of training activities on his or her shift.

Command Structure and fire ground activity shall be conducted per NASA/City of Hampton Agreement.

10.4 FIRE SUPPRESSION

10.4.1 PURPOSE

This section defines the actions to be taken in the event of fires or other related perils to reduce exposure to personnel and to prevent damage to facilities and equipment from the products of combustion.

Actions are taken to prevent the spread of fire(s) originating outside the boundaries of LaRC from encroaching onto government property.

Precautions are taken to prevent the spread of fire(s) from government property onto private, state, or corporate property.

Measures are implemented to prevent the on-site or off-site release of hazardous materials from fires and other related perils.

October 3, 2004

LPR 1710.11

Specific precautions are taken to prevent products of combustion within production, assembly, warehouse, and mission-essential facilities.

10.4.2 SCOPE

This section shall be implemented when conditions are such that personnel, facilities, equipment, systems, or materials are jeopardized or at risk from fire within the boundaries of LaRC.

10.4.3 REQUIREMENTS

10.4.3.1 General

In the best interest of the government, the LaRC Fire Chief and Fire Department station officer shall implement the appropriate section(s) of this standard to protect life, property, materials, supplies, or equipment from fires. Fire protection of LaRC is of the utmost importance and shall not be jeopardized or compromised.

10.4.3.2 Fire Response

LaRC Emergency Fire Dispatcher shall:

1. Dispatch a LaRC Fire Department officer and fire suppression equipment with the proper staffing to prevent the spread of fire to areas that contain personnel, property, or equipment.
2. Notify the LaRC Fire Chief.

LaRC Fire Chief or Fire Department Station Officer shall:

1. Notify the applicable personnel or organizations to supply equipment that is to be used during suppression operations. Designates a staging area where equipment and personnel are to report.
2. Request that the mutual aid agreements be placed into effect, as appropriate.
3. Advise the Facility Coordinator and/or Facility Safety Head of existing and potential conditions and that this procedure may need to be implemented.

Facility Coordinator and/or Facility Safety Head shall ensure that preparations are made to complete the tasks as requested by the LaRC Fire Department station officer.

10.4.3.3 Post fire Response

LaRC Fire Department Station Officer shall:

1. Ensure that notifications are made to the appropriate persons: Facility Coordinator and/or Facility Safety Head; Duty officer; and LaRC Fire Chief.
2. Ensure that all equipment that was placed out of service is returned to normal or automatic position.

10.4.4 RESPONSIBILITIES

LaRC Fire Chief or Fire Department Station Officer shall:

1. Maintain, implement, and enforce guidelines in this section.

October 3, 2004

LPR 1710.11

2. Use all available manpower and equipment to prevent the spread of fire(s) from or onto government-owned property.
3. Request fire suppression assistance according to the mutual aid agreement.

LaRC Emergency Dispatcher shall:

1. Make appropriate announcements.
2. Inform the Facility Coordinator and/or Facility Safety Head of the shutdowns.
3. Notify the LaRC Fire Chief as directed by the LaRC Fire Department Station Officer.
4. Make the mutual aid requests as directed by the LaRC Fire Chief, LaRC Fire Department Station Officer, or incident commander.

Facility Coordinator and/or Facility Safety Head shall:

1. Take actions to secure/safeguard/protect operations and equipment when informed by the LaRC Fire Chief or LaRC Fire Department Station Officer.
2. Inform his or her managers and supervisors when the provisions of this section are placed into effect.
3. Maintain an up-to-date listing of disabled occupants and their locations.
4. Maintain an up-to-date listing of hazardous materials and their locations.

10.5 FIRE DEPARTMENT TRAINING

10.5.1 PURPOSE

This section provides specific requirements for development and implementation of LaRC Fire Department training.

10.5.2 SCOPE

This section shall apply to the development and implementation of training for the LaRC Fire Department personnel who serve LaRC.

10.5.3 REQUIREMENTS

10.5.3.1 Development of Fire Department Training

Hampton Fire Department and/or LaRC Fire Chief shall:

1. Develop training which covers each facet of emergency response:
 - Fire fighting
 - Emergency medical response
 - Hazardous materials response
 - Rescue

October 3, 2004

LPR 1710.11

2. Develop training for routine operations and skills according to the referenced National Fire Protection Association (NFPA) standards pertaining to professional fire fighter competencies.
3. Ensure that training meets or exceeds the minimum requirements established in the applicable referenced NFPA standards and Virginia Office of Fire Programs

10.5.3.2 Implementation of Fire Department Training

Hampton Fire Department shall:

1. Establish an annual training schedule for the LaRC Fire Department with concurrence of the LaRC Fire Chief. Note: NASA may fund and organize Center specific or other specialized training.
2. Schedule and conduct training classes according to the referenced NFPA standard pertaining to the specific training course.
3. Ensure that all LaRC Fire Department training courses are conducted under the supervision of qualified instructors and that each participant attains the established minimum Competency level.
4. Ensure that all live training evolutions are conducted according to the NFPA standard governing such training and are constantly under the supervision of the Hampton Fire Department safety officer.
5. Maintain LaRC Fire Department training records for each course.
6. Provide the LaRC Fire Chief with up-to-date training records for the personnel.

LaRC Fire Department Personnel shall:

1. Attend the scheduled fire department training sessions.
2. Maintain the minimum Competency level according to the referenced NFPA standard pertaining to professional fire fighter qualifications.
3. Conduct operations according to established training courses governing the specific operations.

Hampton Fire Department Safety Officer will ensure that all training courses are conducted according to established procedures and immediately terminates a training evolution when an unacceptable condition is detected.

10.5.4 RESPONSIBILITIES

LaRC Fire Department Personnel shall develop operating procedures and implement LaRC Fire Department operating procedures.

Hampton Fire Department shall schedule and conduct LaRC Fire Department operations procedure training.

Hampton Fire Department Safety Officer shall maintain minimum safety standards for all LaRC Fire Department training.

October 3, 2004

LPR 1710.11

10.6 FIRE DEPARTMENT MUTUAL AID AGREEMENTS

10.6.1 PURPOSE

This section provides specific requirements for the establishment of fire department mutual aid agreements.

10.6.2 SCOPE

This section shall apply to all fire department mutual aid agreements.

10.6.3 RESPONSIBILITIES

LaRC Director shall

1. Ensure that an active mutual aid agreement has been signed with the surrounding fire departments.
2. Ensure that the LaRC Fire Department is prepared and equipped to meet its obligation as specified in the mutual aid agreement.

LaRC Fire Chief shall ensure that the mutual aid agreement is up-to-date and implement the mutual aid agreement as necessary.

10.7 FIRE DEPARTMENT FACILITY INSPECTIONS

10.7.1 PURPOSE

This section establishes a program for inspecting and reporting unsafe conditions or acts pertaining to fire safety.

10.7.2 SCOPE

This section shall apply to all personnel and facilities at LaRC.

10.7.3 REQUIREMENTS

LaRC Fire Chief shall:

1. Ensure that facility inspections are conducted by qualified personnel.
2. Ensure that routine facility inspections are conducted according to the referenced fire department procedures pertaining to facility inspections and that all deficiencies are tracked to resolution.

Facility Coordinator and/or Facility Safety Head shall:

1. Aid the fire department in conducting facility inspections as requested, including the following: Unlocking doors and providing special escorts
2. Ensure timely correction of all noted unsafe conditions.
3. Ensure that the LaRC Fire Department has a complete up-to-date hazardous materials list.

LaRC Fire Department Personnel shall perform inspections and forward reports to the LaRC Fire Chief for review and resolution.

October 3, 2004

LPR 1710.11

10.7.4 RESPONSIBILITIES

LaRC Fire Chief shall establish a facility fire safety inspection program and implement the facility fire safety inspection program.

Facility Coordinator and/or Facility Safety Head shall support the facility fire safety program and address facility fire safety inspection findings.

LaRC Fire Department Personnel shall conduct fire safety inspections in accordance with the referenced documents.

10.8 EMERGENCY MEDICAL SERVICES

10.8.1 PURPOSE

This section establishes a program for emergency medical response at LaRC.

10.8.2 SCOPE

This section shall apply to emergency medical response at LaRC.

10.8.3 REQUIREMENTS

LaRC Fire Chief shall ensure that emergency medical responses are conducted by qualified personnel and shall ensure that emergency medical responses are conducted according to the referenced fire department procedures.

LaRC Fire Department Station Officer shall ensure that medical responses are conducted according to the referenced fire department procedures and shall ensure timely correction of all noted unsafe conditions.

10.8.4 RESPONSIBILITIES

LaRC Fire Chief shall establish and implement an emergency medical response program.

LaRC Fire Department Station Officer and Emergency Medical Responder shall support the emergency medical response program.

10.9 FIRE DEPARTMENT PREPLANS

10.9.1 PURPOSE

This section establishes a program for the development and maintenance of emergency response preplans.

10.9.2 SCOPE

This section applies to the LaRC Fire Department emergency response preplans.

10.9.3 REQUIREMENTS

10.9.3.1 Frequency

LaRC Fire Chief shall:

October 3, 2004

LPR 1710.11

1. Ensure the establishment of a fire department preplan for each facility and notes the date by which the preplan is to be updated.
2. Ensure that fire department preplans are performed for facilities based on the following frequencies:
 - Annually for facilities having a replacement cost value (including contents) in excess of \$50 million, for special facilities, or for facilities with high programmatic value
 - Every 2 years for facilities having a replacement cost value (including contents) of \$10 million to \$50 million
 - Every 3 years for facilities having a replacement cost value (including contents) of less than \$10 million, or
 - After major modifications are made to the building.

10.9.3.2 Development of Fire Department Preplans

LaRC Fire Department Station Officer shall:

1. Ensure that fire department preplans address the following items as a minimum:
 - Facility occupancy
 - Special hazards
 - Fire protection systems provided for the building
 - Location of fire hydrants
 - Location of fire department connections
 - Water supply available
 - Exposures
 - Plan of attack
 - Special salvage requirements
2. Transmit the complete fire department preplan to the LaRC Fire Chief for review and approval.

The LaRC Fire Chief forwards the fire department preplan to the Facility Coordinator and/or Facility Safety Head for review and comment.

Facility Coordinator and/or Facility Safety Head shall:

1. Provide facility specific support in the development of an accurate fire department preplan.

10.9.4 RESPONSIBILITIES

LaRC Fire Chief shall establish the schedule for the development of fire department preplans.

October 3, 2004

LPR 1710.11

LaRC Fire Department Station Officer shall

1. Develop the preplan as delineated in this section.
2. Work with the Facility Coordinator and/or Facility Safety Head to ensure the accuracy of the preplans.

Facility Coordinator and/or Facility Safety Head shall

1. Provide facility specific input for the development of the fire department preplans.

10.10 FIRE DEPARTMENT HAZARDOUS MATERIAL RESPONSE PROGRAM

10.10.1 PURPOSE

This section establishes and implements a program that will provide the required information on hazardous materials at LaRC and reduce personnel exposures.

10.10.2 SCOPE

This section shall apply to all the members of the LaRC Fire Department and to other non-LaRC Fire Department emergency responders, as applicable.

10.10.3 REQUIREMENTS

Hampton Fire Department shall develop instructional objectives and learning outcomes to support educational activities designed to train fire service personnel to the National Fire Protection Association (NFPA) Hazardous Materials First Responder level. Each objective is a statement of the skills and/or body of knowledge a person must achieve to attain this level of Competency

Response Personnel shall attend Hazardous Materials First Responder training offered by the LaRC Fire Department.

10.10.4 RESPONSIBILITIES

Hampton Fire Department shall develop the Hazardous Materials First Responder Training Program and conduct hazardous materials training.

Fire fighter shall attend hazardous materials training and meet the minimum established First Responder proficiency level.

10.11 FIRE DEPARTMENT SALVAGE PLANS

10.11.1 PURPOSE

This section establishes responsibilities for the emergency salvage of essential equipment exposed to products of combustion or fire fighting agents.

10.11.2 SCOPE

This section shall apply to all LaRC operations having essential equipment and equipment with programmatic value or long-term replacement times.

October 3, 2004

LPR 1710.11

Note: For equipment that does not fall within the above criteria, this standard shall be followed to the extent practicable.

10.11.3 REQUIREMENTS

10.11.3.1 Emergency Salvage Equipment

Emergency salvage equipment required for essential electronic equipment differs for the various locations; however, equipment that shall be provided includes:

1. Waterproof salvage covers (used to protect equipment).
2. Sprinkler stoppers (used to stop unnecessary flow from sprinklers).
3. Squeegees.
4. Mops and buckets.

10.11.3.2 Emergency Salvage Operations

LaRC Fire Chief shall ensure that preplans for salvage of essential equipment are developed and ensure salvage equipment is maintained. In the event of fire, particularly where there is considerable smoke or use of water, prompt salvage operations can greatly aid in the rapid restoration of operations and limitation of damage.

LaRC Fire Department Station Officer shall develop preplans for the salvage of essential equipment covered by this section.

LaRC Fire Fighting Forces shall perform prompt salvage and overhaul operations during emergencies and shall notify the Center Operations Directorate when salvage operations are required.

Center Operations Directorate shall assist the Facility Coordinator and/or Facility Safety Head in developing written procedures for reconditioning essential equipment.

Facility Coordinator and/or Facility Safety Head shall develop written procedures for salvage of essential equipment and shall ensure the necessary reconditioning of essential equipment as required.

10.11.4 RESPONSIBILITIES

LaRC Fire Chief shall:

1. Ensure that the required salvage equipment is maintained
2. Ensure the development of the salvage preplans and the performance of salvage operations.

Center Operations Directorate shall support the development of the procedures for reconditioning essential equipment.

October 3, 2004

LPR 1710.11

APPENDIX A
FORMAT FOR ANNUAL SUMMARY OF FIRE
AND OTHER PROPERTY DAMAGE EXPERIENCE REPORT

- 1.0 Fire Related Deaths and Injuries
(Describe each incident relating to death or injury by fire.)
- 2.0 NASA Loss Experience for the Fiscal Year
 - 2.1 Fire Loss Costs
 - 2.2 Costs of Other Losses
 - 2.2.1 Explosions
 - 2.2.2 Natural Cause Events (earthquakes, tornadoes, etc.)
 - 2.2.3 Electrical Malfunctions
 - 2.2.4 Transportation Losses / On-Site Vehicular Accidents
 - 2.2.5 Mechanical Malfunctions
 - 2.2.6 Hazardous Materials Releases
 - 2.2.7 Miscellaneous Accidents (thermal, chemical, and corrosion related accidents)
- 3.0 Summary of Fire Damage Incidents (List each loss, including the category of loss, amount of loss [\$], date, location, and type of accident.)
 - 3.1 Losses of \$50,000 or More
 - 3.2 Losses of \$1,000 to \$49,999
 - 3.3 Other Losses of Relevance
- 4.0 Significant Program Delays Due to Fire
(Describe all fire incidents that resulted in a significant programmatic delay.)
- 5.0 Incidents Actuating Automatic Fire Suppression Systems
 - 5.1 Monetary Loss
 - 5.2 Type of System
 - 5.3 Number of Sprinkler Heads Activated
 - 5.4 Quantity of Agent Discharged
 - 5.5 Remedial Actions Taken to Prevent Future Accidental Discharge (if applicable)
 - 5.6 Causative Factors
 - 5.6.1 Electrical
 - 5.6.2 Mechanical
 - 5.6.3 Human Error
 - 5.6.4 Acts of Nature
 - 5.6.5 Miscellaneous

October 3, 2004

LPR 1710.11

- 6.0 Halon Reduction Activities
 - 6.1 Halon 1301
 - 6.1.1 Number of Fixed Systems
 - 6.1.2 Total Quantity of Halon 1301 at LaRC
 - 6.1.2.1 Active (in pounds) Including Reserve
 - 6.1.2.2 Inventory (in pounds)
 - 6.1.3 Number of Fixed Systems and System Quantity (in pounds) Deactivated in Last Year
 - 6.1.4 Number of Fixed Systems and System Quantity (in pounds) Converted to Manual Operation in Last Year
 - 6.2 Halon 1211
 - 6.2.1 Total Quantity of Halon 1211 at LaRC
 - 6.2.2.1 Active (in pounds) Including Reserve
 - 6.2.2.2 Inventory (in pounds)
 - 6.2.2 Quantity (in pounds) Replaced by Other Agents in Last Year
- 7.0 Fire Protection Installations Completed During Fiscal Year (Include final engineering and construction costs for projects.)
 - 7.1 Number, Type, and Status of Fire Protection Installations
 - 7.2 Automatic Sprinkler Systems
 - 7.3 Special Extinguishing Systems
 - 7.4 Detection and Alarm Systems
 - 7.5 Water Distribution System
- 8.0 Fire Department Activities
 - 8.1 Number of Responses
 - 8.1.1 Fire
 - 8.1.2 Other Emergency
 - 8.1.3 Other Nonemergency
 - 8.1.4 Medical
 - 8.2 Major Equipment Purchases
 - 8.2.1 Emergency Vehicles (Describe type and purchase price.)
 - 8.2.2 Other (Describe type of equipment and purchase price.)
 - 8.3 In-House Training (Describe notable training programs sponsored during fiscal year.)
 - 8.4 Inspection and Fire Prevention (Describe notable activities or programs conducted during previous fiscal year.)

October 3, 2004

LPR 1710.11

APPENDIX B
SAMPLE
FPE SURVEY DEFICIENCY DATABASE PRINTOUT

27Jul96

FPR Number: II

Violation Number	Facility Number:	Year:	Violation Number
1244-95-V01	1244	1995	V01

Violation Description: **Type of Violation:** FSD

The existing water deluge system within the hangar does not provide satisfactory protection per Section 3-1.1 of NFPA 409; and Chapter 7, Section 700 of STD 8719.11, NASA Safety Standard for Fire Protection.

Recommendation(s):

Provide an approved foam water deluge system(s) and supplemental protection systems designed in accordance with NFPA 16 and NFPA 11 or 11A, respectively. Enhanced fire detection should be provided with this system upgrade and be designed and installed in accordance with NFPA 72.

Status of Violation: **Status Description:**

October 3, 2004

LPR 1710.11

APPENDIX C

FIRE PROTECTION IMPAIRMENT

All impairments of LaRC fire alarm systems, fire suppression systems, control valves, initiating devices, notification appliances, supervisory equipment, water supply, power supply, communications equipment, gas monitoring systems, or other fire and life safety systems or parts thereof shall be promptly reported to the Emergency Dispatch Office (EDO) located at Facility 1248 – NASA Fire Station by calling 864-5600. Information required shall include:

- Name of person reporting impairment
- Company, organization, or work group
- Telephone number
- Equipment impaired
- Equipment location (facility number, room or space number)
- Reason for impairment / outage
- Control Tag number
- Date / time equipment tagged out
- Anticipated date / time equipment to be placed back in service

EDO shall be promptly notified when equipment is restored back in service.